

For Public Consultation

Conservation of Fuel and Energy - Dwellings

Building Regulations

Technical Guidance Document



**An Roinn Tithíochta, Pleanála
agus Rialtais Áitiúil**

Department of Housing, Planning
and Local Government



Building Regulations 2014⁸

Technical Guidance Document L

Conservation of Fuel and Energy - Dwellings

ARNA FHOILSIÚ AG OIFIG AN tSOLÁTHAIR
BAILE ÁTHA CLIATH

Le ceannach díreach ón
OIFIG DHÍOLTA FOILSEACHÁN RIALTAIS,
TEACH SUN ALLIANCE, SRÁID THEACH LAIGHEAN, BAILE ÁTHA CLIATH 2,
nó tríd an bpost ó
FOILSEACHÁN RIALTAIS, AN RANNÓG POST-TRÁCHTA,
AONAD 20 PÁIRC MIONDÍOLA COIS LOCHA, CLÁR CHLAINNE MHUIRIS, CONTAE MHAIGH EO
(Teil: 01-6476834/37 nó 1890 213434; Fax: 01-6476843 nó 094-9378964)
nó trí aon díoltóir leabhar.

PUBLISHED BY THE STATIONERY OFFICE
DUBLIN

To be purchased directly from the
GOVERNMENT PUBLICATIONS SALE OFFICE
SUN ALLIANCE HOUSE, MOLESWORTH STREET, DUBLIN 2,
or by mail order from
GOVERNMENT PUBLICATIONS, POSTAL TRADE SECTION,
UNIT 20 LAKESIDE RETAIL PARK, CLAREMORRIS, CO. MAYO
(Tel: 01-6476834/37 or 1890 213434; Fax: 01-6476843 or 094-9378964)
or through any bookseller.

Price €10.00

ISBN 978-1-4064-2594-9



Printed on recycled paper containing
a minimum of 75% post-consumer waste



**An Roinn Tithíochta,
Pleanála agus Rialtais Áitiúil**
Department of Housing,
Planning and Local Government

Contents

	Page
Introduction	3
Transitional arrangements	3
The guidance	3
Technical specifications	3
Materials and workmanship	4
Interpretation	4
Part L - the requirement	5
Section 0: General guidance	6
0.1 Application of the Regulations	6
0.1.1 General	6
0.1.2 New dwellings	6
0.1.3 Existing dwellings	7
0.2 Technical risks and precautions	8
0.2.1 General	8
0.2.2 Fire safety	8
0.2.3 Ventilation	8
0.3 Thermal conductivity and thermal transmittance	8
0.4 Dimensions	9
0.5 Definitions	10
0.6 Application to buildings of architectural or historical interest	10
0.7 Nearly Zero Energy Buildings (NZEBS)	10
Section 1: New dwellings	12
1.1 Limitation of primary energy use and CO₂ emissions	12
1.2 Renewable energy technologies	14
1.3 Building fabric	16
1.3.1 General	16
1.3.2 Fabric insulation	16
1.3.3 Thermal bridging	17
1.3.4 Building envelope air permeability	18
1.4 Building services	20
1.4.1 General	20
1.4.2 Heating appliance efficiency	20
1.4.3 Space heating and hot water supply system controls	20
1.4.4 Insulation of hot water storage vessels, pipes and ducts	21
1.4.5 Mechanical ventilation systems	22

Contents Cont'd.

1.5 Construction quality and commissioning of services	22
1.5.1 General	22
1.5.2 Insulation continuity and air permeability	22
1.5.3 Thermal bridging	23
1.5.4 Air permeability pressure tests	23
1.5.5 Commissioning of space and water heating systems	24
1.6 User information	24
Section 2: Existing dwellings	25
2.1 Building fabric	25
2.1.1 General	25
2.1.2 Fabric insulation	25
2.1.3 Thermal bridging	27
2.1.4 Air permeability	29
2.2 Building services	29
2.2.1 General	29
2.2.2 Heating appliance efficiency	30
2.2.3 Space heating and hot water supply system controls	31
2.2.4 Insulation of hot water storage vessels, pipes and ducts	32
2.3 Major Renovation	40
Appendices	33
A Calculation of U-values	34
B Fabric insulation: Additional guidance for common constructions	43
C Reference values for calculation of MPEPC and MPCPC	59
D Thermal bridging at junctions and around openings	61
E Achieving compliance with respect to EPC and CPC	74
Standards and publications	76
Other standards and publications	79

Building Regulations

Technical Guidance Document L

Conservation of Fuel and Energy - Dwellings

Introduction

This document has been published by the Minister for Housing, Planning, ~~Community~~ and Local Government under article 7 of the Building Regulations 1997. It provides guidance in relation to the application of Part L of the Second Schedule to the Regulations as inserted by the Building Regulations (Part L Amendment) Regulations 201~~4~~8 (S.I. No. ~~xxx~~ of 201~~4~~8). The guidance in this document applies to dwellings, both new and existing. The guidance in relation to the application of Part L contained in Technical Guidance Document L - Conservation of Fuel and Energy - Buildings other than Dwellings applies to all other new and existing buildings.

The 2018 Part L Regulations (and this document) partly transpose the EU Energy Performance of Buildings Directive Recast (EPBD Recast) 2010/31/EU of 19th May 2010.

The 2017 amendment to Part L (Conservation of Fuel and Energy) of the Building Regulations and this Technical Guidance Document L, provide for the implementation of requirements of Articles 2,3 4, 6 (part of), 7, 8, 9(3,b) of the EU Energy Performance of Buildings Directive – EPBD (recast) (2010/31/EU of 19 May 2010).

These requirements include:

- application of a methodology for the calculation of the energy performance of buildings on the basis of a general framework set out in Annex I to the EPBD (recast).
- setting of minimum energy performance requirements for buildings and the application of these requirements to new buildings to achieve Nearly Zero Energy Buildings;
- ensuring where buildings undergo major renovation that the renovated systems- and components meet minimum thermal performance requirements in so far as this is technically, functionally and economically feasible

The guidance in this document also gives due regard to the cost-optimal levels of minimum energy performance requirements submitted in Ireland's report to the Commission under Article 5 of the EPBD Recast Directive 2010/31/EU of 19th May 2010.

The 2018 Part L Regulations (and this document) set energy performance requirements to achieve Nearly Zero Energy Buildings performance as required by Article 4 (1) of the Directive 2010/31/EU for new dwellings

The document should be read in conjunction with the Building Regulations 1997-2018~~4~~ and other documents published under these Regulations.

In general, Building Regulations apply to the construction of new buildings and to extensions and material alterations to existing buildings. In addition, certain Parts of the Regulations, including Part L, apply to existing buildings where a material change of use takes place.

Transitional arrangements

In general, this document applies to works, or buildings in which a material alteration or change of use or major renovation takes place commences or takes place, as the case may be, on or after 1st April 2019. Insofar as the guidance contained therein relates to dwellings, Technical Guidance Document L - Conservation of Fuel and Energy – Dwellings 2011 (~~Amended 2017~~) ceases to have effect from 31st March 2019. However, the foregoing document may continue to be used in the case of dwellings: -

- where the work, material alteration or the change of use commences or takes place, as the case may be, on or before 31st March 2019, or
- where planning approval or permission has been applied for on or before 31st March 2019 and substantial work has

been completed by [31st March 2020](#). “Substantial work has been completed” means that the structure of the external walls has been erected.

The guidance

The materials, methods of construction, standards and other specifications (including technical specifications) that are referred to in this document are those which are likely to be suitable for the purposes of the Building Regulations (as amended). Where works are carried out in accordance with the guidance in this document, this will, prima facie, indicate compliance with Part L of the Second Schedule to the Building Regulations.

However, the adoption of an approach other than that outlined in the guidance is not precluded provided that the relevant requirements of the Regulations are complied with. Those involved in the design and construction of a building may be required by the relevant building control authority to provide such evidence as is necessary to establish that the requirements of the Regulations are being complied with.

Technical specifications

Building Regulations are made for specific purposes, e.g. to provide, in relation to buildings, for the health, safety and welfare of persons, the conservation of energy and access for people with disabilities.

Technical specifications (including harmonised European Standards, European Technical Approvals, National Standards and Agrément Certificates) are relevant to the extent that they relate to these considerations.

Any reference to a technical specification is a reference to so much of the specification as is relevant in the context in which it arises. Technical specifications may also address other aspects not covered by the Regulations. A reference to a technical specification is to

the latest edition (including any amendments, supplements or addenda) current at the date of publication of this Technical Guidance Document. However, if this version of the technical specification is subsequently revised or updated by the issuing body, the new version may be used as a source of guidance provided that it continues to address the relevant requirements of the Regulations.

A list of other standards and publications that deal with matters relating to this Part of the Building Regulations is included at the end of this document. These standards and publications may be used as a source of further information but do not form part of the guidance.

Materials and workmanship

Under Part D of the Second Schedule to the Building Regulations, building work to which the Regulations apply must be carried out with proper materials and in a workmanlike manner. Guidance in relation to compliance with Part D is contained in Technical Guidance Document D.

Interpretation

In this document, a reference to a section, paragraph, appendix or diagram is, unless otherwise stated, a reference to a section, paragraph, appendix or diagram, as the case may be, of this document. A reference to another Technical Guidance Document is a reference to the latest edition of a document published by the Minister for Housing, Planning, Community and Local Government under article 7 of the Building Regulations 1997 (as amended).

Diagrams are used in this document to illustrate particular aspects of construction - they may not show all the details of construction.

Conservation of Fuel and Energy

Part L - The requirement

The requirements regarding conservation of fuel and energy for dwellings are laid out in Part L of the Second Schedule to the Building Regulations 1997 (S.I. No. 497 of 1997) as amended by the Building Regulations (Part L Amendment) Regulations 2011 (S.I. No. xxx of 2018).

The Second Schedule, insofar as it relates to works relating to dwellings, is amended to read as follows: -

- L1 A building shall be designed and constructed so as to ensure that the energy performance of the building is such as to limit the amount of energy required for the operation of the building and the amount of carbon dioxide (CO₂) emissions associated with this energy use insofar as is reasonably practicable.
- L2 For existing dwellings, the requirements of L1 shall be met by: -
- (a) limiting heat loss and, where appropriate, maximising heat gain through the fabric of the building;
 - (b) controlling, as appropriate, the output of the space heating and hot water systems;
 - (c) limiting the heat loss from pipes, ducts and vessels used for the transport or storage of heated water or air;
 - (d) providing that all oil and gas fired boilers installed as replacements in existing dwellings shall meet a minimum seasonal efficiency of 90% where practicable.
 - (e) when a building undergoes major renovation, the minimum energy performance requirement of the building or the renovated part thereof is upgraded in order to meet the cost optimal level of energy performance in so far as this is technically, functionally and economically feasible.
- L3 For new dwellings, the requirements of L1 shall be met by: -
- (a) providing that the energy performance of the dwelling is such as to limit the calculated primary energy consumption and related carbon dioxide (CO₂) emissions insofar as is reasonably practicable, when both energy consumption and carbon dioxide (CO₂) emissions are calculated using the Dwelling Energy Assessment Procedure (DEAP) published by Sustainable Energy Authority of Ireland;
 - (b) ~~providing that, for new dwellings, a very significant reasonable proportion of the energy consumption to meet the energy performance of a dwelling is provided by renewable energy sources;~~
providing that, the nearly zero or very low amount of energy required is covered to a very significant extent by energy from renewable sources including energy from renewable sources produced on-site or nearby;
 - (c) limiting heat loss and, where appropriate, availing of heat gain through the fabric of the building;

- (d) providing and commissioning energy efficient space and water heating systems with efficient heat sources and effective controls;
- (e) providing that all oil and gas fired boilers shall meet a minimum seasonal efficiency of 90%;
- (f) Ensuring that the building is appropriately designed to avoid the need for cooling
- (f) providing to the dwelling owner sufficient information about the building, the fixed building services and their maintenance requirements so that the building can be operated in such a manner as to use no more fuel and energy than is reasonable.

0.1 Application of The Regulations

0.1.1 General

0.1.1.1 The aim of Part L of the Second Schedule to the Building Regulations is to limit the use of fossil fuel energy and related carbon dioxide (CO₂) emissions arising from the operation of buildings, while ensuring that occupants can achieve adequate levels of lighting and thermal comfort. Buildings should be designed and constructed to achieve this aim as far as is practicable.

0.1.1.2 The guidance in this document applies to works to dwellings only. Guidance for buildings other than dwellings can be found in a separate Technical Guidance Document L - Buildings other than dwellings.

0.1.2 New dwellings

0.1.2.1 For new dwellings, the key issues to be addressed in order to ensure compliance are: -

Whole dwelling performance

- (a) Primary energy consumption and related CO₂ emissions: providing that the calculated primary energy consumption associated with the operation of the dwelling and the related CO₂ emissions when calculated using the Dwelling Energy Assessment Procedure (DEAP) published by the Sustainable Energy Authority of Ireland, as described in Section 1.1, do not exceed a target value specified in this document;

Individual minimum performance levels

The performance levels specified for items (b) to (i) below are in the nature of backstop minimum performance levels so as to ensure reasonable levels of performance for all factors affecting energy use, irrespective of the measures incorporated to achieve compliance with Regulation L3(a).

Meeting the performance levels specified for items (b) to (j) will not necessarily mean that the level specified for primary energy consumption and related CO₂ emissions [item (a)] will be met. One or more of the performance levels specified, for items (b) to (j), will need to be exceeded to achieve this.

- (b) Use of renewable energy sources: providing that the contribution of ~~low or zero-carbon~~ renewable energy sources to the calculated primary energy requirement meets the target for such contribution as set down in Section 1.2;
- (c) Fabric insulation: providing for fabric insulation, including the limitation of thermal bridging, which satisfies the guidance in this regard as set out in Section 1.3 (sub-sections 1.3.2 to 1.3.3);
- (d) Air tightness: limiting air infiltration as set out in sub-section 1.3.4;
- (e) Boiler Heat generator efficiency: providing an efficient boiler or other heat source as set out in sub-section 1.4.2; (f) Building Services Controls: controlling, as appropriate, the demand

for, and output of, space heating and hot water services provided, as set out in sub-section 1.4.3;

- (g) Insulation of pipes, ducts and vessels: limiting the heat loss from pipes, ducts and vessels used for the transport or storage of heated water or air, as set out in sub-section 1.4.4;
- (h) Mechanical Ventilation Systems: providing that, where a mechanical ventilation system is installed, the system meets reasonable performance levels, as set out in sub-section 1.4.5;
- (i) Ensuring that the building is appropriately designed to limit the need for cooling
- (j) Performance of completed dwelling: ensure design and construction process are such that the completed building satisfies compliance targets and design intent. Guidance is given in Section 1.5;

User information

- (k) Ensure that adequate operating and maintenance instructions are available to facilitate operation in an energy efficient manner. Guidance is given in Section 1.6.

~~0.1.2.2 This revision of Part L builds on the previous revision in 2007 and is the next step towards the optimisation of the efficiency of energy use in new dwellings and the minimisation of related CO₂ emissions. The overall aim is to achieve carbon neutral dwellings at the earliest date practicable.~~

0.1.2.3 Consideration may be given to the future upgrading of the building fabric and fixed services so as to reduce further CO₂ emissions associated with the operation and use of these dwellings.

0.1.2.4 Where a dwelling has an attached room or space that is to be used for commercial purposes (e.g. workshop,

surgery, consulting room or office), such room or space should be treated as part of the dwelling if the commercial part could revert to domestic use on a change of ownership, e.g. where there is direct access between the commercial space and the living accommodation, both are contained within the same thermal envelope and the living accommodation occupies a substantial proportion of the total area of the building.

Where a new dwelling forms part of a larger building, the guidance in this document applies to the individual dwelling, and the relevant guidance in Technical Guidance Document L - Conservation of Fuel and Energy – Buildings other than dwellings applies to the non-dwelling parts of the building such as common areas (including common areas of apartment blocks), and in the case of mixed-use developments, the commercial or retail space.

0.1.2.5 The guidance given in this Technical Guidance Document is generally applicable to all works associated with the construction of new dwellings. However, unheated ancillary areas, e.g. a buffer space for solar preheating of ventilation air which are not intended for use as part of the habitable dwelling area should generally be treated as outside the area assessed in relation to energy consumption and CO₂ emissions (see Section 1.1). However, where such areas have the potential to become part of the habitable area, e.g. attached garages, the external fabric elements should comply with the guidance in relation to fabric insulation given in sub-sections 1.3.2 and 1.3.3.

An attached conservatory-style sunspace, or the like, forming part of a new dwelling construction should be treated as an integral part of the habitable area of the dwelling.

0.1.3 Existing dwellings

0.1.3.1 This amendment applies to all works to existing dwellings that are covered by the requirements of the Building Regulations, including extensions, material alterations,

material changes of use, major renovation and window and door replacement. In carrying out this work, the aim should be to limit energy requirements for the operation of the dwelling and associated CO₂ emissions as far as practicable as required by Regulation L1. ~~Specifically, Regulation L2(d) provides that replacement oil and gas boilers should achieve a seasonal efficiency of 90% where practicable.~~ The key issues to be addressed are: -

- (a) Fabric insulation: providing reasonable levels of fabric insulation in all new construction, including the limitation of thermal bridging including, where provided, replacement windows and doors. Guidance is given in sub-sections 2.1.2 and 2.1.3;
- (b) Air tightness: limiting air infiltration through the newly constructed elements as far as practicable. Guidance is given in sub-section 2.1.4;
- (c) Boiler/Heat Generator efficiency: providing an efficient boiler or other heat source as set out in sub-section 2.2.2;
- (d) Building Services Controls: where new space and/or water heating services are provided, controlling, as appropriate, the demand for, and output of, these space heating and hot water services. Guidance on appropriate measures is given in sub-section 2.2.3;
- (e) Insulation of pipes, ducts and vessels: limiting the heat loss from pipes, ducts and vessels used for the transport or storage of heated water or air, as set out in sub-section 2.2.4.

Major Renovation

(l) providing that where more than 25% of the surface area of the building envelope undergoes renovation the energy performance of the whole building should be improved to Cost Optimal level in so far as this is technically, functionally and

economically feasible. Guidance is given in section 2.3.

0.2 TECHNICAL RISKS AND PRECAUTIONS

0.2.1 General

0.2.1.1 The incorporation of additional thickness of thermal insulation and other energy conservation measures can result in changes in traditional construction practice. Appendix B contains general guidance on the construction and installation for common forms of construction for roofs, walls and floors.

0.2.1.2 Care should be taken in design and construction to ensure that changes do not increase the risk of certain types of problems, such as rain penetration and condensation. Some guidance on avoiding such increased risk is given in Appendix B of this document. General guidance on avoiding risks that may arise is also contained in the publication "Thermal insulation: avoiding risks; Building Research Establishment (Ref BR 262)".

0.2.1.3 Guidance in relation to particular issues and methods of construction will be found in relevant standards.

0.2.2 Fire safety

0.2.2.1 Part B of the Second Schedule to the Building Regulations prescribes fire safety requirements. In designing and constructing buildings to comply with Part L, these requirements must be met and the guidance in relation to fire safety in Technical Guidance Document B should be fully taken into account. In particular, it is important to ensure that windows, which provide secondary means of escape in accordance with Technical Guidance Document B, comply with the dimensional and other guidance for such windows set in that document.

0.2.3 Ventilation

0.2.3.1 Part F of the Second Schedule to the Building Regulations prescribes ventilation requirements both to meet the needs of the occupants of the building and to prevent excessive condensation in roofs and roofspaces. A key aim of the provisions in relation to ventilation of occupied spaces is to minimise the risk of condensation, mould growth or other indoor air quality problems. In addition to meeting the requirements of Part F of the Building Regulations, the avoidance of excessive condensation requires that appropriate heating and ventilation regimes be employed in occupied dwellings. Advice for house purchasers and occupants on these issues is published separately by both HomeBond and the Sustainable Energy Authority of Ireland.

0.2.3.2 Part J of the Second Schedule to the Building Regulations prescribes requirements in relation to the supply of air for combustion appliances, including open-flued appliances which draw air from the room or space in which they are situated. Technical Guidance Document J provides guidance in this regard.

0.3 THERMAL CONDUCTIVITY AND THERMAL TRANSMITTANCE

0.3.1 Thermal conductivity (λ -value) relates to a material or substance, and is a measure of the rate at which heat passes through a uniform slab of unit thickness of that material or substance, when unit temperature difference is maintained between its faces. It is expressed in units of Watts per metre per degree (W/mK).

0.3.2 For the purpose of showing compliance with this Part of the Building Regulations, design λ -values based on manufacturers declared values should be used. For thermally homogeneous materials, declared and design values should be determined in accordance with I.S. EN ISO 10456: 2007. Design values for masonry materials should be determined in accordance with I.S. EN

1745: 2012²⁰². For insulation materials, values determined in accordance with the appropriate harmonised European standard should be used. Certified λ -values for foamed insulant materials should take account of the blowing agent actually used. The use of HCFC for this purpose is no longer permitted.

For products or components for which no appropriate standard exists, measured values, certified by an approved body or certified laboratory (see Technical Guidance Document D), should be used.

0.3.3 Table A1 of Appendix A contain λ values for some common building materials. These are primarily based on data contained in I.S. EN ISO 10456: 2007 ~~or in CIBSE Guide A, Section A3~~. These publications also include common values for insulation materials. The values provide a general indication of the thermal conductivity that may be expected for these materials. In the absence of declared values, design values or certified measured values as outlined in paragraph 0.3.2, values of thermal conductivity given in Table A1 may be used. However, values for specific products may differ from these illustrative values. Compliance should be verified for thermal insulation materials using thermal conductivity values derived as outlined in paragraph 0.3.2 above

0.3.4 Thermal transmittance (U-value) relates to a building component or structure, and is a measure of the rate at which heat passes through that component or structure when unit temperature difference is maintained between the ambient air temperatures on each side. It is expressed in units of Watts per square metre per degree of air temperature difference (W/m²K).

0.3.5 Thermal transmittance values (U-values) relevant to this Part of the Regulations are those relating to elements exposed directly or indirectly to the outside air. This includes floors directly in contact with the ground, suspended ground floors

incorporating ventilated or unventilated voids, and elements exposed indirectly via unheated spaces. The U-value takes account of the effect of the ground, voids and unheated spaces on the rate of heat loss, where appropriate. Heat loss through elements that separate dwellings or other premises that can reasonably be assumed to be heated, is considered to be negligible. Such elements do not need to meet any particular U-value nor should they be taken into account in the calculation of CO₂ emissions or overall transmission heat loss.

0.3.6 A range of methods exist for calculating U-values of building elements. Methods of calculation are outlined in Appendix A, together with examples of their use. Alternatively U-values may be based on certified measured values. Measurements of thermal transmission properties of building components generally should be made in accordance with I.S. EN ISO 8990: 1997, or, in the case of windows and doors, I.S. EN ISO 12567-1: 2010~~04~~.

0.3.7 Any part of a roof that has a pitch of 70° or more may be treated as a wall for the purpose of assessing the appropriate level of thermal transmission. Elements separating the building from spaces that can reasonably be assumed to be heated should not be included.

0.3.8 Appendix B contains guidance on the construction and installation for common forms of construction for roofs, walls and floors. It explains the condensation risk and gives guidance on the use of vapour control layers. Table B1 in Appendix B contains indicative U-values for external doors, windows and rooflights (roof windows).

0.3.4 NSAI SR 54:2014 Code of Practice for the Energy Efficient Retrofit of Dwellings provides technical guidance on the energy efficient retrofit of the building fabric and services, the application of retrofit measures on a whole dwelling basis, general building science and the management of retrofit projects.

0.4 DIMENSIONS

0.4.1 Except where otherwise indicated linear measurements for the calculation of wall, roof and floor areas and building volumes should be taken between the finished internal faces of the appropriate external building elements and, in the case of roofs, in the plane of the insulation. Linear measurements for the calculation of the areas of external door, window and rooflight openings should be taken between internal faces of appropriate sills, lintels and reveals.

0.4.2 "Volume" means the total volume enclosed by all enclosing elements and includes the volume of non-usable spaces such as ducts, stairwells and floor voids in intermediate floors.

0.5 DEFINITIONS

For the purposes of this Technical Guidance Document the following definitions apply:

Biomass: Biodegradable fraction of products waste and residues from agriculture (including vegetal and animal substances), forestry and related industries, as well as the biodegradable fraction of industrial and municipal waste, used as a fuel or energy source. Fuels derived from biomass may be in solid, liquid or gas form. In this document, where the term "biomass" is used on its own, it should be taken to mean solid biomass (wood, wood chip, wood pellet, etc).

Biofuel: Liquid or gas fuel derived from biomass.

Note: Biomass (including biofuel) is generally included in Delivered Energy and thus, together with the energy used to produce and deliver it, included in Primary Energy

Delivered Energy: Energy supplied to the building and its systems to satisfy the relevant energy uses, e.g. space heating, water heating, cooling, ventilation, lighting. Delivered energy does not include renewable energy produced on-site. Delivered energy differs from energy use by the extent of on-site conversion and transformation losses,

e.g. boiler efficiency losses.

Energy Use (for a particular purpose, e.g. space heating, water heating, cooling, ventilation, lighting): Energy input to the relevant system to satisfy the relevant purpose.

~~*Delivered Energy:* Energy supplied to the dwelling and its systems to satisfy the relevant energy uses, e.g. space heating, water heating, cooling, ventilation, lighting. Delivered energy does not include renewable energy produced on-site.~~

~~Delivered energy differs from energy use by the extent of on-site conversion and transformation losses, e.g. boiler efficiency losses.~~

Heat pump is an encased assembly or assemblies designed as a unit, using a vapour compression cycle to provide the delivery of heat

Major Renovation: means the renovation of a building where more than 25 % of the surface of the building envelope undergoes renovation.

The surface area of the building thermal envelope means the entire surface area of a building through which it can lose heat to the external environment or the ground, including all heat loss areas of walls, windows, floors and roof". The surface area should be calculated as outlined in section 0.4 using internal dimensions.

Nearly Zero-Energy Building (NZEB): means a building that has a very high energy performance, as determined in accordance with Annex I of the EU Energy Performance of Buildings Directive Recast (EPBD Recast) 2010/31/EU of 19th May 2010. The nearly zero or very low amount of energy required should be covered to a very significant extent by energy from renewable sources, including energy from renewable sources produced on-site or nearby;

Primary Energy: Energy that has not been subjected to any conversion or transformation process. For a dwelling, it is the delivered energy plus the energy used to produce the

energy delivered to the dwelling. It is calculated from the delivered energy, with an allowance for any energy exported from the site, using conversion factors.

Renewable Energy: Energy from renewable non-fossil energy sources, e.g. solar energy (thermal and photovoltaic), wind, hydropower, biomass, geothermal, wave, tidal, landfill gas, sewage treatment plant gas and biogases.

~~*Biomass:* Biodegradable fraction of products, waste and residues from agriculture (including vegetal and animal substances), forestry and related industries, as well as the biodegradable fraction of industrial and municipal waste, used as a fuel or energy source. Fuels derived from biomass may be in solid, liquid or gas form. In this document, where the term "biomass" is used on its own, it should be taken to mean solid biomass (wood, wood chip, wood pellet, etc).~~

Biofuel: Liquid or gas fuel derived from biomass.

Seasonal Efficiency: The seasonal efficiency calculated as defined in the DEAP manual.

Note: *Biomass* (including biofuel) is generally included in Delivered Energy and thus, together with the energy used to produce and deliver it, included in Primary Energy.

0.6 Application to buildings of architectural or historical interest

0.6.1 Part L does not apply to works (including extensions) to an existing building which is a "protected structure" or a "proposed protected structure" within the meaning of the Planning and Development Act 2000 (No. 30 of 2000).

0.6.2 Nevertheless, the application of this Part may pose particular difficulties for habitable buildings which, although not protected structures or proposed protected structures, may be of architectural or historical interest or buildings of traditional

construction with permeable fabric that both absorbs and readily allows the evaporation of moisture.

IS EN 16883 Conservation of cultural heritage — Guidelines for improving the energy performance of historic buildings provides guidelines for sustainably improving the energy performance of historic buildings, e.g. historically, architecturally or culturally valuable buildings, while respecting their heritage significance.

0.6.3 Works such as the replacement of doors, windows and rooflights, the provision of internal and/or external insulation and damp-proofing to walls and basements, insulation to the underside of slating and provision of roof vents and ducting of pipework could all affect the character of the structure.

0.6.4 In general, the type of works described above should be carefully assessed for their material and visual impact on the structure

0.6.5 Historical windows and doors should be repaired rather than replaced, and internal insulation and damp-proofing should not disrupt or damage historic plasterwork or flagstones and should not introduce further moisture into the structure.

0.6.6 Roof insulation should be achieved without damage to slating (either during the works or from erosion due to condensation) and obtrusive vents should not affect the character of the roof.

0.6.7 In specific cases, relaxation of the values proposed may be acceptable, to the local building control authority, if it can be shown to be necessary in order to preserve the architectural and historical integrity of the particular building.

0.6.8 In specific cases, services and their controls can play a large part in improving energy efficiency. In most traditional buildings, building services such as heating systems, plumbing and electrical installations are not original to the building and there may

therefore be some flexibility in altering them.

0.6.9 For more guidance on appropriate measures see “Guidelines No 9: Architectural Heritage Protection - Guidelines for Planning Authorities” and “Energy Efficiency in Traditional Buildings” by the Department of the Environment, Heritage and Local Government.

0.7 NEARLY ZERO ENERGY BUILDINGS (NZEBs)

~~**0.7.1** In accordance with Directive 2010/31/EU of the European Parliament and the Council of 19 May 2010 on the energy performance of buildings (recast), all new dwellings will be nearly zero energy dwellings by 31 December 2020.~~

~~**0.7.2** Nearly Zero Energy Building means a building that has a very high energy performance, as determined in accordance with Annex I to Directive 2010/31/EU of the European Parliament and the Council of 19 May 2010 on the energy performance of buildings (recast) (O.J. No. L 153, 18.6.2010, page 13). The nearly zero or very low amount of energy required should be covered to a very significant extent by energy from renewable sources, including energy from renewable sources produced on-site or nearby.~~

0.7.1 In order to achieve the acceptable primary energy consumption rate for a nearly zero energy dwelling, the calculated energy performance coefficient (EPC) of the dwelling being assessed should be no greater than the Maximum Permitted Energy Performance Coefficient (MPEPC). The MPEPC for a nearly zero energy dwelling is 0.30.

0.7.2 To demonstrate that an acceptable CO₂ emission rate has been achieved for a nearly zero energy dwelling, the calculated carbon performance coefficient (CPC) of the dwelling being assessed should be no greater than the Maximum Permitted Carbon Performance Coefficient (MPCPC). The MPCPC for a nearly zero energy dwelling is 0.35.

Section 1

New dwellings

-
- L1 A building shall be designed and constructed so as to ensure that the energy performance of the building is such as to limit the amount of energy required for the operation of the building and the amount of carbon dioxide (CO₂) emissions associated with this energy use insofar as is reasonably practicable.
- L3 For new dwellings, the requirements of L1 shall be met by: -
- (a) providing that the energy performance of the dwelling is such as to limit the calculated primary energy consumption and related carbon dioxide (CO₂) emissions insofar as is reasonably practicable, when both energy consumption and carbon dioxide (CO₂) emissions are calculated using the Dwelling Energy Assessment Procedure (DEAP) published by Sustainable Energy Authority of Ireland;
 - (b) ~~providing that, for new dwellings, a very significant reasonable proportion of the energy consumption to meet the energy performance of a dwelling is provided by renewable energy sources;~~
providing that, the nearly zero or very low amount of energy required is covered to a very significant extent by energy from renewable sources including energy from renewable sources produced on-site or nearby;
 - (c) limiting heat loss and, where appropriate, availing of heat gain through the fabric of the building;
 - (d) providing and commissioning energy efficient space and water heating systems with efficient heat sources and effective controls;
 - (e) providing that all oil and gas fired boilers shall meet a minimum seasonal efficiency of 90%;
 - (f) providing to the dwelling owner sufficient information about the building, the fixed building services and their maintenance requirements so that the building can be operated in such a manner as to use no more fuel and energy than is reasonable.
-

1.1 Limitation of Primary Energy Use and CO₂ Emissions

1.1.1 This Section provides guidance on how to show compliance with the requirements in relation to primary energy consumption and CO₂ emissions specified in Regulation L3(a). The methodology for calculation to be used is specified in the Regulation as the DEAP methodology. This methodology is published by the Sustainable Energy Authority of Ireland (SEAI) and calculates the energy consumption and CO₂ emissions associated with a standardised use of a dwelling. The energy consumption is expressed in terms of kilowatt hours per square metre floor area per year (kWh/m²/yr) and the CO₂ emissions expressed in terms of kilograms of CO₂ per square metre floor area per year (kg CO₂/m²/yr). Full details of the methodology are available on the SEAI website at <http://www.seai.ie>. The DEAP manual, also available on that website, describes the DEAP methodology. The calculation is based on the energy balance taking into account a range of factors that contribute to annual energy usage and associated CO₂ emissions for the provision of space heating, water heating, ventilation and lighting of a dwelling. These factors include: -

- size, geometry and exposure of the dwelling;
- materials used for construction of the dwelling;
- thermal insulation of the different elements of the building fabric;
- ventilation characteristics of the dwelling and ventilation equipment;
- efficiency, responsiveness and control characteristics of the heating system(s);
- solar gains through glazed openings of the dwelling;
- thermal storage (mass) capacity of the dwelling;

- the fuel used to provide space and water heating, ventilation and lighting;
- renewable and alternative energy generation technologies incorporated in the dwelling;
- air permeability of the dwelling.

1.1.2 The performance criteria are based on the relative values of the calculated primary energy consumption and CO₂ emissions of a dwelling being assessed, and similar calculated values for a reference dwelling. Details of the reference dwelling are given in Appendix C. The criteria are determined as follows: -

- primary energy consumption and CO₂ emissions for both the proposed dwelling and the reference dwelling are calculated using DEAP;
- the calculated primary energy consumption of the proposed dwelling is divided by that of the reference dwelling, the result being the energy performance coefficient (EPC) of the proposed dwelling. To demonstrate that an acceptable primary energy consumption rate has been achieved, the calculated EPC of the dwelling being assessed should be no greater than the Maximum Permitted Energy Performance Coefficient (MPEPC). The MPEPC is ~~0.4~~0.3. This coefficient represents the numerical indicator for the energy performance of Nearly Zero Energy Dwellings.
- the calculated CO₂ emission rate of the proposed dwelling is divided by that of the reference dwelling, the result being the carbon performance coefficient (CPC) of the proposed dwelling. To demonstrate that an acceptable CO₂ emission rate has been achieved, the calculated CPC of the dwelling being assessed should be no greater than the Maximum Permitted Carbon Performance Coefficient (MPCPC). The MPCPC is ~~0.46~~ 0.35. This coefficient

represents the numerical indicator for the CO₂ emission rate for Nearly Zero Energy Dwellings.

The DEAP software will calculate the EPC and CPC of the dwelling being assessed and clearly indicate whether compliance with the requirements of Regulation L3(a) has been achieved.

1.1.3 Where a building contains more than one dwelling (such as in a terrace of houses or a block of apartments), reasonable provision would be to show that: -

- every individual dwelling has an EPC and CPC no greater than the MPEPC and MPCPC respectively; or
- the average EPC and CPC for all dwellings in the building is no greater than the MPEPC and MPCPC respectively.

Where the latter approach is used, the average EPC and CPC are calculated by multiplying the EPC and CPC for each individual dwelling by the floor area of that dwelling, adding together and dividing the results by the sum of the floor areas of all dwellings. Common areas in the building are not included in this calculation.

1.1.4 The requirements that the calculated EPC and CPC do not exceed the calculated MPEPC and MPCPC respectively, applies to the constructed dwelling. It is considered good practice for designers to calculate the EPC and CPC at early design stage in order to ensure that the requirements can be achieved by the constructed building. It is also open to professional bodies or other industry interests to develop model dwelling designs that can confidently be adopted without the need to calculate the EPC and CPC at design stage. However, the use of constructions and service systems which have been assessed at design stage, or other model designs, does not preclude the need to verify compliance by calculating the EPC and CPC when all relevant details of the final

construction are known.

1.1.5 The use of renewable and low carbon technologies, such as solar hot water, biomass (e.g. wood and wood pellets) and heat pumps, whether provided to meet the requirements of this Part of the Building Regulations (see Section 1.2) or provided as additional to meeting that requirement, can facilitate compliance with the requirements in relation to primary energy use and CO₂ emissions. As defined, primary energy does not include energy derived from on-site renewable energy technologies. In addition, as renewable energy technologies generally are characterised by zero, or greatly reduced, CO₂ emissions, the calculated EPC and CPC are reduced by the extent that they replace traditional fossil fuels. As the performance of the reference dwelling (see Appendix C) is not affected by the incorporation of these technologies in a dwelling being assessed, this has the effect of making it easier to achieve compliance with this Part of the Building Regulations when these technologies are used.

For certain dwelling types, use of renewables may prove the most practical approach to achieving compliance. The use of centralised renewable energy sources contributing to a heat distribution system serving all dwelling units in a development or apartment block may prove to be more practicable than providing separate renewable energy for each dwelling individually.

1.2 Renewable energy technologies

1.2.1 This section gives guidance on the minimum level of renewable technologies to be provided to show compliance with Regulation L3(b). Renewable Energy Ratio (RER) is the ratio of the primary energy from renewable energy sources to total primary energy as defined and calculated in DEAP. The following represents a very significant level of energy provision from renewable energy technologies in order to satisfy Regulation L5 (b); -

- Where the MPEPC of 0.3 and MPCPC of 0.35 is achieved a RER of 0.20 represents a very significant level of energy provision from renewable energy technologies

For the purposes of this Section, “renewable energy technologies” means technology, products or equipment that supply energy derived from renewable energy sources, e.g. solar thermal systems, solar photovoltaic systems, biomass systems, systems using biofuels, heat pumps, aerogenerators and other small scale renewable systems.

1.2.2 Where a building or development contains more than one dwelling, reasonable provision would be to show that: -

- every individual dwelling should meet the minimum provision from renewable energy technologies specified in paragraph 1.2.1 above; or
- the average contribution of renewable technologies to all dwellings in the building or development should meet that minimum level of provision per dwelling.

Where the latter approach is used, common areas in the building are not included in this calculation.

1.2.3 In the case of ~~electrically-powered~~ heat pumps DEAP sets the procedure to calculate

the renewable energy provision for use in the Renewable Energy Ratio. ~~only energy in excess of 2.5 times the electrical energy directly consumed by the heat pump can be counted towards meeting the minimum level of energy provision from renewable technology.~~ In the case of systems based on biofuels or biomass, appliances must be designed to run on these fuels only, i.e. incapable of providing thermal energy from fossil fuels, to be accepted as renewable technology for the purposes of this Regulation. For example, a boiler which could operate on either oil or a biofuel mixture would not be considered to be a renewable technology. Similarly a boiler capable of utilizing coal or peat, in addition to a biomass fuel would not be considered a renewable technology.

1.2.4 The use of centralised renewable energy sources contributing to a heat distribution system serving all dwelling units in a district, an area, a development or part of a development, e.g. an apartment block, may prove to be more practicable than providing separate renewable energy for each dwelling individually and may be counted towards the Renewable Energy Ratio.

1.2.5 As an alternative to providing the RER (Renewable Energy Ratio) as outlined in sub-section 1.2.1 the use of a combined heat and power (CHP) system which contributes to the space and water heating energy use would be acceptable.

The primary energy savings due to the use of CHP should be equivalent to the RER of 0.20 contributing to the thermal energy use within the building. The calculation methodology for the primary energy saving contribution is provided in the DEAP calculation.

The design of the CHP system should take account of the output rating of the appliance and the design thermal profile for the development for which it is designed.

It should be suitable for the building application (simultaneous electrical and thermal profile requirements) and not oversized.

Further guidance with regards to the design of CHP systems is available in CIBSE Manual AM 12 Combined Heat and Power in Buildings. Section 4.4 of CIBSE Manual AM 12 details an operating model for CHP sizing and recommends the use of an hour by hour model over a whole year with heat and electricity demand profiles representing an average year. ~~As an alternative to providing 10 kWh/m²/annum thermal energy (or 4 kWh/m²/annum electrical energy) from renewable technology sources, the use of a small-scale combined heat and power (CHP) system which contributes to the space and water heating energy use would be acceptable.~~ This approach may be appropriate in some high density developments, e.g. apartment and mixed-use developments.

~~The energy savings due to the use of CHP should be equivalent to 10 kWh/m²/annum contributing to energy use for domestic hot water heating, space heating or cooling. This energy saving contribution can be calculated using:-~~

~~$$R_{th} = CHP H \times \left[\frac{1}{0.9} + \frac{CHP E \eta}{CHP H \eta \times 0.4} + \frac{1}{CHP H \eta} \right]$$~~

~~Where:-~~

~~R_{th} is the energy saving contribution from the CHP system.~~

~~CHP H is the useful heat output from the CHP system.~~

~~CHP H η is the heat efficiency of the CHP production defined as annual useful heat output divided by the gross calorific fuel input used to produce the sum of useful heat output and electricity from CHP.~~

~~CHP E η is the electrical efficiency of the CHP production defined as annual electricity from cogeneration divided by the fuel input used to produce the sum of useful heat output and~~

~~electricity from CHP.~~

~~The design of the CHP system should take account of the output rating of the appliance and the design heat demand for the development for which it is designed. Further guidance with regards to the design of CHP systems is available in "Heating and Domestic Hot Water Systems for Dwellings—Achieving compliance with Part L 2011" (to be published).~~

1.2.6 Part D of the Building Regulations requires that all works be carried out with proper materials and in a workmanlike manner. "Materials" includes products, components and items of equipment, and guidance is provided on how products, components and items of equipment can be shown to be "proper materials". Renewable technologies should satisfy the requirements of Part D in the same way as other construction products and materials. A range of standards applicable to renewable energy technologies are given in the "Other standards and publications" Section in this document.

For specific renewable technologies, the SEAI maintain databases of acceptable products together with information on relevant performance characteristics. Products listed in these databases may be assumed to be "proper materials" for the purposes of this Part of the Building Regulations. Databases exist for: -

- solar thermal systems;
- wood pellet stoves;
- wood pellet/chip boilers;
- heat pumps.

1.2.7 To ensure that works are carried out in a "workmanlike manner", the design and installation of renewable energy systems to comply with this guidance should be carried out by a person qualified to carry out such work. A suitably qualified installer must have achieved [Quality and Qualifications Ireland \(QQI\)](#) or equivalent certification from an

accredited training course in each of the technology areas they wish to work in. Qualified installers may include SEAI registered installers and FÁS Solas trained plumbers who have completed the renewable technology module, or similar.

1.2.8 Detailed guidance on the specification of renewable technologies for dwellings is contained in the Technical Guidance Document L supporting document “Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L” and the National Standards Authority of Ireland’s SR 50-2: 2012 Code of practice for building services - Part 2: Solar panels ~~(to be published)~~.

1.3 Building fabric

1.3.1 General

1.3.1.1 This section gives guidance on acceptable levels of provision to ensure that heat loss through the fabric of a dwelling is limited insofar as reasonably practicable. Guidance is given on three main issues: -

- insulation levels to be achieved by the plane fabric elements (sub-section 1.3.2);
- thermal bridging (sub-section 1.3.3); and
- limitation of air permeability (sub-section 1.3.4).

1.3.1.2 Unheated areas which are wholly or largely within the building structure, do not have permanent ventilation openings and are not otherwise subject to excessive air-infiltration or ventilation, e.g. common areas such as stairwells, corridors in buildings containing flats, may be considered as within the insulated fabric. In that case, if the external fabric of these areas is insulated to the same level as that achieved by equivalent adjacent external elements, no particular requirement for insulation between a heated dwelling and unheated areas would arise. It should be noted that heat losses to such unheated areas are taken into account by the

DEAP methodology in the calculation of the dwelling EPC and CPC (see Section 1.1).

1.3.2 Fabric insulation

1.3.2.1 The derivation of U-values, including those applicable where heat loss is to an unheated space, is dealt with in paragraphs 0.3.4 to 0.3.8 and Appendix A.

1.3.2.2 In order to limit heat loss through the building fabric reasonable provision should be made to limit transmission heat loss by plane elements of the building fabric. Acceptable levels of thermal insulation for each of the plane elements of the building to achieve this are specified in terms of average area-weighted U-value (U_m) in Table 1 (Column 2) for each fabric element type. These values can be relaxed for individual elements or parts of elements where considered necessary for design or construction reasons. Maximum acceptable values for such elements or parts of elements are specified in Column 3 of Table 1. Where this relaxation is availed of, the average area-weighted values given in Column 2 continue to apply and compensatory insulation measures may be necessary for other elements or parts of elements of that type to ensure that these are met. Where the source of space heating is underfloor heating, a floor U-value of 0.15 W/m²K should generally be satisfactory. ~~Further guidance in relation to insulation of floors where underfloor heating is proposed is contained in the document “Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L 2014” (to be published).~~

1.3.2.3 Reasonable provision would also be achieved if the total heat loss through all the opaque elements did not exceed that which would be the case if each of the area-weighted average U-value (U_m) set out in Table 1 were achieved individually. Where this approach is chosen, the values for individual elements or sections of elements given in Table 1 (Column 3) also apply. For ground floors or exposed floors incorporating underfloor heating, the guidance in paragraph 1.3.2.2 applies.

Table 1 Maximum elemental U-value (W/m ² K) ^{1, 2}		
Column 1 Fabric Elements	Column 2 Area-weighted Average Elemental U-Value (U _m)	Column 3 Average Elemental U-value – individual element or section of element
Roofs		
Pitched roof		
- Insulation at ceiling	0.16	0.3
- Insulation on slope	0.16	
Flat roof	0.20	
Walls	0.21-0.18	0.6
Ground floors ³	0.24-0.18	0.6
Other exposed floors	0.24-0.18	0.6
External doors, windows and rooflights	1.6 1.4 ^{4,5}	3.0
Notes:		
1. The U-value includes the effect of unheated voids or other spaces.		
2. For alternative method of showing compliance see paragraph 1.3.2.3.		
3. For insulation of ground floors and exposed floors incorporating underfloor heating, see paragraph 1.3.2.2.		
4. Windows, doors and rooflights should have a maximum U-value of 1.46 W/m ² K when their combined area is 25% of floor area. However areas and U-values may be varied as set out in Table 2.		
5. A high solar transmittance value g _{perp} improves the overall performance of a window by improving solar gains. The NSAI Window Energy Performance Scheme (WEPS) provides a rating for windows combining heat loss and solar transmittance		

1.3.2.4 The maximum area-weighted average U-value for doors, windows and rooflights of 1.6 W/m²K given in Table 1 applies when the combined area of external door, window and rooflight openings equals 25% of floor area. However, both the permitted combined area of external door, window and rooflight openings and the maximum area-weighted average U-value of these elements may be varied as set out in Table 2. The area of openings should not be reduced below that required for the provision of adequate daylight. BS 8206: Part 2: 2008 Code of Practice for daylight and CIBSE Lighting Guide LG 10 gives advice on adequate daylight provision.

1.3.2.5 Diagram 1 summarises the minimum fabric insulation standards applicable.

Table 2 Permitted variation in combined areas (A _{ope}) and average U-values (U _{ope}) of external doors, windows and rooflights	
Average U-value of windows, doors and rooflights (U _{ope}) (W/m ² K)	Maximum combined area of external doors, windows and rooflights (A _{ope}), expressed as % of floor area (A _f)
0.8	58.9
1.0	44.8
1.2	35.1
1.3	31.9
1.4	29.2
1.5	26.9
1.6	25.0
1.7	23.3
1.8	21.9
1.9	20.6
2.0	19.4
2.2	17.5
2.4	15.9
2.6	14.5
Note:	
Intermediate values of "combined areas" or of "U-values" may be estimated by interpolation in the above Table. Alternatively the following expression may be used to calculate the appropriate value:	
$A_{ope}/A_f = 0.3475 / (U_{ope} - 0.21)$	
This expression may also be used to calculate appropriate values outside the range covered by the Table.	

1.3.3 Thermal bridging

1.3.3.1 To avoid excessive heat losses and local condensation problems, reasonable care should be taken to ensure continuity of insulation and to limit local thermal bridging, e.g. around windows, doors and other wall openings, at junctions between elements and other locations. Any key thermal bridge should not pose a risk of surface or interstitial condensation. Heat loss associated with thermal bridges is taken into account in calculating energy use and CO₂ emissions using the DEAP methodology. See Appendix D for further information in relation to thermal bridging and its effect on dwelling heat loss and how this is taken account of in DEAP calculations.

1.3.3.2 The following represents alternative approaches to making reasonable provision with regard to limitation of thermal bridging: -

- (i) adopt Acceptable Construction Details for typical constructions as shown in sections 1 to 6 in the document “Limiting Thermal Bridging and Air Infiltration – Acceptable Construction Details” for all key junctions;
- (ii) adopt Acceptable Construction Details sections 1 to 6 combined with details from Appendix 2 of the document “Limiting Thermal Bridging and Air Infiltration – Acceptable Construction Details” or other certified details (as defined in (iii) below) for all key junctions;
- (iii) use certified details which have been assessed in accordance, and comply, with Appendix D, e.g. certified by a third party certification body such as Agrément or equivalent or certified by a member of an approved thermal modelers scheme (to be developed) or equivalent for all key junctions;
- (iv) use alternative details which limit the risk of mould growth and surface condensation to an acceptable level as set out in paragraph D.2 of Appendix D for all junctions.

Irrespective of which approach is used, appropriate provision for on-site inspection and related quality control procedures should be made (see sub-sections 1.5.2 and 1.5.3).

1.3.3.3 The DEAP calculation of primary energy use and CO₂ emissions (see Section 1.1) takes account of thermal bridging effects. In general this is done by including an allowance for additional heat loss due to thermal bridging, expressed as a multiplier applied to the total exposed surface area or by the calculation of the transmission heat loss coefficient H_{TB} .

Where provision for thermal bridging is made in accordance with option (i) of paragraph 1.3.3.2, this multiplier (y) may be taken as

0.08 or the transmission heat loss coefficient (H_{TB}) can be calculated for each of the key junctions for the specific dwelling using the psi values given in Tables D1 to D6 in Appendix D.

Where provision for thermal bridging is made in accordance with option (ii) of paragraph 1.3.3.2, the transmission heat loss coefficient (H_{TB}) should be calculated using the psi values associated with the specific details adopted (i.e. Tables D1 to D6 and Appendix 2 of “Limiting Thermal Bridging and Air Infiltration – Acceptable Construction Details” or other certified Psi values).

Where provision for thermal bridging is made in accordance with option (iii) of paragraph 1.3.3.2, the transmission heat loss coefficient (H_{TB}) should be calculated using the psi values associated with the certified specific details adopted.

Where provision for thermal bridging is made in accordance with option (iv) of paragraph 1.3.3.2, this multiplier (y) should be taken as 0.15.

As an alternative to all of the above, the value 0.15 may be used for the multiplier (y) providing the details used limit the risk of mould growth and surface condensation to an acceptable level as set out in paragraph D.2 of Appendix D for all junctions.

The calculation of transmission heat loss (H_{TB}) coefficient is explained in paragraph D.3 Appendix D and Appendix K of the DEAP manual.


1.3.4 Building envelope air permeability

1.3.4.1 To avoid excessive heat losses, reasonable care should be taken to limit the air permeability of the envelope of each dwelling. In this context, envelope is the total area of all floors, walls (including windows and doors), and ceilings bordering the dwelling, including elements adjoining other heated or unheated spaces.

High levels of infiltration can contribute to uncontrolled ventilation. Infiltration is unlikely

to provide adequate ventilation as required in the correct location. It is important as air permeability is reduced that purpose provided ventilation is maintained.

Diagram 1 Average Area Weighted Elemental U-values
(Par. 1.3.2.2)

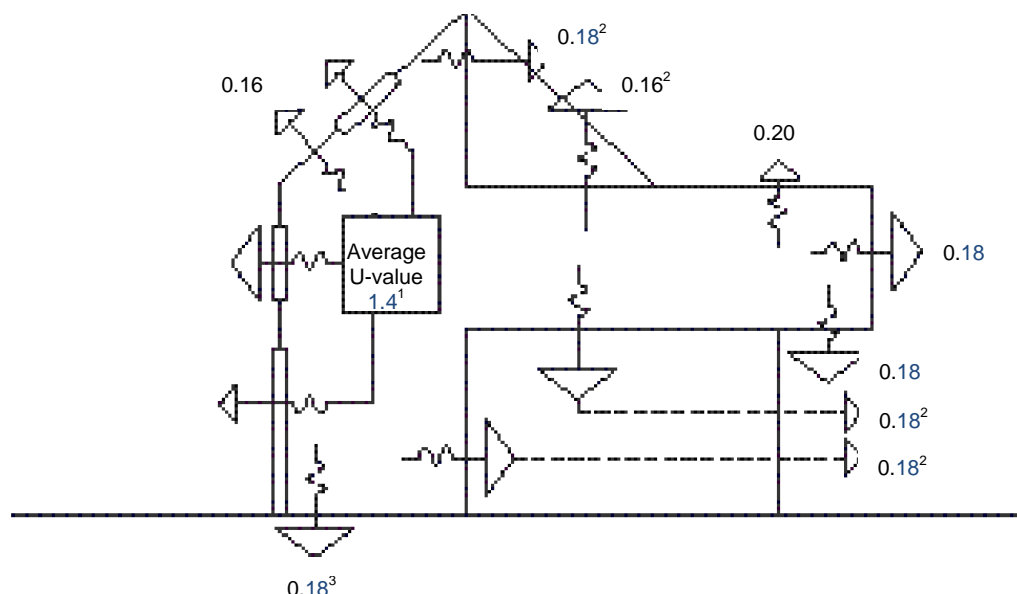

Notes:

Average U-values of all elements may vary as set out in paragraph 1.3.2.3.

1. The average U-value of $1.4 \text{ W/m}^2 \text{ K}$ for windows, doors and rooflights applies **when the area of these elements is equal to 25% of floor-area. Average U-value of these elements may vary as set out in paragraph 1.3.2.4 and Table 2.**

2. The U-values include the effect of unheated voids and other spaces.

3. This U value applies to unheated floors. For floors with underfloor heating the appropriate U value is $0.15 \text{ W/m}^2 \text{ K}$ (see paragraph 1.3.2.2).

1.3.4.2 The following represents a reasonable approach to the design and construction of dwellings to ensure acceptable levels of air permeability: -

- identify the primary air barrier elements, (e.g. sheathing, plaster, vapour control layer, breather membrane) at early design stage;
- develop appropriate details and performance specification to ensure continuity of the air barrier. Communicate these to all those involved in the construction process. Responsibility for construction of details should be established;
- provide on-site inspection regime and

related quality control procedures so as to ensure that the design intention is achieved in practice.

1.3.4.3 Achievement of reasonable levels of air permeability can be facilitated by adopting the standard details referred to in paragraph 1.3.3.2 above, together with an appropriate performance specification and the on-site inspection regime and related quality control procedures, referred to in that paragraph.

Alternative approaches to element design, details and quality control procedures may also be acceptable, provided it can be shown that these approaches provide an equivalent level of performance, as if the standard details, performance specification and quality control procedures referred to above were

adopted.

1.3.4.4 Air pressure testing should be carried out on ~~a proportion of~~ all dwellings on all development sites. See sub-section 1.5.4 for details of the test procedure, extent of testing, use of test results in DEAP calculations and appropriate measures to be undertaken where the limit set is not achieved. When tested in accordance with the procedure referred to in sub-section 1.5.4, a performance level of ~~5~~7 m³/(h.m²) represents a reasonable upper limit for air permeability. Where lower levels of air permeability are achieved it is important that purpose provided ventilation is maintained. For this reason Technical Guidance Document F also provides guidance for buildings with lower air permeability.

1.3.5 Overheating

Guidance is provided in DEAP for carrying out the overheating assessment.

Where an overheating risk is indicated in DEAP further guidance is provided in CIBSE TM 59 to ensure overheating is avoided for normally occupied naturally ventilated spaces.

1.3.6.1 CIBSE TM 37 provides the following recommendations and further guidance to reduce or avoid solar overheating:

(a) *Layout*: planning the layout and orientation of buildings and rooms to maximise the benefits of sunlight and minimise the disadvantages.

(b) *Solar shading*: this may include external, internal or mid-pane shading devices, or solar control glazing.

(c) *Thermal mass*: an exposed heavyweight structure, with a long response time, will tend to absorb heat, resulting in lower peak temperatures on hot days. Night time venting and acoustic requirements should also be taken into account.

(d) *Good ventilation*: a reasonable level of ventilation will always be required in buildings to maintain indoor air quality. The ability to switch to a much higher air change rate can be a very effective way to control solar overheating. E.g. cross ventilation, stack ventilation or mechanical ventilation

(e) *Reducing internal gains*: e.g. energy efficient equipment, lamps
luminaires, and controls

1.4 BUILDING SERVICES

1.4.1 General

1.4.1.1 Regulation L3(d) requires that space and water heating systems in dwellings be energy efficient, with efficient heat sources and effective controls. More specifically, Regulation L3(e) provides that oil or gas fired boilers must achieve a minimum seasonal efficiency of 90%. This Section gives guidance for dwellings where the main space and water heating is based on pumped low temperature hot water systems, utilising radiators for space heating and incorporating a hot water cylinder for the storage of domestic hot water, and the fuel used is natural gas, LPG or oil. Guidance is given on three main issues: -

- (a) heating appliance efficiency (sub-section 1.4.2);
- (b) space heating and hot water supply system controls (sub-section 1.4.3); and
- (c) insulation of hot water storage vessels, pipes and ducts (sub-section 1.4.4).

~~Detailed guidance for dwellings using a wide range of space and water heating systems is contained in a supporting document "Heating and Domestic Hot Water Systems for Dwellings—Achieving compliance with Part L 2011" (to be published).~~

1.4.1.2 This Section also contains guidance in relation to the energy efficiency aspects of: -

(a) biomass independent boilers (paragraph 1.4.2.2), and

(b) mechanical ventilation systems, (subsection 1.4.5),

where provided.

1.4.2 Heating-generator appliance efficiency

1.4.2.1 The appliance or appliances provided to service space heating and hot water systems should be as efficient in use as reasonably practicable. For fully pumped hot water-based central heating systems utilising oil or gas, the boiler seasonal efficiency should be not less than 90% as specified in the DEAP manual and the associated Home-heating Appliance Register of Performance (HARP) database maintained by the SEAI (www.seai.ie/harp).

For fully pumped hot water-based central heating systems utilising electric heat pumps, the seasonal performance factor should be not less than 3.0 for space heating and 1.5 for domestic hot water generation when calculated in accordance with ecodesign regulation

For fully pumped hot water-based central heating systems utilising gas heat pumps, the seasonal performance factor should be not less than 1.5 for space heating and 1.0 for domestic hot water generation when calculated in accordance with ecodesign regulation

1.4.2.2 For fully pumped hot water-based central heating systems utilising a biomass independent boiler, the boiler seasonal efficiency should not be less than 77% as specified in the DEAP manual and the associated Home-heating Appliance Register of performance (HARP) database maintained by the SEAI (www.seai.ie/harp).

1.4.3 Space heating and hot water supply system controls

1.4.3.1 Space and water heating systems should be effectively controlled so as to

ensure the efficient use of energy by limiting the provision of heat energy use to that required to satisfy user requirements, insofar as reasonably practicable. The aim should be to provide the following minimum level of control: -

- automatic control of space heating on the basis of room temperature;
- automatic control of heat input to stored hot water on the basis of stored water temperature;
- separate and independent automatic time control of space heating and hot water;
- shut down of boiler or other heat source when there is no demand for either space or water heating from that source.

The guidance in paragraphs 1.4.3.2 to 1.4.3.5 below is specifically applicable to fully pumped hot water-based central heating systems.

The minimum requirements for controls for heating systems using heat pumps as heat generators are set out in Table 2.

1.4.3.2 Provision should be made to control heat input on the basis of temperature within the heated space, e.g. by the use of room thermostats, thermostatic radiator valves, or other equivalent form of sensing device. For larger dwellings, independent temperature control should generally be provided for separate zones that normally operate at different temperatures, e.g. living and sleeping zones. Thermostats should be located in a position representative of the temperature in the area being controlled and which is not unduly influenced by draughts, direct sunlight or other factors which would directly affect performance. Depending on the design and layout of the dwelling, control on the basis of a single zone will generally be satisfactory for smaller dwellings. For larger dwellings, e.g. where floor area exceeds 100 m², independent temperature control on the basis of two independent zones will generally be appropriate. In certain cases, additional

zone control may be desirable, e.g. zones which experience significant solar or other energy inputs may be controlled separately from zones not experiencing such inputs.

1.4.3.4 Separate and independent time control for space heating and for heating of stored water should be provided. Independent time control of space heating zones is appropriate where independent temperature control applies.

1.4.3.3 Hot water storage vessels should be fitted with thermostatic control that shuts off the supply of heat when the desired storage temperature is reached.

1.4.3.5 The operation of controls should be such that the oil or gas boiler is switched off when no heat is required for either space or water heating, i.e. boiler interlock. Systems controlled by thermostatic radiator valves should be fitted with flow control or other equivalent device to ensure boiler switch off.

Table 2- Minimum Controls for DHW and space heating Heat Pump Systems

	Minimum standard of controls for heat pumps
3.0 Domestic Hot Water (DHW)	<p>a. For full heating, the heat pump and any supplementary domestic hot water heating should be capable of supplying water in the range 60°C to 65°C. This is applicable to ground -to-water, water-to-water and air-to-water type heat pumps.</p> <p>b. If the heat pump is not capable of supplying water at these temperatures, supplementary heating should be provided and controlled as described in other sections of this guide.</p> <p>Controls should include an auxiliary heating regime to 60°C or more for disinfection purposes.</p> <p>c. The domestic hot water system should have temperature control (e.g. a tank thermostat) and time control to optimise the time taken to heat the water</p> <p>d. The heat pump may be utilised for all or part of the DHW load. During the DHW heating period the heat pump may not necessarily be providing heated water to the space heating system</p>
4.0 Controls	<p>a. Heat pump unit controls should include:</p> <ul style="list-style-type: none"> i. control of water pump operation (internal and external as appropriate) ii. Control of water temperature for the distribution system. iii. Control of outdoor fan operation for air-to-water units. iv. Defrost control of external airside heat exchanger for air-to-water systems. v. Protection for water flow failure vi. Protection for water high temperature vii. Protection for high refrigerant pressure viii. Protection of air flow failure on air-to-water units. <p>b. External controls should include:</p>

	<ul style="list-style-type: none"> i. weather compensation or internal temperature control ii. timer or programmer for space heating. c. Minimum heat pump flow rates or volume requirements should be met. If all zones are thermostatically controlled, then a buffer would be an acceptable method of compliance.
--	---

40°C to + 700°C); or

1.4.4 Insulation of hot water storage vessels, pipes and ducts

1.4.4.1 All hot water storage vessels, pipes and ducts associated with the provision of heating and hot water in a dwelling should be insulated to prevent heat loss. Hot water pipes and ducts within the normally heated area of the dwelling that contribute to the heat requirement of the dwelling do not require insulation (except those referred to in paragraph 1.4.4.4). Pipes and ducts which are incorporated into wall, floor or roof construction should be insulated.

1.4.4.2 Adequate insulation of hot water storage vessels can be achieved by the use of a storage vessel with factory applied insulation of such characteristics that, when tested on a 120 litre cylinder complying with I.S. 161: 1975 using the method specified in BS 1566, Part 1: 2002, Appendix B, standing heat losses are restricted to 0.8 W/litre. Use of a storage vessel with 50 mm, factory applied coating of PU-foam having zero ozone depletion potential and a minimum density of 30 kg/m³ satisfies this criterion when installed within the normally heated area of the dwelling. Alternative insulation measures giving equivalent performance may also be used.

1.4.4.3 Unless the heat loss from a pipe or duct carrying hot water contributes to the useful heat requirement of a room or space, the pipe or duct should be insulated. The following levels of insulation should suffice: -

- (a) pipe or duct insulation meeting the recommendations of BS 5422: 2009 Methods of specifying thermal insulating materials for pipes, ductwork and equipment (in the temperature range -

- (b) insulation with material of such thickness as gives an equivalent reduction in heat loss as that achieved using material having a thermal conductivity at 40°C of 0.035 W/mK and a thickness equal to the outside diameter of the pipe, for pipes up to 40 mm diameter, and a thickness of 40 mm for larger pipes.

1.4.4.4 The hot pipes connected to hot water storage vessels, including the vent pipe and the primary flow and return to the heat exchanger, where fitted, should be insulated, to the standard outlined in paragraph 1.4.4.3 above, for at least one metre from their point of connection.

1.4.4.5 It should be noted that water pipes and storage vessels in unheated areas will generally need to be insulated for the purpose of protection against freezing. Guidance on suitable protection measures is given in Technical Guidance Document G and Report BR 262, Thermal insulation: avoiding risks, published by BRE.

1.4.5 Mechanical ventilation systems

1.4.5.1 Guidance on good practice with regard to energy efficiency of dwelling ventilation systems is contained in GPG 268 Energy efficient ventilation in dwellings – a guide for specifiers, available from the SEAI.

1.4.5.2 Where a mechanical ventilation system designed for continuous operation (with or without heat recovery) is installed for the provision of ventilation to a dwelling or significant part thereof, the system should meet the performance levels specified in GPG 268 and also have specific fan power and heat recovery efficiency backstop values

where appropriate not worse than those given in Table 3. Performance data for mechanical ventilation systems from system at www.sap-appendixq.org.uk.

The effectiveness of mechanical ventilation systems improve as air permeability values decrease. Air permeability values of less than ~~3~~**5** m³/(hr.m²) at 50 pa are recommended in dwellings with mechanical ventilation, especially ventilation systems with heat recovery.

Table 3 does not apply to fans installed for intermittent use in individual rooms.

Table 3 Minimum performance levels for mechanical ventilation systems	
System type	Performance
Specific Fan Power (SFP) for continuous supply only and continuous extract only	0.8 0.6 W/litre/sec
SFP for balanced systems	4.5 1.2 W/litre/sec
Heat recovery efficiency	66 70 %

1.5 CONSTRUCTION QUALITY AND COMMISSIONING OF SERVICES

1.5.1 General

1.5.1.1 The requirements of Part L apply to the completed building. Reasonable measures should be taken during construction and appropriate checks and assessments carried out prior to completion to ensure that compliance with Part L is achieved. Sub-sections 1.5.2 to 1.5.4 give guidance on appropriate measures to satisfy this requirement.

1.5.2 Insulation continuity and air permeability

1.5.2.1 The elements that comprise the external fabric of the building should be designed and constructed to ensure that the calculated performance of the building and of its components is achieved in practice. Changes made during design and construction should be assessed for their impact on insulation performance and on air permeability. Those not directly involved in the installation of insulation should be fully

manufacturers for use in DEAP can be obtained from the SAP Appendix Q database

aware of the importance of not reducing the effectiveness of the installed insulation through removal or damage. On-site quality control should include checks on the adequacy of insulation installation and of any barriers designed to limit air permeability, including an inspection of finished work to ensure that all work is properly constructed before covering over.

1.5.3 Thermal bridging

1.5.3.1 There should be no reasonably avoidable thermal bridging, e.g. due to gaps between insulation layers and at joints, junctions and edges around openings. Where unavoidable thermal bridging is provided for in the design, care should be taken to ensure that the chosen design detail is accurately constructed on site.

1.5.4 Air permeability pressure tests

1.5.4.1 Air permeability can be measured by means of pressure testing of a building prior to completion. The procedure for testing is specified in I.S. EN ~~ISO 9972:2015~~**13829:2000** "Thermal performance of buildings: determination of air permeability of buildings: fan pressurization method". Additional guidance on testing procedure is given in Sections 2 to 4 of the BSRIA Guide "Airtightness testing for new dwellings" and CIBSE Technical Manual TM 23 "Testing Buildings for Air leakage" and the ATTMA publication "Measuring air permeability of Building Envelopes". The preferred test method is that controllable ventilator grills should be temporarily sealed rather than just closed. Permeability is calculated by dividing the air leakage rate in m³/hr by the envelope area in m². The performance is assessed at 50 Pascals pressure difference. It has been empirically determined that for dwellings generally the permeability at 50 Pascals pressure difference is approximately 20 times the air change rate at normal conditions. Guidance on appropriate extent of testing is given in paragraph 1.5.4.3.

1.5.4.2 Subject to the guidance in paragraph 1.5.4.7, air pressure testing should be carried out on ~~all a proportion of~~ dwellings on all backstop value of ~~57~~ $\text{m}^3/\text{hr}/\text{m}^2$. The tests should be carried out by a person certified by an independent third party to carry out this work, e.g. [Irish National Accreditation Board](#) (INAB), National Standards Authority of Ireland certified or equivalent. The test report should contain at least the information specified in Section 7 of I.S. EN 13829.

~~1.5.4.3 On each development, an air pressure test should be carried out on at least one unit of each dwelling type. One dwelling from the first four units of each dwelling type planned for completion should be tested. The basic number of tests for each dwelling type is presented in Table 4. The total number tested is related to the number of units of that type in the development and to the results achieved in any earlier tests carried out. Where a number of apartment blocks are constructed on the same site, each block should be treated as a separate development irrespective of the number of blocks on the site.~~

Table 4 — Number of pressure tests per dwelling type	
Number of units	Number of tests
1 to 4	One test
Greater than 4, but equal to or less than 40	Two tests
Greater than 40, but equal to or less than 100	At least 5%
More than 100	
(a) where the first five tests achieve the design air permeability	At least 2% (for dwellings in excess of first 100 units)
(b) where one or more of first five tests do not achieve the design air permeability	At least 5% of units, until 5 successful consecutive tests are achieved, 2% thereafter

1.5.4.4 If the measured air change rates are not worse than the criterion set out in paragraph 1.3.4.4, the test results should be taken as satisfactory evidence that the requirements of Part L3(c), insofar as it relates to air tightness, has been demonstrated for this dwelling type. If satisfactory performance is not achieved in a

development sites including single dwelling developments, as outlined in paragraphs 1.5.4.3 to 1.5.4.6 to show attainment of particular test, then remedial measures should be carried out on the test dwelling and a new test carried out. This should be repeated until the dwelling achieves the criterion set out in paragraph 1.3.4.4. Dwellings completed later than the most recent successful test on a dwelling of this type should either have similar remedial work carried out or should be subject to pressure testing.

~~1.5.4.5 Where remedial work and a new test is required on any dwelling following the initial test, the size of sample for testing should be increased by one, for that dwelling type.~~

1.5.4.6 Where the air permeability assumed for the DEAP calculations is better than the value derived from pressure test results, a check calculation should be carried out to show that the calculated EPC and CPC using the measured air permeability (after any remedial works to satisfy paragraph 1.3.4.4, if such are necessary) are not worse than the MPEPC and MPCPC respectively. If necessary, additional remedial works or other measures should be carried out to ensure that this criterion is also met. Where further remedial works to reduce air permeability are undertaken, a further test would be necessary to verify revised air permeability figure to be used in revised DEAP calculations.

~~1.5.4.7 Where an air permeability value better than the backstop value of $7 \text{ m}^3/\text{hr}/\text{m}^2$ at 50 Pascals is claimed for use in DEAP, a test should be performed on each dwelling claiming that value.~~

~~1.5.4.8 For small developments comprising no more than three dwelling units, specific pressure testing of these dwellings would not be necessary if it can be demonstrated with air pressure test reports that, during the preceding 12 month period, a dwelling of the same dwelling type constructed by the same builder had been pressure tested according to the procedures given in this sub-section~~

~~and had satisfied the criterion set in paragraph 1.3.4.4. However, if the assumed air change rate in the calculation of the EPC value should be carried out. The guidance given in this sub-section would apply in this situation.~~

1.5.4.9 Air pressurisation test reports should be retained by the developer of the dwelling as proof of performance, and copies included in the user information referred to in Section 1.6.

1.5.5 Commissioning space and water heating systems

1.5.5.1 The heating and hot water system(s) should be commissioned so that at completion, the system(s) and their controls are left in the intended working order and can operate efficiently for the purposes of the conservation of fuel and energy. The procedure for carrying out commissioning of these systems is set out in “Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L 2018” (to be published).

1.6 USER INFORMATION

1.6.1 The owner of the building should be provided with sufficient information about the building, the fixed building services and their maintenance requirements so that the building can be operated in such a manner as to use no more fuel and energy than is reasonable in the circumstances. A way of complying would be to provide a suitable set of operating and maintenance instructions aimed at achieving economy in the use of fuel and energy in a way that householders can understand. The instructions should be directly related to the particular system(s) installed in the dwelling. Without prejudice to the need to comply with health and safety requirements, the instructions should explain to the occupier of the dwelling how to operate the system(s) efficiently. This should include: -

- (a) the making of adjustments to the timing and temperature control settings; and

~~and CPC using the DEAP methodology is less than the criterion set in paragraph 1.3.4.4, a pressure test to verify this assumed~~

- (b) what routine maintenance is needed to enable operating efficiency to be maintained at a reasonable level through the service life(lives) of the system(s).

(c) the operation and maintenance of renewable energy systems

The information to satisfy this requirement may be provided in the context of the Advisory Report to the mandatory Building Energy Rating certificate, augmented as appropriate.

Section 2

Existing dwellings

- L1 A building shall be designed and constructed so as to ensure that the energy performance of the building is such as to limit the amount of energy required for the operation of the building and the amount of carbon dioxide (CO₂) emissions associated with this energy use insofar as is reasonably practicable.
- L2 For existing dwellings, the requirements of L1 shall be met by: -
- (a) limiting heat loss and, where appropriate, maximising heat gain through the fabric of the building;
 - (b) controlling, as appropriate, the output of the space heating and hot water systems;
 - (c) limiting the heat loss from pipes, ducts and vessels used for the transport or storage of heated water or air;
 - (d) providing that all oil and gas fired boilers installed as replacements in existing dwellings shall meet a minimum seasonal efficiency of 90% where practicable.
 - (e) when a building undergoes major renovation, the minimum energy performance requirement of the building or the renovated part thereof is upgraded in order to meet the cost optimal level of energy performance in so far as this is technically, functionally and economically feasible.

2.1 BUILDING FABRIC

2.1.1 General

2.1.1.1 This section gives guidance on acceptable levels of provision to ensure that heat loss through fabric elements provided by way of extension, material alteration or, replacement of doors and windows to an existing dwelling is limited insofar as reasonably practicable. Guidance is given on three main issues: -

- insulation levels to be achieved by the plane fabric elements (sub-section 2.1.2);
- thermal bridging (sub-section 2.1.3); and
- limitation of air permeability (sub-section 2.1.4).

Where a material change of use of an existing building to use as a dwelling occurs, the performance of the fabric elements of the newly provided dwelling should also meet the performance levels specified in this sub-section.

2.1.1.2 This Part of the Building Regulations applies to the replacement of external doors, windows, or rooflights in an existing building. The average U-value of replacement units should not exceed the value of 1.6 W/m²K set out in Table 5. In this context, the repair or renewal of parts of individual elements, e.g. window glass, window casement sash, door leaf, should be considered as repair and not replacement.

2.1.1.3 Unheated areas which are wholly or largely within the building structure, do not have permanent ventilation openings and are not otherwise subject to excessive air-infiltration or ventilation, e.g. common areas such as stairwells, corridors in buildings containing flats, may be considered as within the insulated fabric. In that case, if the external fabric of these areas is insulated to the same level as that achieved by equivalent adjacent external elements, no particular requirement for insulation between a heated dwelling and unheated areas would arise.

2.1.2.1 The derivation of U-values, including those applicable where heat loss is to an unheated space, is dealt with in paragraphs 0.3.4 to 0.3.8 and Appendix A.

2.1.2 Fabric insulation

~~**2.1.2.1** The derivation of U-values, including those applicable where heat loss is to an unheated space, is dealt with in paragraphs 0.3.4 to 0.3.8 and Appendix A.~~

Extensions

2.1.2.12 Acceptable levels of thermal insulation for each of the plane elements of the building are specified in terms of average area-weighted U-value (U_m) in Tables 1 and 5 for each fabric element type for extensions (Table 1, Column 2) and these values can be relaxed for individual elements or parts of elements where considered necessary for design or construction reasons. Maximum acceptable values for such elements or parts of elements are specified in Column 3 of Tables 1.. Where this relaxation is availed of, the average area-weighted values given in the Tables continue to apply and compensatory insulation measures may be necessary for other elements or parts of elements of that type to ensure that these are met. Where the source of space heating is underfloor heating, a floor U-value of 0.15 W/m²K should generally be satisfactory. Further guidance in relation to insulation of floors where underfloor heating is proposed is contained in the document "Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L 2011" (to be published).

2.1.2.3 For extensions, reasonable provision would also be achieved if the total heat loss through all the opaque elements did not exceed that which would be the case if each of the area-weighted average U-value (U_m) set out in Table 1 were achieved individually. Where this approach is chosen, the values for individual elements or sections of elements given in Table 1 Column 3 apply to each relevant element. For ground floors or exposed floors incorporating underfloor heating, the guidance in paragraph 2.1.2.2

applies.

2.1.2.4 For extensions, the maximum area-weighted average U-value for doors, windows and rooflights of $1.40 \text{ W/m}^2\text{K}$ given in Table 1 applies when the combined area of external door, window and rooflight openings equals 25% of floor area. However, both the permitted combined area of external door, window and rooflight openings and the maximum area-weighted average U-value of these elements may be varied as set out in Table 6. The area of openings should not be reduced below that required for the provision of adequate daylight. BS 8206: Part 2: 2008 Code of practice for daylighting and CIBSE Lighting Guide LG10 for daylight gives advice on adequate daylight provision.

2.1.2.5 In applying paragraph 2.1.2.4 to an extension to an existing dwelling, the relevant floor area may be taken to be:-

- (a) the combined floor area of the existing dwelling and extension; in this case the combined area of external doors, windows and rooflight openings refers to the area of such openings in the extended dwelling, i.e. the opening area of retained external doors, windows and rooflights together with the opening area of external doors, windows and rooflights in the extension; or
- (b) the floor area of the extension alone; in this case the combined area of external doors, window and rooflight openings refers to the area of such openings in the extension alone. In this case, the maximum combined area of external doors, windows and rooflights derived using Table 6 can be increased by an area equivalent to the area of external door, window and rooflight openings of the existing dwellings which have been closed or covered over by the extension.

Table 6 Permitted variation in combined areas (A_{ope}) and average U-values (U_{ope}) of external doors, windows and rooflights

Average U-value of windows, doors and rooflights (U_{ope}) ($\text{W/m}^2\text{K}$)	Maximum combined area of external doors, windows and rooflights (A_{ope}), expressed as % of floor area (A_f)
0.8	58.9
1.0	44.0
1.2	35.1
1.3	31.9
1.4	29.2
1.5	26.9
1.6	25.0
1.7	23.3
1.8	21.9
1.9	20.6
2.0	19.4
2.2	17.5
2.4	15.9
2.6	14.5

Note:
Intermediate values of "combined areas" or of "U-values" may be estimated by interpolation in the above Table. Alternatively the following expression may be used to calculate the appropriate value:-

$A_{ope}/A_f = 0.3475 / (U_{ope} - 0.21)$
This expression may also be used to calculate appropriate values outside the range covered by the Table.

For extensions which: -

- are thermally separated from the adjacent spaces within the building by walls, doors and other opaque or glazed elements which have U-values not more than 10% greater than corresponding exposed areas of the main dwelling, and
- are unheated or, if provided with a heating facility, have provision for automatic temperature and on-off control independent of the heating provision in the existing building,

the limitation on the combined area of exposed external door, window and rooflight openings does not apply. In this case the average U-value of these elements should not exceed the value of $1.40 \text{ W/m}^2\text{K}$.

Material Alterations and Material Change of Use

2.1.2.2 Acceptable levels of thermal insulation for each of the plane elements of the building are specified in terms of average area-weighted U-value (U_m) for material alterations and material changes of use (Table 5, Column 2). These values can be relaxed for individual elements or parts of elements where considered necessary for design or construction reasons. Maximum acceptable values for such elements or parts of elements are specified in Column 3 of Tables 5. Where this relaxation is availed of,

the average area-weighted values given in the Tables continue to apply and compensatory insulation measures may be necessary for other elements or parts of elements of that type to ensure that these are met. Where the source of space heating is underfloor heating, a floor U-value of $0.15 \text{ W/m}^2\text{K}$ should generally be satisfactory. Further guidance in relation to insulation of floors where underfloor heating is proposed is contained in the document "Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L 2018" (to be published).

Table 5 Maximum elemental U value ($\text{W/m}^2\text{K}$)^{1, 2} for Material Alterations or Material Change of Use		
Column 1 Fabric Elements	Column 2 Area-weighted Average Elemental U-Value (U_m)	Column 3 Average Elemental U-value – individual element or section of element
Roofs		
Pitched roof		
- Insulation at ceiling	0.16	0.35
- Insulation on slope	0.25	
Flat roof	0.25	
Walls		
Cavity walls ⁴	0.55	0.60
Other walls	0.35	
Ground floors ³	-	-
	0.45 ⁵	
Other exposed floors ³	0.25	0.60
External doors, windows and rooflights and curtain walling	1.640 ⁴	3.0
Notes: 1. The U-value includes the effect of unheated voids or other spaces. 2. For material alterations, the U-values relate to the new works. 3. For insulation of ground floors and exposed floors incorporating underfloor heating, see paragraph 2.1.2.2. 4. For extensions and material change of use, windows, doors and rooflights should have a maximum U-value of $1.6 \text{ W/m}^2\text{K}$ when their combined area is 25% of floor area. However areas and U-values may be varied as set out in Table 6 and paragraph 2.1.2.4. 5.4 This only applies in the case of a wall suitable for the installation of cavity insulation. Where this is not the case it should be treated as for "other walls". 6.5 This U value only applies where floors are being replaced.		

2.1.2.6 This Part of the Building Regulations applies to the replacement of external doors, windows, or rooflights in an existing dwelling. The average U-value of replacement units should not exceed the value of $1.60 \text{ W/m}^2\text{K}$ set out in Table 5. In this context, the repair or renewal of parts of individual elements, e.g. window glass, window casement sash, door leaf, should be considered as repair and not replacement.

2.1.3 Thermal bridging

2.1.3.1 To avoid excessive heat losses and local condensation problems, reasonable care should be taken to ensure continuity of insulation and to limit local thermal bridging, e.g. around windows, doors and other wall openings, at junctions between elements and other locations. Any thermal bridge should not pose a risk of surface or interstitial condensation. See Appendix D for further information in relation to thermal bridging and its effect on dwelling heat loss.

2.1.3.2 Reasonable provision with regard to limitation of thermal bridging for extensions is to adopt Acceptable Construction Details for typical constructions as shown in the document “Limiting Thermal Bridging and Air Infiltration – Acceptable Construction Details” and [SR 54 NSAI SR 54:2014 Code of Practice for the Energy Efficient Retrofit of Dwellings- Annex H](#) or other details that are similar or have been assessed as limiting thermal bridging to an equivalent level.

2.1.3.3 For material alterations or material change of use lintel, jamb and sill designs similar to those shown in [Annex H Diagram 2 SR 54 NSAI SR 54:2014 Code of Practice for the Energy Efficient Retrofit of Dwellings](#) would be satisfactory and heat losses due to thermal bridging can be ignored if they are adopted. ~~At lintel, jambs and sills generally a 15 mm thickness of insulation material having a value of 0.033 W/mK (or equivalent) will generally be adequate. Where advanced levels of insulation are applied a higher thermal resistance may be necessary.~~

2.1.3.4 For material alterations or material change of use care should be taken to control the risk of thermal bridging at the edges of floors where the floor is being replaced. The insulation should have minimum thermal resistance of $0.7 \text{ m}^2\text{K/W}$ (25 mm of insulation with thermal conductivity of 0.035 W/mK , or equivalent).

2.1.4 Air permeability

2.1.4.1 For extensions to existing dwellings reasonable levels of air permeability can be achieved by adopting the standard details referred to in paragraph 2.1.3.2 above, together with an appropriate performance specification and the on-site inspection regime and related quality control procedures as referred to in sub-sections 1.5.2 and 1.5.3. Alternative approaches to element design, details and quality control procedures may also be acceptable, provided it can be shown that these approaches are equivalent.


2.1.4.2 For material alterations or material change of use infiltration of cold outside air should be limited by reducing unintentional air paths as far as is practicable. Measures to ensure this include: -

- (a) sealing the void between dry-lining and masonry walls at the edges of openings such as windows and doors, and at the junctions with walls, floors and ceilings (e.g. by continuous bands of bonding plaster or battens);
- (b) sealing vapour control membranes in timber-frame constructions;
- (c) fitting draught-stripping in the frames of openable elements of windows, doors and rooflights;
- (d) sealing around loft hatches;
- (e) ensuring boxing for concealed services is sealed at floor and ceiling levels and sealing piped services where they penetrate or project into hollow constructions or voids.

measures. Further information on sealing service penetrations can also be found in the Introduction Section of Acceptable Construction Details.

Diagram 2 illustrates some of these Care should be taken to ensure compliance with the ventilation requirements of Part F and of Part J of the Building Regulations.

Diagram 2 — Lintel, jamb and sill designs
(Par. 2.1.3.3)

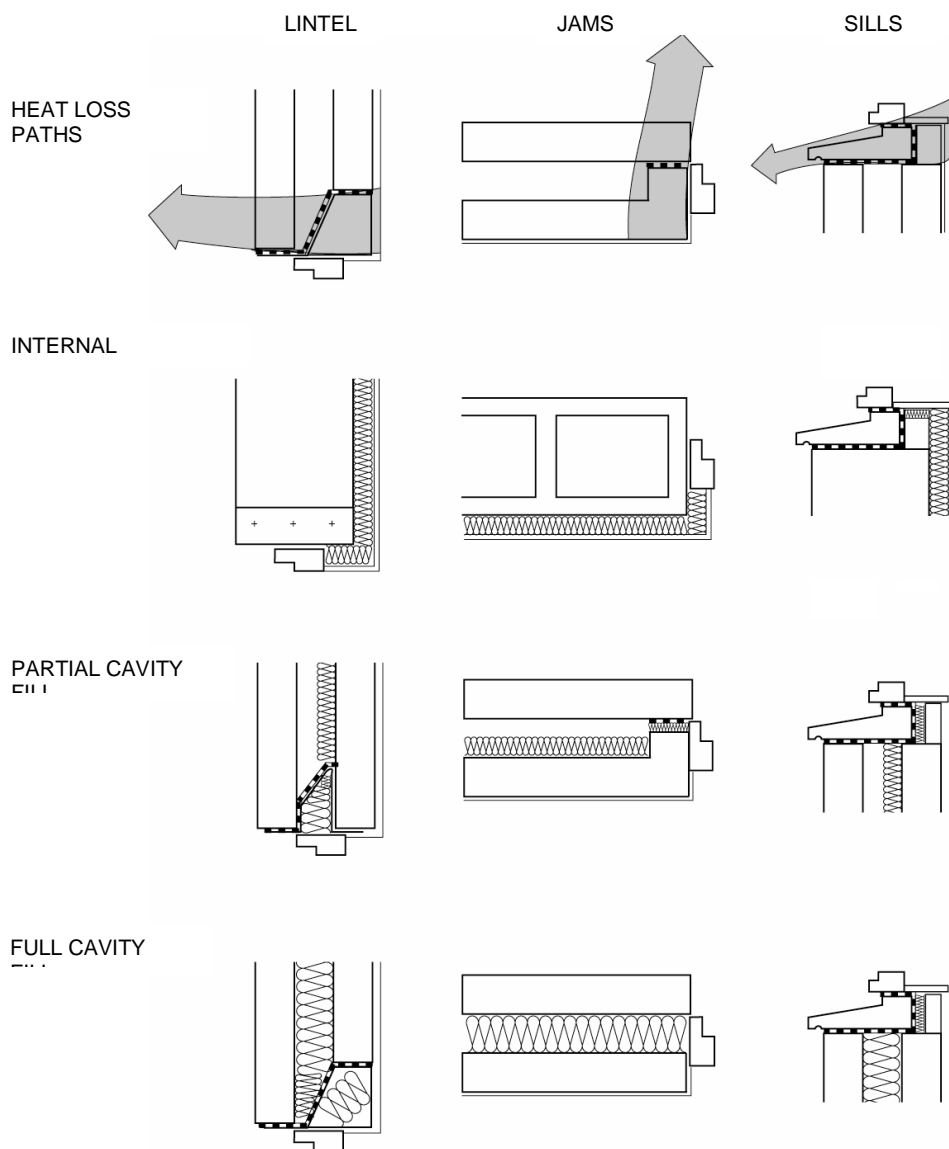

Note:

1. The internal faces of metal lintels should be covered with at least 15 mm of lightweight plaster; alternatively they can be dry-lined.
2. Where external insulation is used, thermal bridging details in accordance with third party certification should be used.
3. Further information on good practice details can be found in Acceptable Construction Details and may be applied to material alterations or material change of use in certain circumstances.

2.2 BUILDING SERVICES


2.2.1 General

2.2.1.1 Space and water heating systems provided in the context of material alterations to existing dwellings or extensions to existing dwellings should be energy efficient and have efficient heat sources and effective controls. Similar considerations apply to space and water heating systems provided in the context of a material change of use of an existing building to use as a dwelling. Specifically, Regulation L2(d) provides that oil or gas fired boilers installed as replacements in existing dwellings should have a minimum seasonal efficiency of 90%, where practicable.

This Section gives guidance where the main space and water heating is based on pumped low temperature hot water systems, ~~utilising radiators for space heating and incorporating a hot water cylinder for the storage of domestic hot water, and the fuel used is natural gas, LPG or oil.~~ Guidance is given on three main issues: -

- (a) heating appliance efficiency (sub-section 2.2.2);
- (b) space heating and hot water supply system controls (sub-section 2.2.3); and
- (c) insulation of hot water storage vessels, pipes and ducts (sub-section 2.2.4).

Diagram 2 Air infiltration measures
(Par. 2.1.4.1)

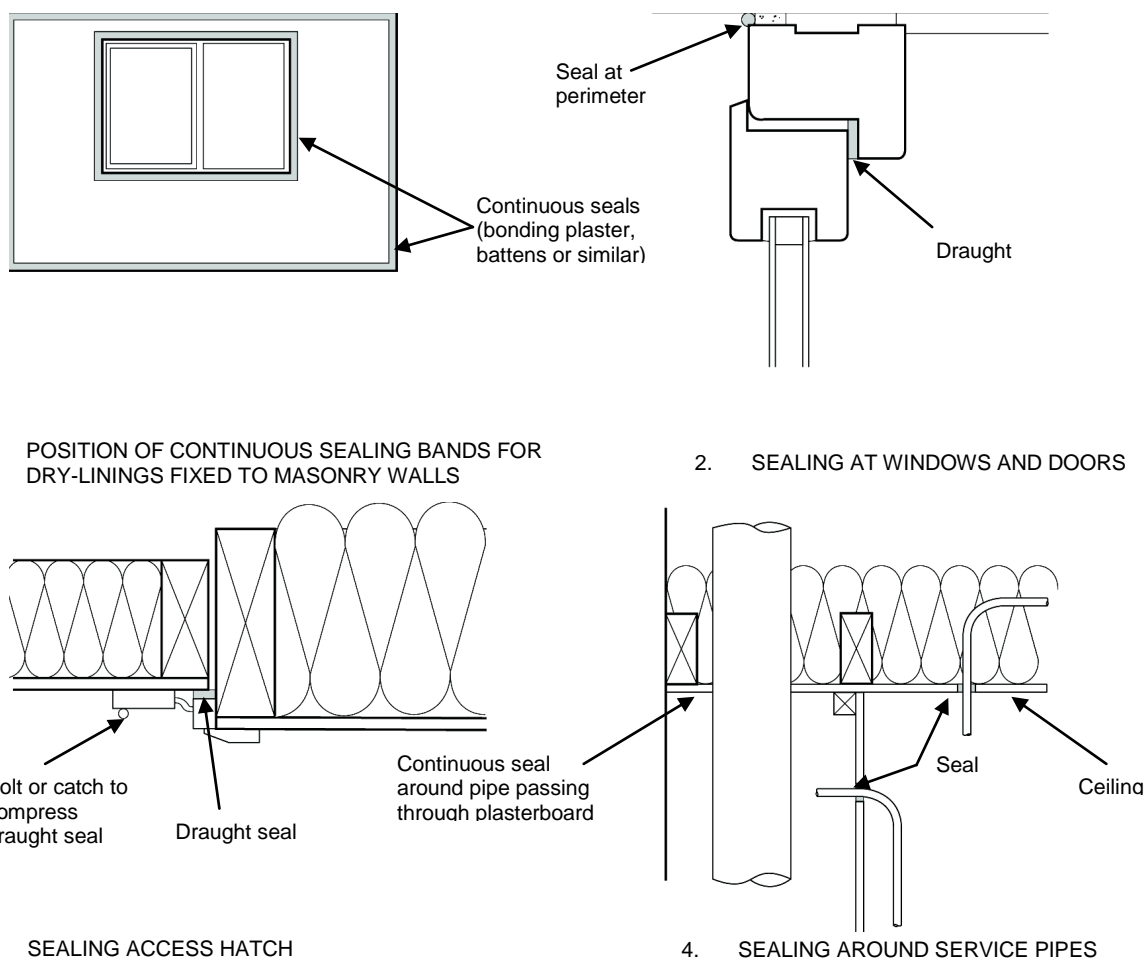

Detailed guidance for dwellings using a wide range of space and water heating systems is contained in a supporting document “Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L 2011” (to be published).

2.2.1.2 This Section also contains guidance in relation to the energy efficiency aspects of biomass independent boilers (paragraph 2.2.2.2) where provided.

2.2.2 Heat Generatoring-appliance efficiency

2.2.2.1 The appliance or appliances provided to service space heating and hot water systems should be as efficient in use as reasonably practicable. Guidance on appropriate efficiency for various systems and fuels is contained in “Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L 2018” (to be published). For fully pumped hot water-based central heating systems utilising oil or gas, the boiler seasonal efficiency should be not less than 90% as specified in the DEAP manual and the associated Home-heating Appliance Register of Performance (HARP) database maintained by the SEAI (www.seai.ie/harp). Effectively this requires the use of condensing boilers. In a limited number of situations involving replacement of existing boilers, provision of a condensing boiler may not be practicable. Detailed guidance on the assessment of specific situations to identify those where provision of condensing boilers is not practicable is given in “Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L” 2011” (to be published).

For fully pumped hot water-based central heating systems utilising electric heat pumps, the seasonal performance factor should be not less than 3.0 for space heating and 1.5 for domestic hot water generation when calculated in accordance with ecodesign regulation

For fully pumped hot water-based central heating systems utilising gas heat pumps, the

seasonal performance factor should be not less than 1.5 for space heating and 1.0 for domestic hot water generation when calculated in accordance with ecodesign regulation

Replacement electronic storage heaters should have a heat retention not less than 45% measured according to IS EN 60531. They should incorporate a timer and electronic room thermostat to control the heat output that are user adjustable.

2.2.2.2 For fully pumped hot water-based central heating systems utilising a biomass independent boiler, the boiler seasonal efficiency should be not less than 77% as specified in the DEAP manual and the associated Home-heating Appliance Register of Performance (HARP) database maintained by the SEAI (www.seai.ie/harp).

2.2.3 Space heating and hot water supply system controls

2.2.3.1 Space and water heating systems should be effectively controlled so as to ensure the efficient use of energy by limiting the provision of heat energy use to that required to satisfy user requirements, insofar as reasonably practicable. The aim should be to provide the following minimum level of control: -

- automatic control of space heating on the basis of room temperature;
- automatic control of heat input to stored hot water on the basis of stored water temperature;
- separate and independent automatic time control of space heating and hot water;
- shut down of boiler or other heat source when there is no demand for either space or water heating from that source.

The guidance in paragraphs 2.2.3.2 to 2.2.3.5 below is specifically applicable to fully pumped hot water-based central heating

systems.

2.2.3.2 Provision should be made to control heat input on the basis of temperature within the heated space, e.g. by the use of room thermostats, thermostatic radiator valves, or other equivalent form of sensing device. For larger dwellings, independent temperature control should generally be provided for separate zones that normally operate at different temperatures, e.g. living and sleeping zones. Thermostats should be located in a position representative of the temperature in the area being controlled and which is not unduly influenced by draughts, direct sunlight or other factors which would directly affect performance. Depending on the design and layout of the dwelling, control on the basis of a single zone will generally be satisfactory for smaller dwellings. For larger dwellings, e.g. where floor area exceeds 100 m², independent temperature control on the basis of two independent zones will generally be appropriate. In certain cases, additional zone control may be desirable, e.g. zones which experience significant solar or other energy inputs may be controlled separately from zones not experiencing such inputs.

2.2.3.3 Hot water storage vessels should be fitted with thermostatic control that shuts off the supply of heat when the desired storage temperature is reached.

2.2.3.4 Separate and independent time control for space heating and for heating of stored water should be provided. Independent time control of space heating zones may be appropriate where independent temperature control applies.

2.2.3.5 The operation of controls should be such that the boiler is switched off when no heat is required for either space or water heating, i.e. boiler interlock. Systems controlled by thermostatic radiator valves should be fitted with flow control or other equivalent device to ensure boiler switch off.

2.2.4 Insulation of hot water storage vessels, pipes and ducts

2.2.4.1 All hot water storage vessels, pipes

and ducts associated with the provision of heating and hot water in a dwelling should be insulated to prevent heat loss. Hot water pipes and ducts within the normally heated area of the dwelling that contribute to the heat requirement of the dwelling do not require insulation (except those referred to in paragraph 2.2.4.4). Pipes and ducts which are incorporated into wall, floor or roof construction should be insulated.

2.2.4.2 Adequate insulation of hot water storage vessels can be achieved by the use of a storage vessel with factory applied insulation of such characteristics that, when tested on a 120 litre cylinder complying with I.S. 161: 1975 using the method specified in BS 1566, Part 1: 2002, Appendix B, standing heat losses are restricted to 0.8 W/litre. Use of a storage vessel with 50 mm, factory applied coating of PU-foam having zero ozone depletion potential and a minimum density of 30 kg/m³ satisfies this criterion. Alternative insulation measures giving equivalent performance may also be used.

2.2.4.3 Unless the heat loss from a pipe or duct carrying hot water contributes to the useful heat requirement of a room or space, the pipe or duct should be insulated. The following levels of insulation should suffice: -

- (a) pipe or duct insulation meeting the recommendations of BS 5422: 2009 Methods of specifying thermal insulating materials for pipes, ductwork and equipment (in the temperature range - 40°C to + 700°C); or
- (b) insulation with material of such thickness as gives an equivalent reduction in heat loss as that achieved using material having a thermal conductivity at 40°C of 0.035 W/mK and a thickness equal to the outside diameter of the pipe, for pipes up to 40 mm diameter, and a thickness of 40 mm for larger pipes.

2.2.4.4 The hot pipes connected to hot water storage vessels, including the vent pipe and the primary flow and return to the heat exchanger, where fitted, should be insulated

to the standard outlined in paragraph 2.2.4.3 above, for at least one metre from their point of connection.

2.2.4.5 It should be noted that water pipes and storage vessels in unheated areas will generally need to be insulated for the purpose of protection against freezing. Guidance on suitable protection measures is given in Technical Guidance Document G and Report BR 262, Thermal insulation: avoiding risks, published by BRE.

2.3 Major Renovation

2.3.1 Where more than 25% of the surface area of the dwelling envelope undergoes renovation the energy performance of the whole building should be improved to Cost Optimal level in so far as this is technically, functionally and economically feasible.

2.3.2 The cost optimal performance level to be achieved is 125 kWh/m²/yr when calculated in DEAP.

2.3.3 As an alternative to paragraph 2.3.2 Table 6 sets out the improvements normally considered to be cost optimal and will typically be economically feasible when more than 25% of the surface area of a building is being upgraded.

2.3.4 When calculating the proportion of surface area undergoing renovation the area of the whole dwelling external envelope should be taken into account including i.e. external walls, roofs, floors, windows, doors, and roof windows and lights. The surface area of the building thermal envelope means the entire surface area of a building through which it can lose heat to the external environment or the ground, including all heat loss areas of walls, windows, floors and roof". The surface area should be calculated as outlined in section 0.4 using internal dimensions and the guidance in DEAP.

2.3.5 Works to the surface area for which it is technically, functionally and economically feasible to improve the energy performance of the whole building to cost optimal level include the following:

- Cladding the external surface of the wall
- Drylining the internal surface of a wall

2.3.6 Painting, replastering, rendering, re-slating or re-tiling are not considered a major renovation.

Installation of insulation at ceiling level between joists and installation of cavity wall

insulation are not considered a major renovation to the surface area.

2.3.6 Replacement of roofs, floors and windows are normally subject to the requirements of Table 5 for Material Alterations and window and door replacement. It is not considered technically, functionally or economically feasible to bring the whole building to cost optimal level when replacing the surface area of these elements

2.3.7 When undertaking on or in connection with a building that is of architectural or historical interest the aim should be to improve the building as far as is reasonably practical. The work should not prejudice the character of the building or increase the risk of long term deterioration of the building fabric or fittings. Refer to Par 0.5.

2.3.8 Where major renovation upgrades are being carried adequate ventilation should be provided. Refer to Section 10 of SR 54 Code of practice for the energy efficient retrofit of dwellings

Table 6 Cost Optimal Works activated by Major Renovation

Major Renovation > 25% surface area ^{1,2,3}	Works to bring dwelling to cost optimal level
External wall renovation	<ul style="list-style-type: none"> a. Upgrade insulation at ceiling level where U Values are greater than in Table 5, b. Oil or gas boiler replacement & controls upgrade where the oil or gas boiler is more than 15 years old and efficiency less than 86% and c. Replacement of electric storage heating systems where more than 15 years and with with heat retention not less than 45% measured according to IS EN 60531.

¹Where works are planned as a single project.

² Where major renovations to walls, roofs and ground floors constitute essential repairs e.g. repair or renewal of works due to fire, storm or flood damage or as a result of a material defect e.g. reactive pyrite in sub-floor hardcore, it is not considered economically feasible to bring these renovations to a cost optimal level.

³Major Renovation of external wall elements should also meet the requirements of Table 5

Appendix A

APPENDICES

Appendix A

GENERAL

A1.1 General guidance on the calculation of U-values is contained in Report BR 443 “Conventions for the Calculation of U-values” 2006. For building elements and components generally, the method of calculating U-values is specified in I.S. EN ISO 6946: 2007. U-values of components involving heat transfer to the ground, e.g. ground floors with or without floor voids, basement walls, are calculated by the method specified in I.S. EN ISO 13370: 2007. A soil thermal conductivity of 2.0 W/mK should be used, unless otherwise verified. U-values for windows, doors and shutters may be calculated using I.S. EN ISO 10077-1: 2006 or I.S. EN ISO 10077-2: ~~2003~~2012. U Values for curtain walling should be calculated using I.S. EN 12631:2012 Information on U-values and guidance on calculation procedures contained in the ~~2006 7th edition of CIBSE Guide A3~~2015 8th edition of CIBSE Guide Section A3: Thermal Properties of Building Structures are based on these standards and may be used to show compliance with this Part.

A method for assessing U-values of light steel-framed constructions is given in Digest 465 “U-values for light steel construction”, published by BRE. Guidance in relation to the calculation of U-values for various forms of metal clad construction can be found in Technical Paper No. 14 “Guidance for the design of metal roofing and cladding to comply with Approved Document L2: 2001” published by MCRMA, Technical Information Sheet No. 312, “Metal cladding: U-value calculation assessing thermal performance of built-up metal roof and wall cladding systems using rail and bracket spacers” published by SCI and IP 10/02 “Metal cladding: assessing thermal performance of built-up systems which use ‘Z’ spacers” published by BRE.

Software packages to perform U-value calculations in accordance with the standards above are readily available.

A1.2 U-values derived by calculation should be rounded to two significant figures and

relevant information on input data should be provided. When calculating U-values the effects of timber joists, structural and other framing, mortar bedding, window frames and other small areas where thermal bridging occurs must be taken into account. Similarly, account must be taken of the effect of small areas where the insulation level is reduced significantly relative to the general level for the component or structure element under consideration. Thermal bridging may be disregarded, however, where the general thermal resistance does not exceed that in the bridged area by more than 0.1 m²K/W. For example, normal mortar joints need not be taken into account in calculations for brickwork or concrete blockwork where the density of the brick or block material is in excess of 1500 kg/m³. A ventilation opening in a wall or roof (other than a window, rooflight or door opening), may be considered as having the same U-value as the element in which it occurs.

A1.3 Examples of the application of the calculation method specified in I.S. EN 6946: 2007 are given below. An example of the calculation of ground floor U-values using I.S. EN ISO 13370: 2007 is also given.

A1.4 Thermal conductivities of common building materials are given in Table A1. For the most part, these are taken from I.S. EN ISO 10456: 2007 or CIBSE Guide A3. Values for common insulation materials are also available in these documents. See paragraph 0.3.3 regarding application of these Tables.

SIMPLE STRUCTURE WITHOUT THERMAL BRIDGING

A2.1 To calculate the U-value of a building element (wall or roof) using I.S. EN ISO 6946: 2007, the thermal resistance of each component is calculated, and these thermal resistances, together with surface resistances as appropriate, are then combined to yield the total thermal resistance and U-value. The result is corrected to account for mechanical fixings (e.g. wall ties) or air gaps if required. For an element consisting of homogenous

Appendix A

layers with no thermal bridging, the total resistance is simply the sum of individual thermal resistances and surface resistances.

Table A1 Thermal conductivity of some common building materials

Material	Density (kg/m ³)	Thermal Conductivity (W/mK)
General Building Materials		
Clay brickwork (outer leaf)	1,700	0.77
Clay brickwork (inner leaf)	1,700	0.56
Concrete block (heavyweight)	2,000	1.33
Concrete block (medium weight)	1,400	0.57
Concrete block (autoclaved aerated)	700	0.20
Concrete block (autoclaved aerated)	500	0.15
Concrete block (hollow)	1800	0.835
Cast concrete, high density	2,400	2.00
Cast concrete, medium density	1,800	1.15
Aerated concrete slab	500	0.16
Concrete screed	1,200	0.41
Reinforced concrete (1% steel)	2,300	2.30
Reinforced concrete (2% steel)	2,400	2.50
Wall ties, stainless steel	7,900	17.00
Wall ties, galvanised steel	7,800	50.00
Mortar (protected)	1,750	0.88
Mortar (exposed)	1,750	0.94
External rendering (cement sand)	1,800	1.00
Plaster (gypsum lightweight)	600	0.18
Plaster (gypsum)	1,200	0.43
Plasterboard	900	0.25
Natural slate	2,500	2.20
Concrete tiles	2,100	1.50
Clay tiles	2,000	1.00
Fibre cement slates	1,800	0.45
Ceramic/Porcelain tiles	2,300	1.30
Plastic tiles	1,000	0.20
Asphalt	2,100	0.70
Felt bitumen layers	1,100	0.23
Timber, softwood	500	0.13
Timber, hardwood	700	0.18
Wood wool slab	500	0.10
Wood-based panels (plywood, chipboard, etc.)	500	0.13
<i>Note:</i> <i>The values in this table are indicative only. Certified values, should be used in preference, if available.</i>		


I.S. EN 6946: 2007 provides for corrections to the calculated U-value. In the case of Example A1 (see Diagram A1), corrections for air gaps in the insulated layer and for mechanical fasteners may apply. However, if the total correction is less than 3% of the calculated value, the correction may be ignored.

In this case no correction for air gaps applies as it is assumed that the insulation boards meet the dimensional standards set out in I.S. EN ISO 6946: 2007 and that they are installed without gaps greater than 5 mm.

The construction involves the use of wall ties that penetrate fully through the insulation layer.

Example A1: Masonry cavity wall

Diagram A1 Masonry cavity wall
(Par. A2.1)

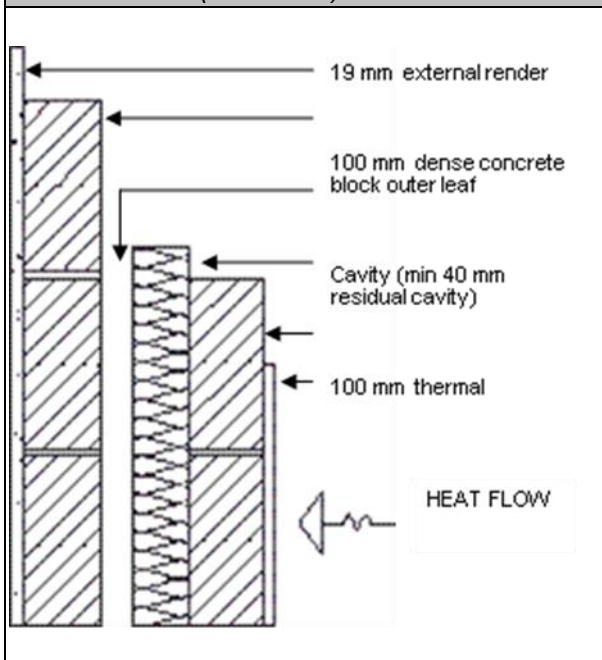

Layer/ Surface	Thickness (m)	Conductivity (w/mK)	Resistance (m ² K/W)
External surface	-	-	0.040
External render	0.019	1.00	0.019
Concrete block	0.100	1.33	0.075
Air cavity	-	-	0.180
Insulation	0.100	0.023	4.348
Concrete block	0.100	1.33	0.075
Plaster (lightweight)	0.013	0.18	0.072
Internal surface	-	-	0.130
Total Resistance	-	-	4.939
U-value of construction = 1 / 4.939 = 0.20 W/m ² K			

A potential correction factor applies which, assuming the use of 4 mm diameter stainless steel ties at 5 ties per m², is calculated as 0.006 W/m²K. This is equal to 3% of the calculated U-value and the corrected U-value for this structure would be 0.21. It should be noted that, if galvanised steel wall ties were used, a correction of 0.02 W/m²K would apply, and the corrected U-value for this construction would be 0.22 W/m²K.


STRUCTURE WITH BRIDGED LAYER(S)

A2.2 For an element in which one or more layers are thermally bridged, the total thermal resistance is calculated in three steps as follows: -

- The upper thermal resistance is based on the assumption that heat flows through the component in straight lines perpendicular to the element's surfaces. To calculate it, all possible heat flow paths are identified, for each path the resistance of all layers are combined in series to give the total resistance for the path, and the resistances of all paths are then combined in parallel to give the upper resistance of the element.
- The lower thermal resistance is based on the assumption that all planes parallel to the surfaces of the component are isothermal surfaces. To calculate it, the resistances of all components of each thermally bridged layer are combined in parallel to give the effective resistance for the layer, and the resistances of all layers are then combined in series to give the lower resistance of the element.
- The total thermal resistance is the mean of the upper and lower resistances.

The percentage of timber bridging the insulation layer as a repeating thermal bridge can be calculated when the size and frequency of the timber members is known. Alternatively, the figures given in Table A2 can be used.

Example A2: Timber-frame wall (with one insulating layer bridged)

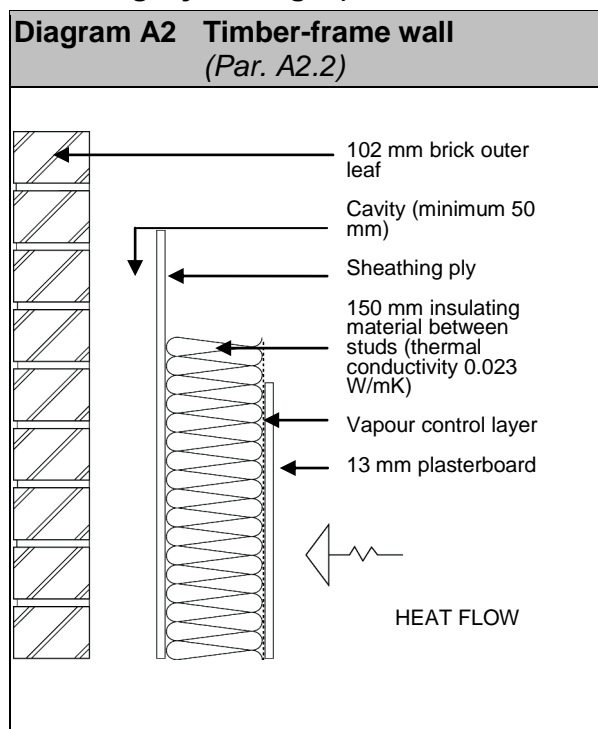

The thermal resistance of each component is calculated (or, in the case of surface resistances, entered) as follows: -

Layer/ Surface	Thickness (m)	Conductivity (W/mK)	Resistance (m ² K/W)
External surface	-	-	0.040
Brick outer leaf	0.102	0.77	0.132
Air cavity	-	-	0.180
Sheathing ply	0.012	0.13	0.092
Polyisocyanurate (PIR)	0.150	0.023	6.522
Timber studs	0.150	0.12	1.25
Plasterboard	0.013	0.25	0.052
Internal surface	-	-	0.130

Table A2 Timber fractions for bridged layers				
Layer	Timber frame walls	Ceiling flat/sloped		Suspended timber floor
		Drylined	battened wall	
% Fraction	15	9	8	12

Upper resistance

Assuming that heat flows in straight lines perpendicular to the wall surfaces, there are

two heat flow paths - through the insulation and through the studs. The resistance of each of these paths is calculated as follows: -

Resistance through section containing insulation [m²K/W]: -

External surface resistance	0.040
Brick outer leaf	0.132
Air cavity	0.180
Sheathing ply	0.092
Polyisocyanurate (PIR)	6.522
Plasterboard	0.052
Internal surface resistance	0.130

Total 7.148

Resistance through section containing timber stud [m²K/W]: -

External surface resistance	0.040
Brick outer leaf	0.132
Air cavity	0.180
Sheathing ply	0.092
Timber studs	1.250
Plasterboard	0.052
Internal surface resistance	0.130

Total 1.876

The upper thermal resistance R_u is obtained from: -

$$R_u = 1 / (F_1 / R_1 + F_2 / R_2)$$

where F_1 and F_2 are the fractional areas of heat flow paths 1 and 2, and R_1 and R_2 are the resistances of these paths.

$$\text{Upper resistance } R_u = 1 / (0.85 / 7.148 + 0.15 / 1.876) = 5.028 \text{ m}^2\text{K/W}$$

Lower resistance

Assuming an isothermal plane on each face of the layer of insulation which is bridged by timber studs, the thermal resistance of this bridged layer, R_b , is calculated from: -

$$R_b = 1 / (F_{ins} / R_{ins} + F_t / R_t)$$

where F_{ins} and F_t are the fractional areas of

insulation and timber, and R_{ins} and R_t are their resistances.

$$R_b = 1 / (0.85 / 6.522 + 0.15 / 1.25) = 3.995 \text{ m}^2\text{K/W}$$

The resistances of all layers are then combined in series to give the lower resistance [$\text{m}^2\text{K/W}$]: -

External surface resistance	0.040
Brick outer leaf	0.132
Air cavity	0.180
Sheathing Ply	0.092
Bridged insulation layer	3.995
Plasterboard	0.052
Internal surface resistance	0.130

Lower resistance (R_L) **4.621**

Total resistance

The total resistance R_t is given by: -

$$R_t = (R_u + R_L) / 2 = (5.028 + 4.621) / 2 = 4.8245 \text{ m}^2\text{K/W}$$

The U-value is the reciprocal of the total resistance: -


$$U\text{-value} = 1 / 4.8245 = 0.21 \text{ W/m}^2\text{K (to 2 decimal places)}.$$

There is a potential correction for air gaps in the insulation layer. In this case no correction for air gaps applies as it is assumed that the insulation boards are factory fitted and meet the dimensional standards set out in I.S. EN ISO 6946: 2007 and that they are installed without gaps greater than 5 mm.

Example A3: Domestic pitched roof with insulation at ceiling level (between and over joists)

A pitched roof has 100 mm of mineral wool tightly fitted between 44 mm by 100 mm timber joists spaced 600 mm apart (centres to centres) and 150 mm of mineral wool over the joists. The roof is slated or tiled with sarking felt under the slates or tiles. The ceiling consists of 13 mm of plasterboard.

The fractional area of timber at ceiling level is taken as 9%.

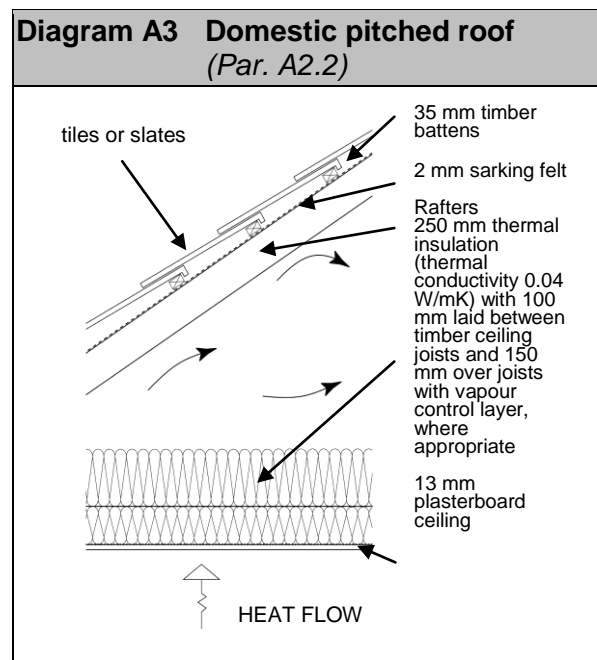

Layer/ Surface	Thickness (m)	Conductivity (W/mK)	Resistance ($\text{m}^2\text{K/W}$)
External surface	-	-	0.040
Roof space (including sloping construction and roof cavity)	-	-	0.200
Mineral wool (continuous layer)	0.150	0.04	3.750
Mineral wool (between joists)	0.100	0.04	2.500
Timber joists	0.100	0.13	0.769
Plasterboard	0.013	0.25	0.052
Internal surface	-	-	0.100

Upper resistance (R_u)

Resistance through section containing both layers of insulation [$\text{m}^2\text{K/W}$]: -

External surface resistance	0.040
Resistance of roof space	0.200
Resistance of mineral wool over joists	3.750
Resistance of mineral wool between joists	2.500
Resistance of plasterboard	0.052

Inside surface resistance	0.100
Total	6.642
Resistance through section containing timber joists: -	
External surface resistance	0.040
Resistance of roof space	0.200
Resistance of mineral wool over joists	3.750
Resistance of timber joists	0.769
Resistance of plasterboard	0.052
Inside surface resistance	0.100

Total **4.911**

The upper thermal resistance [R_u] is obtained from: -

$$R_u = 1 / (F_1 / R_1 + F_2 / R_2)$$

where F_1 and F_2 are the fractional areas of heat flow paths 1 and 2, and R_1 and R_2 are the resistances of these paths.

$$\text{Upper resistance } R_u = 1 / (0.91 / 6.642 + 0.09 / 4.911) = 6.438 \text{ m}^2\text{K/W}$$

Lower resistance (R_L)

Assuming an isothermal plane on each face of the layer of insulation which is bridged by timber studs, the thermal resistance of this bridged layer, R_b , is calculated from: -

$$R_b = 1 / (F_{ins} / R_{ins} + F_t / R_t)$$

where F_{ins} and F_t are the fractional areas of insulation and timber, and R_{ins} and R_t are their resistances.

$$R_b = 1 / (0.91 / 2.500 + 0.09 / 0.769) = 2.079 \text{ m}^2\text{K/W}$$

The resistances of all layers are then combined in series to give the lower resistance [$\text{m}^2\text{K/W}$]: -

External surface resistance	0.040
Resistance of roof space	0.200
Resistance of mineral wool over joists	3.750
Resistance of bridged layer	2.079
Resistance of plasterboard	0.052

Inside surface resistance	0.100
---------------------------	-------

Lower resistance (R_L) **6.221**

Total resistance

The total resistance R_t is given by: -

$$R_t = (R_u + R_L) / 2 = (6.438 + 6.221) / 2 = 6.329 \text{ m}^2\text{K/W}$$

The U-value is the reciprocal of the total resistance: -

$$U\text{-value} = 1 / 6.329 = 0.16 \text{ W/m}^2\text{K (to 2 decimal places).}$$

I.S. EN ISO 6946: 2007 does not specify any potential correction for this construction.


GROUND FLOORS AND BASEMENTS

A3.1 The U-value of an uninsulated ground floor depends on a number of factors including floor shape and area and the nature of the soil beneath the floor. I.S. EN ISO 13370: 2007 deals with the calculation of U-values of ground floors. Methods are specified for floors directly on the ground and for floors with vented and unvented sub-floor spaces. I.S. EN ISO 13370: 2007 also covers heat loss from basement floors and walls.

A3.2 In the case of semi-detached or terraced premises, blocks of flats and similar buildings, the floor dimensions can be taken as either those of the individual premises or those of the whole building. Unheated spaces outside the insulated fabric, such as attached porches or garages, should be excluded when deriving floor dimensions but the length of the floor perimeter between the heated building and the unheated space should be included when determining the length of exposed perimeter. Where such ancillary areas have the potential to become part of the habitable area of the dwelling, floors should be insulated to the same level as the dwelling floors unless it is envisaged that a new insulated floor will be provided when converted.

Example A4: Slab-on-ground floor – full floor insulation

The slab-on-ground floor consists of a 150 mm dense concrete ground floor slab on 100 mm insulation. The insulation has a thermal conductivity of 0.031 W/mK. The floor dimensions are 8750 mm by 7250 mm with three sides exposed. One 8750 mm side abuts the floor of an adjoining semi-detached house.

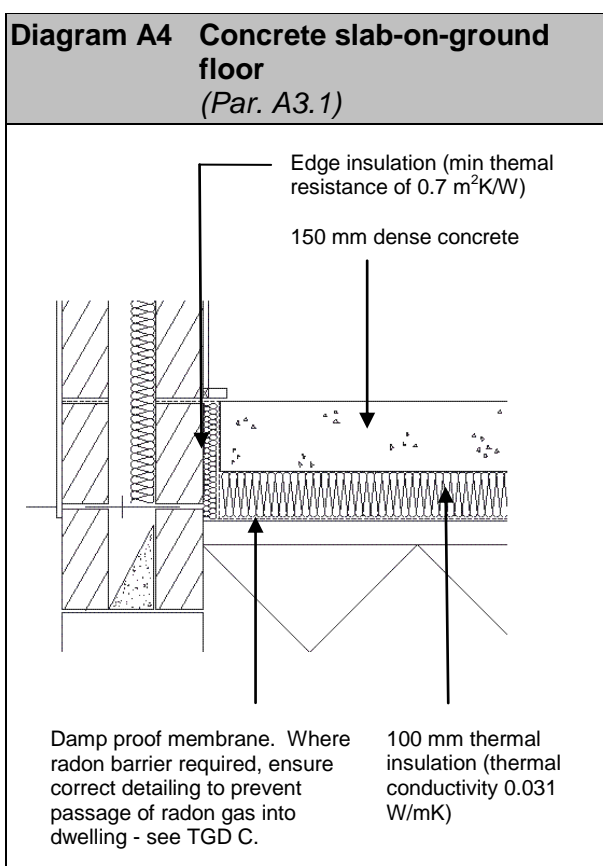

In accordance with I.S. EN ISO 13370: 2007, the following expression gives the U-value for well-insulated floors: -

$$U = \lambda / (0.457B' + d_t), \text{ where}$$

$$\lambda = \text{thermal conductivity of unfrozen ground (W/mK)}$$

$$B' = 2A/P \text{ (m)}$$

$$d_t = w + \lambda(R_{si} + R_f + R_{se}) \text{ (m)}$$

$$A = \text{floor area (m}^2\text{)}$$

P = heat loss perimeter (m)

w = wall thickness (m)

R_{si} , R_f and R_{se} are internal surface resistance, floor construction (including insulation) resistance and external surface resistance respectively. Standard values of R_{si} and R_{se} for floors are given as 0.17 m²K/W and 0.04 m²K/W respectively. The standard also states that the thermal resistance of dense concrete slabs and thin floor coverings may be ignored in the calculation and that the thermal conductivity of the ground should be taken as 2.0 W/mK unless otherwise known or specified.

Ignoring the thermal resistance of the dense concrete slab, the thermal resistance of the floor construction (R_f) is equal to the thermal resistance of the insulation alone, i.e. $0.1 / 0.031$ or 3.226 m²K/W. Taking the wall thickness as 350 mm, this gives: -

$$d_t = 0.35 + 2.0(0.17 + 3.226 + 0.04) = 7.222 \text{ m}$$

$$\text{Also } B' = 2(8.75 \times 7.25) / (8.75 + 7.25 + 7.25) = 5.457 \text{ m}$$

$$\text{Therefore } U = 2.0 / ((0.457 \times 5.457) + 7.222) = 0.21 \text{ W/m}^2\text{K}$$

The edge insulation to the slab is provided to prevent thermal bridging at the edge of the slab. I.S. EN ISO 13370: 2007 does not consider this edge insulation as contributing to the overall floor insulation and thus reducing the floor U-value. However, edge insulation, which extends below the external ground level, is considered to contribute to a reduction in floor U-value and a method of taking this into account is included in the standard. Foundation walls of insulating lightweight concrete may be taken as edge insulation for this purpose.

ELEMENTS ADJACENT TO UNHEATED SPACES

A4.1 As indicated in paragraph 0.3.5, the procedure for the calculation of U-values of elements adjacent to unheated spaces (previously referred to as semi-exposed elements) is given in I.S. EN ISO 6946: 2007 and I.S. EN ISO 13789: 2007.

The following formulae may be used to derive elemental U-values (taking the unheated space into account) for typical housing situations irrespective of the precise dimensions of the unheated space.

$$U_o = 1 / (1/U - R_u) \text{ or } U = 1 / (1/U_o + R_u)$$

Where: U – U-value of element adjacent to unheated space ($\text{W/m}^2\text{K}$), taking the effect of the unheated space into account.

U_o – U-value of the element between heated and unheated spaces ($\text{W/m}^2\text{K}$) calculated as if there was no unheated space adjacent to the element.

R_u – effective thermal resistance of unheated space inclusive of all external elements ($\text{m}^2\text{K/W}$).





This procedure can be used when the precise details on the structure providing an unheated space are not available, or not crucial.

R_u for typical unheated structures (including garages, access corridors to flats and unheated conservatories) are given in Tables A3, A4 and A5.

Table A5 applies only where a conservatory-style sunroom is not treated as an integral part of the dwelling, i.e. is treated as an extension.

In the case of room-in-roof construction, the U-value of the walls of the room-in-roof construction and of the ceiling of the room below the space adjacent to these walls can be calculated using this procedure. See Diagram A5

Table A3 Typical resistance (R_u) for unheated space**(a) Integral and adjacent single garages or other similar unheated space**

Garage or other similar unheated space		Element between garage and dwelling	R_u	
			Outside ¹	Inside ²
Single fully integral		Side wall, end wall and floor	0.33	0.68
Single fully integral		One wall and floor	0.25	0.54
Single, partially integral displaced forward		Side wall, end wall and floor	0.26	0.56
Single, adjacent		One wall	0.09	

Notes:

The table gives R_u for single garages; use $(0.5 \times R_u)$ for double garages when extra garage is not fully integral, and $(0.85 \times R_u)$ for fully integral double garages. Single garage means a garage for one car; double garage means a garage for two cars.

1. Walls separating garage from dwelling are external walls.

2. Insulated envelope of dwelling goes round outside of garage.

Table A4 Typical resistance (R_u) for unheated space
(b) Unheated stairwells and access corridors in flats

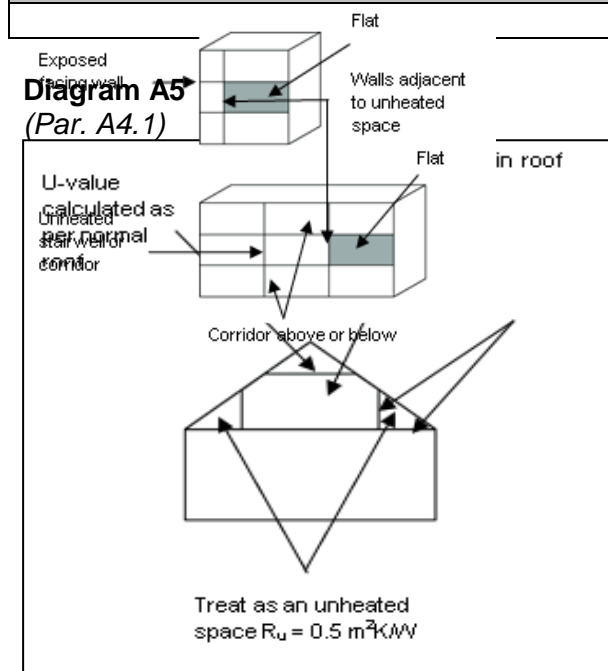


Table A4 Typical resistance (R_u) for unheated space		
(b) Unheated stairwells and access corridors in flats		
Unheated space		R_u
Stairwells:		
	Facing wall exposed	0.82
	Facing wall not exposed	0.90
Access corridors:		
	Facing wall exposed, corridor above or below	0.31
	Facing wall exposed, corridor above and below	0.28
	Facing wall not exposed, corridor above or below	0.43
	Facing wall not exposed, corridor above and below	0.40

Table A5 Typical resistance (R_u) for unheated space	
(c) Conservatory-type sunroom	
Number of walls between dwelling and conservatory/sunroom	R_u
One	0.06
Two (conservatory in angle of dwelling)	0.14
Three (conservatory in recess)	0.25

Alternatively R_u can be calculated using the following formula as detailed in BRE 443. To more accurately the resistance through the fabric and unheated space eg. In apartment walls facing unheated corridors

$$R_u = \frac{A_i}{\sum (A_e \times U_e) + 0.33nV}$$

A_i ; A_e =respective areas of internal and external elements (m^2), excluding any ground floor

U_e = U-values of external elements ($\text{W}/\text{m}^2\text{K}$)

V =volume of unheated space (m^3)

n =air change rate of unheated space (ach)

Typical air change rates for unheated spaces (from BRE 443)

Air tightness type	n (air changes per hour)
No doors or windows, all joints between components well-sealed, no ventilation openings provided	0.1
All joints between components well-sealed, no ventilation openings provided	0.5
All joints well-sealed, small openings provided for ventilation	1.0
Not airtight due to some localised open joints or permanent ventilation openings	3.0
Not airtight due to numerous open joints, or large or numerous permanent ventilation openings	10.0

Appendix B

Fabric insulation:

Additional guidance for common constructions

GENERAL

B.1 This Appendix provides some basic guidance in relation to typical roof, wall and floor constructions. Guidance is not exhaustive and designers and contractors should also have regard to other sources of relevant guidance, e.g. “BR 262: 2001 Thermal Insulation; avoiding risks”, relevant standards and good building practice.

In particular, diagrams in this Appendix are intended to be illustrative of the construction to which they refer. They do not purport to provide detailed guidance on the avoidance of thermal bridging. See sections 1.3.3, 2.1.3 and Limiting Thermal Bridging and Air Infiltration - Acceptable Construction Details (ACDs) for guidance on reasonable provision in this regard.

B.2 For many typical roof, wall and floor constructions, the thickness of insulation required to achieve a particular U-value can vary depending on the thermal performance of the insulation material. Higher performing insulating materials, i.e. those with lower thermal conductivities, can achieve any given U-value with a lower thickness of insulating material.

B.3 Condensation in buildings occurs whenever warm moist air meets surfaces that are at or below the dew point of that air. There are two main types, surface condensation and interstitial condensation.

Surface condensation occurs on the surface of walls, windows, ceilings and floors and may result in mould and mildew.

Interstitial condensation occurs within the construction of the building and can damage structural materials or make insulating materials less effective.

Full checks should be performed on the likelihood of surface and interstitial condensation of a construction detail in accordance with I.S. EN ISO 13788:2012. This standard contains recommended procedures for the assessment of the risk of:

- surface condensation and mould growth;
- interstitial condensation.

The guidance in BRE document BR 497 Conventions for calculating linear thermal transmittance and temperature factors (2nd Edition) may be used to perform the checks in IS EN ISO 13788:2012.

I.S. EN 15026 can also be used to assess the risk of surface condensation and mould growth. The transient models covered in this standard take account of heat and moisture storage, latent heat effects, and liquid and convective transport under realistic boundary and initial conditions.

B.4 A vapour control layer (VCL) substantially reduces the water vapour transfer through any building component in which it is incorporated by limiting both vapour diffusion and air movement. The measures required to achieve a functional VCL must be carefully considered at the design stage.

A VCL should extend over the whole of the element into which it is incorporated and must be integrated with and sealed to adjoining elements, such as masonry, upstands and glazing systems and to any VCL in those elements. VCLs may be formed with a membrane within the structure or with a lining board with an integral membrane. A VCL should be of appropriate vapour resistance and should be situated on the warm side of the insulation.

The performance of a VCL depends upon the vapour resistance of the material selected, the practicability of the design and the standard of workmanship involved in its installation. The integrity of the VCL should be ensured by effective sealing of all service penetrations, e.g. electrical wiring. Methods of avoiding such penetrations should be considered in the design stage.

Side and end joints in a flexible sheet VCL should be kept to a minimum. Joints should be made over a solid backing member or substrate, lapped not less than 50 mm and sealed with an appropriate sealant. Similarly,


tears and splits should be repaired using the same material, jointed as above. If polyethylene sheeting is used, it should be protected from heat and sunlight to reduce the risk of degradation occurring. Where a VCL is incorporated in a rigid board, joints between adjacent boards should be sealed to avoid mass transfer of water vapour due to air leakage. These seals should be designed to accommodate thermal or other movement which may occur during the design life of the building.

A VCL can also act as an air leakage barrier, which by reducing air movement has the added benefit of reducing the heat lost by convection.

B.5 ROOF CONSTRUCTIONS

B.5.1 Construction R1: Tiled or slated pitched roof, ventilated roof space, insulation at ceiling level

B.5.1.1R1(a) Insulation between and over joists

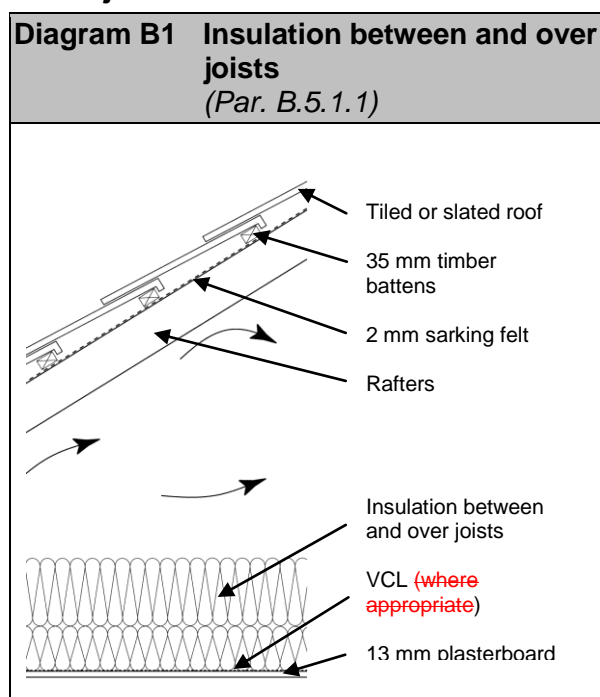

Installation guidelines and precautions

Care is required in design and construction, particularly in regard to the following: -

Provision of adequate roofspace ventilation

Adequate ventilation is particularly important to ensure the prevention of excessive condensation in cold attic areas. See relevant guidance in Technical Guidance Document F.

Minimising transfer of water vapour from occupied dwelling area to cold attic space

In addition to ensuring adequate ventilation, measures should be taken to limit transfer of water vapour to the cold attic. Care should be taken to seal around all penetrations of pipes, ducts, wiring, etc. through the ceiling, including provision of an effective seal to the attic access hatch. Use of a VCL at ceiling level, on the warm side of the insulation, will assist in limiting vapour transfer and should therefore be used, but cannot be relied on as an alternative to ventilation. Where the roof pitch is less than 15°, or where the shape of the roof is such that there is difficulty in ensuring adequate ventilation, e.g. room-in-the-roof construction, the VCL is essential.

Minimising the extent of cold bridging

Particular areas of potential cold bridging include junctions with external walls at eaves and gables, and junctions with solid party walls. Gaps in the insulation should be avoided and the insulation should fit tightly against joists, noggings, bracing etc. Insulation joints should be closely butted and joints in upper and lower layers of insulation should be staggered (see Acceptable Construction Details, details G01 - G04).

Protecting water tanks and pipework against the risk of freezing

All pipework on the cold side of the insulation should be adequately insulated. Where the cold water cistern is located in the attic, as is normally the case, the top and sides of the cistern should be insulated. The area underneath the cistern should be left uninsulated and continuity of tank and ceiling insulation should be ensured, e.g. by overlapping the tank and ceiling insulation. Provision should be made to ensure ventilation of the tank. Where raised tanks are used, (to aid head pressure), the ceiling

should be insulated normally and the tank insulated separately.

Ensuring that there is no danger from overheating of electric cables or fittings


Cables should be installed above the insulation. Cables which pass through or are enclosed in insulation should be adequately rated to ensure that they do not overheat. Recessed fittings and transformers should have adequate ventilation or other means to prevent overheating.

Providing for access to tanks, services and fittings in the roofspace

Because the depth of insulation will obscure the location of ceiling joists, provision should be made for access from the access hatch to the cold water tank and to other fittings to which access for occasional maintenance and servicing may be required. This can be done by provision of walkways without compressing the installed insulation or by the use of high density insulation under the walkway or by installing composite attic boards.

B.5.1.2R1(b) Insulation between and below joists

Insulation is laid in one layer between the joists, protruding above them where its depth is greater, and leaving air gaps above the joists. A composite board of plasterboard with insulation backing is used for the ceiling.

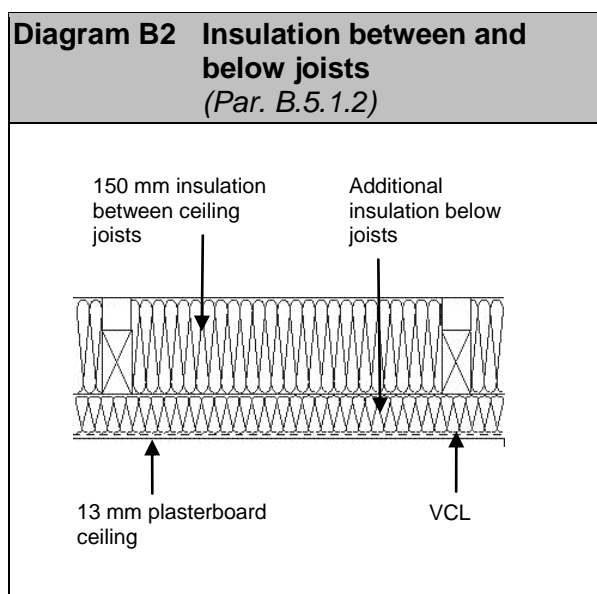


Installation guidelines and precautions

Similar guidelines and precautions apply as for R1(a) above. Where the thermal conductivity of insulation between and below the joists is different, the material on the warm side (i.e. below the joists) should have a vapour resistance no lower than that on the cold side (i.e. between the joists). It is preferable if the insulation on the cold side is more permeable than that on the warm side (e.g. mineral wool outside with expanded polystyrene inside).

B.5.2 Construction R2: Tiled or slated pitched roof, occupied or unventilated roof space, insulation on roof slope

B.5.2.1R2(a) Insulation between and below rafters, 50 mm ventilated cavity between insulation and sarking felt breathable membrane

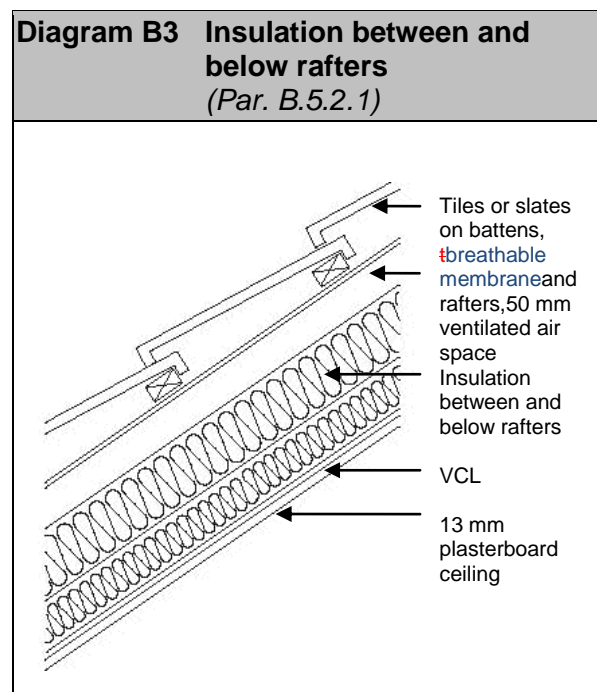

Installation guidelines and precautions

The insulation is installed in two layers, one between the rafters (and battens) and the second below and across them. To limit water vapour transfer and minimise condensation risks, a VCL is required on the

warm side of the insulation. No material of high vapour resistance, e.g. facing layer attached to insulation to facilitate fixing, should be included within the overall thickness of insulation. Care must be taken to prevent roof timbers and access problems interfering with the continuity of insulation and VCL.

Provision should be made for ventilation top and bottom of the 50 mm ventilation gap on the cold side of the insulation.


An alternative construction using a breathable membrane may be used. In this case the membrane should be certified in accordance with Part D of the Building Regulations and installed in accordance with the guidance on the certificate.

Care should be taken to avoid thermal bridging at roof/wall junctions at eaves, gable walls and party walls (see Acceptable Construction Details, details 1.13 and 1.16).

Where the thermal conductivity of insulation between and below the rafters is different, the material on the warm side (i.e. below the rafters) should have a vapour resistance no lower than that on the cold side (i.e. between the rafters). It is preferable if the insulation on the cold side is more permeable than that on the warm side (e.g. mineral wool outside with expanded polystyrene inside).

B.5.2.2R2(b):Insulation above and between rafters, slate or tile underlay of breather membrane type

Diagram B4 Insulation above and between rafters
(Par. B.5.2.2)

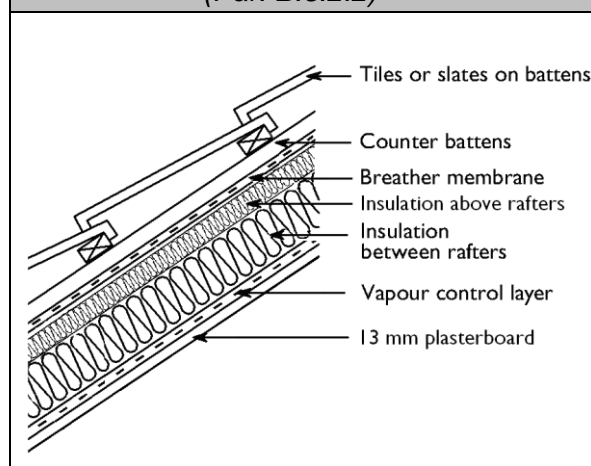

Installation guidelines and precautions

The effective performance of this system is critically dependent on the prevention of air and water vapour movement between the warm and cold sides of the insulation. Only systems which are certified or shown by test and calculation as appropriate for this function, (see Technical Guidance Document D, paragraphs 1.1 (a) and (b)) should be used. The precise details of construction are dependent on the insulation and roof underlay materials to be used. Installation should be carried out precisely in accordance with the procedures described in the relevant certificate.


In general, the insulation material must be of low vapour permeability, there should be a tight fit between adjacent insulation boards, and between insulation boards and rafters. All gaps in the insulation (e.g. at eaves, ridge, gable ends, around rooflights and chimneys, etc.) should be sealed with flexible sealant or expanding foam.

Care should be taken to avoid thermal bridging at roof/wall junctions at eaves, gable

walls and party walls (see Acceptable Construction Details, details 1.14 and 1.18).

B.5.3 Construction R3: Flat roof, timber joists, insulation below deck (Cold Deck)

B.5.3 R3: Insulation between and below joists, 50 mm air gap between insulation and roof decking

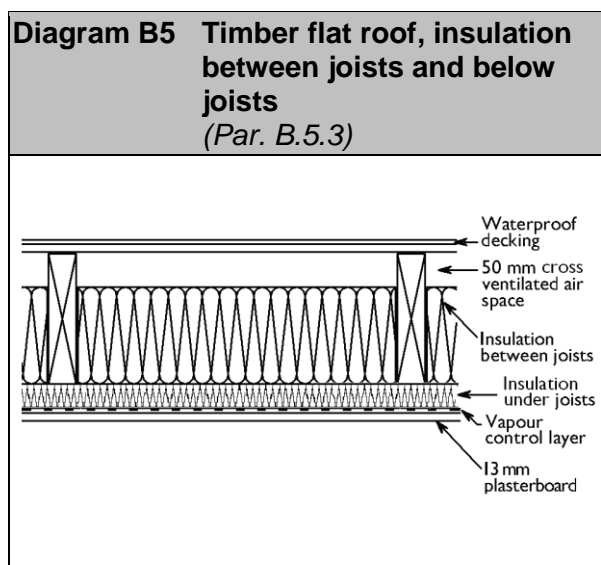

Installation guidelines and precautions


The insulation is installed in two layers, one between the joists, and the second below the joists. A ventilated air space as specified in Technical Guidance Document F should be provided above the insulation. Cross ventilation should be provided to each and every void. When installing the insulation, care is needed to ensure that it does not block the ventilation flow paths. The roof insulation should connect with the wall insulation so as to avoid a cold bridge at this point.

The lower layer may be in the form of composite boards of plasterboard backed with insulation, with integral vapour barrier, fixed to the joists. The edges of boards should be sealed with vapour-resistant tape. Where the thermal conductivity of insulation between and below the joists is different, the material on the warm side (i.e. below the

joists) should have a vapour resistance no lower than that on the cold side (i.e. between the joists). It is preferable if the insulation on the cold side is more permeable than that on the warm side (e.g. mineral wool outside with expanded polystyrene inside).

B.5.4 Construction R4: Sandwich warm deck flat roof

The insulation is installed above the roof deck but below the weatherproof membrane. The structural deck may be of timber, concrete or metal.

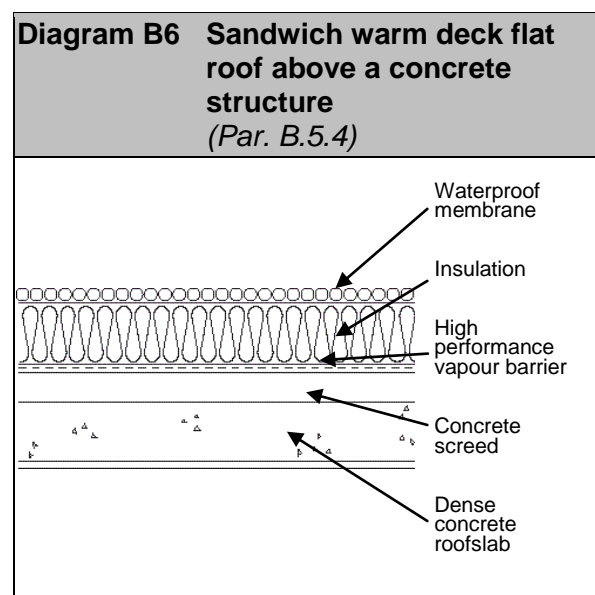


Installation guidelines and precautions

The insulation boards are laid over and normally fully bonded to a high performance vapour barrier complying with I.S. EN 13707: 2004 2013 which is bonded to the roof deck. The insulation is overlaid with a waterproof membrane, which may consist of a single layer membrane, a fully-bonded built-up bitumen roofing system, or mastic asphalt on an isolating layer. At the perimeter, the vapour barrier is turned up and back over the insulation and bonded to it and the weatherproof membrane. Extreme care is required to ensure that moisture can not penetrate the vapour barrier. The insulation should not be allowed to get wet during installation. There should be no insulation below the deck nor should this area be

ventilated as this could give rise to a risk of condensation on the underside of the vapour barrier. Thermal bridging at roof/wall junctions should be avoided (see Acceptable Construction Details, details 1.19 and 1.20).

B.5.5 Construction R5: Inverted warm deck flat roof: insulation to falls above both roof deck and weatherproof membrane

Insulation materials should have low water absorption, be frost resistant and should maintain performance in damp conditions over the long term. To balance loss of performance due to the damp conditions and the intermittent cooling effect of water passing through and draining off from the warm side of the insulation, the insulation thickness calculated as necessary for dry conditions should be increased by 20%. Alternatively the extra heat loss can be calculated in accordance with Section D4 of Appendix D in I.S. EN ISO 6946.

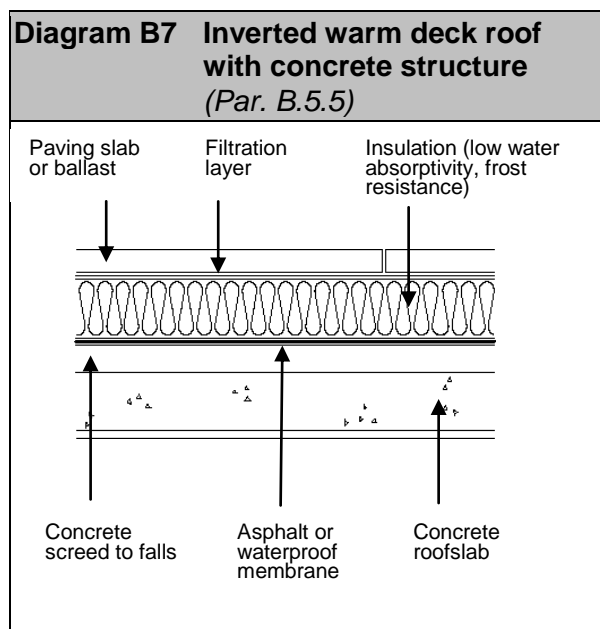

Installation guidelines and precautions

The insulation is laid on the waterproof membrane. A filtration layer is used to keep out grit, which could eventually damage the weatherproof membrane. The insulation must be restrained to prevent wind uplift and protected against ultraviolet degradation.

This is usually achieved by use of gravel ballast, paving stones or equivalent restraint and protection. The insulation should have sufficient compressive strength to withstand the weight of the ballast and any other loads.

Rainwater will penetrate the insulation as far as the waterproof membrane. Drainage should be provided to remove this rainwater both at the upper surface and at the membrane level where practicable. To minimise the effect of rain on performance, insulation boards should be tightly jointed (rebated or tongued-and-grooved edges are preferred), and trimmed to give a close fit around upstands and service penetrations.

To avoid condensation problems, the thermal resistance of the construction between the weatherproof membrane and the heated space should be at least $0.15 \text{ m}^2\text{K/W}$. However, this thermal resistance should not exceed 25% of the thermal resistance of the whole construction.


Thermal bridging at roof/wall junctions should be avoided.

B.6 WALL CONSTRUCTIONS

B.6.1 W1: Cavity walls, insulation in cavity, cavity retained (partial fill)

B.6.1.1W1(a): Brick or rendered dense concrete block external leaf, partial fill insulation, dense concrete block inner leaf, plaster or plasterboard internal finish.

It should be noted that the details refer to cavity walls with a maximum overall cavity width of 150 mm which is the greatest cavity width for which details of construction are given in I.S. EN 1996. Eurocode 6; Design of Masonry Structures and associated national annexes. Where it is proposed to use wider cavity widths, full structural design will be necessary.

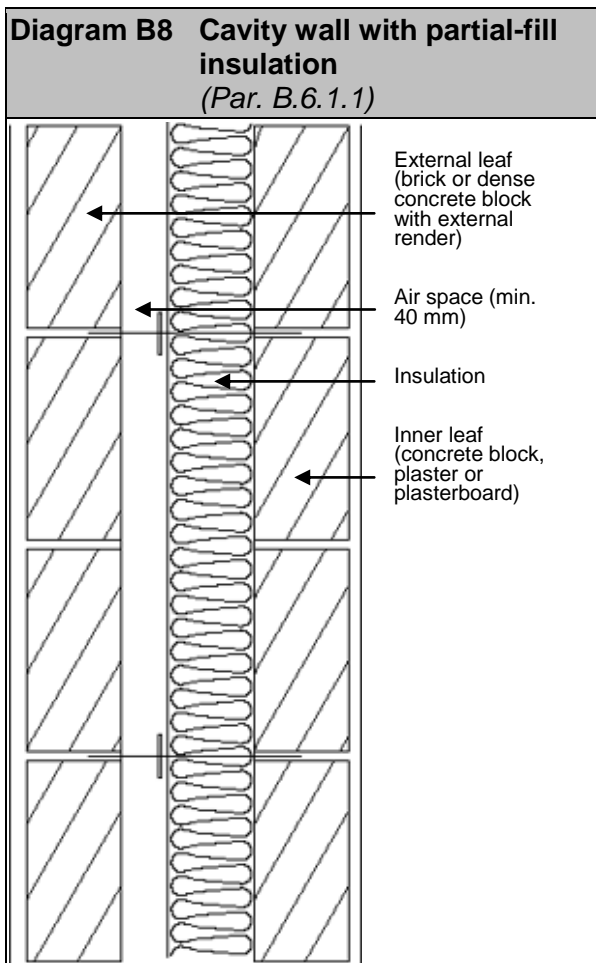

The insulation thickness required to achieve a given U-value may be reduced by using lightweight concrete insulating blocks for the inner leaf. When calculating the U-value in accordance with Appendix A, the inner leaf is considered a bridged layer due to the mortar with a 7% fractional area.

Due to the sound attenuation properties of lightweight blocks their suitability for use in the inner leaves adjoining party walls may be limited when flanking sound transmission is considered.

Installation guidelines and precautions

Insulation should be tight against the inner leaf. Any excess mortar should be cleaned off before fixing insulation. The insulation layer should be continuous and without gaps. Insulation batts should butt tightly against each other. Mortar droppings on batts should be avoided. Batts should be cut and trimmed

to fit tightly around openings, cavity trays, lintels, sleeved vents and other components bridging the cavity, and should be adequately supported in position. BRE “Good Building Guide 68 Part 2 Installing thermal insulation: Good site practice” provides further guidance on installing insulation in cavity walls.

Critical locations where care should be taken to limit thermal bridging include lintels, jambs, sills, roof/wall junctions and wall/floor junctions. The method of cavity closure used should not cause thermal bridge at the roof/wall junction (see Acceptable Construction Details, section 1 details).

B.6.1.2W1(b): As W1(a) except with insulation partly in cavity and partly as internal lining

If composite boards of plasterboard backed with insulation (of similar conductivity to that used in the cavity) are used internally then the total insulation thickness (cavity plus internal) may be used to calculate the U-value. If internal insulation is placed between timber studs/battens, then the insulation must be treated as two separate layers with the bridging effect allowed for in the internal layer (similar to Example A2 in Appendix A).

Where the thermal conductivity of the insulation is different, the material on the warm side (i.e. internally) should have a vapour resistance no lower than the insulation on the cold side (i.e. in the cavity).

Lower U-values, or reduced insulation thickness, can be achieved by using insulating concrete blockwork (rather than dense concrete) between the cavity and internal insulation.

Insulation partly in cavity and partly as internal lining helps minimise thermal bridging. Internal insulation limits thermal bridging at floor and roof junctions, whereas cavity insulation minimises thermal bridging at separating walls and internal fixtures.


Installation guidelines and precautions

Installation of insulation in the cavity should

follow the guidelines given above for construction W1(a) (partial-fill cavity insulation), and installation of the internal lining should follow the guidelines given below for construction W4 (hollow-block). BRE “Good Building Guide 68 Part 2 Installing thermal insulation: Good site practice” provides further guidance on installing insulation in cavity walls.

B.6.2 Construction W2: Cavity walls, insulation in cavity, no residual cavity (full-fill)

The insulation fully fills the cavity. Insulation may be in the form of semi-rigid batts installed as wall construction proceeds, or loose-fill material blown into the cavity after the wall is constructed; the former is considered here. Insulation material suitable for cavity fill should not absorb water by capillary action and should not transmit water from outer to inner leaf. Such insulation may extend below damp proof coursing (dpc) level.

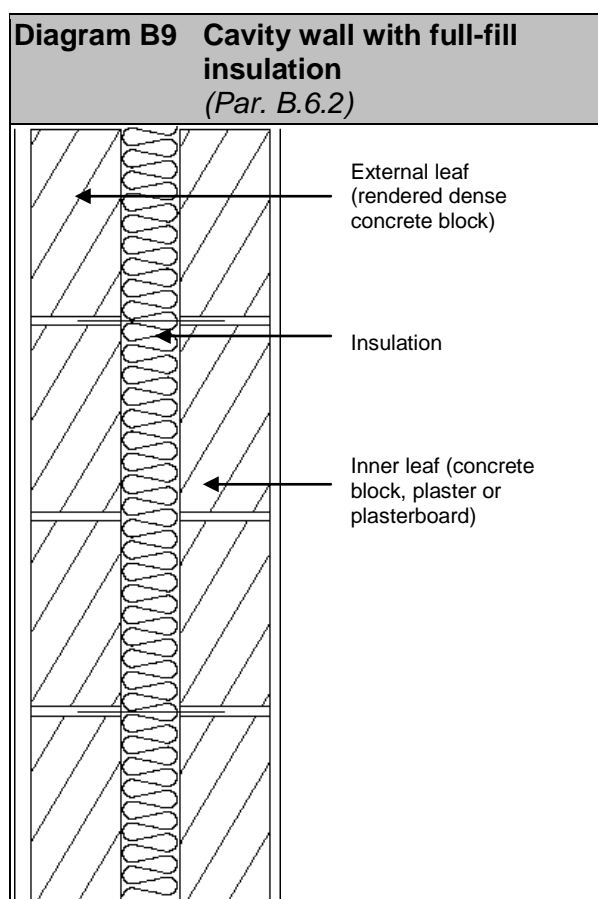

The insulation thickness required to achieve a given U-value may be reduced by using insulating concrete blocks for the inner leaf, as advised in W1(a) above.

Installation guidelines and precautions

Only certified insulation products should be used, and the installation and other requirements specified in such certificates should be fully complied with. In particular, regard should be had to the exposure conditions under which use is certified and any limitations on external finish associated therewith.

Guidance on minimising air gaps and infiltration in partial-fill cavity insulation applies also to full-fill insulation. Similar issues regarding avoidance of thermal bridging as for partial-fill construction apply.

BRE “Good Building Guide 68 Part 2 Installing thermal insulation: Good site practice” provides further guidance on installing insulation in cavity walls.


B.6.3 Construction W3: Timber frame wall, brick or rendered concrete block external leaf

B.6.3.1W3(a): Insulation between studs

The insulation is installed between studs, whose depth equals or exceeds the thickness of insulation specified.

In calculating U-values, the fractional area of timber bridging the insulation should be checked. Account should be taken of all repeating timber elements which fully bridge the insulation. In Table A2 a fractional area of 15% is given as the default percentage and is used in Example A2 to calculate the upper and lower thermal resistance of the bridged construction.

Diagram B10 Timber frame wall, insulation between framing timbers
(Par. B.6.3.1)

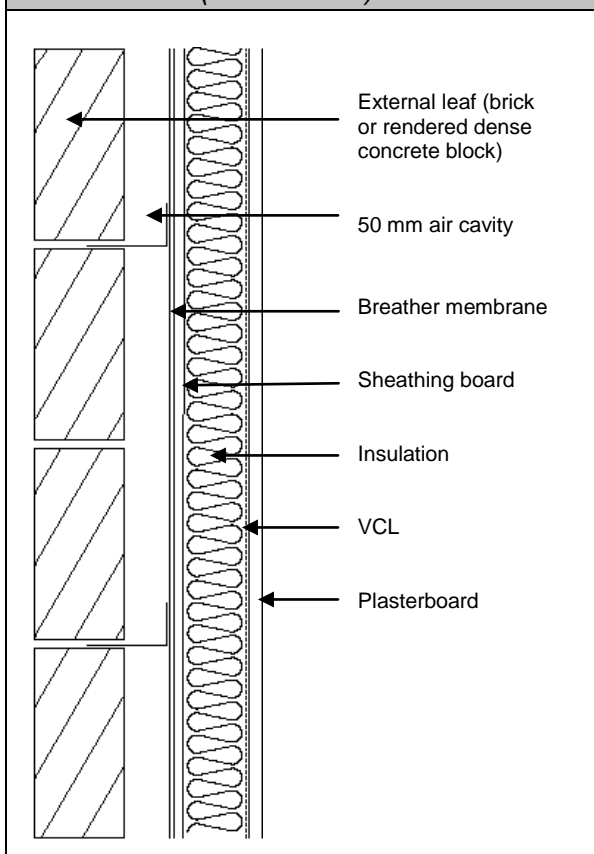

Installation guidelines and precautions

Air gaps in the insulation layer, and between it and the vapour barrier, should be avoided. Insulation batts should be friction fitted between studs to minimise gaps between insulation and joists. Adjacent insulation pieces should butt tightly together. Particular care is needed to fill gaps between closely-spaced studs at wall/wall and wall/floor junctions, and at corners of external walls.

A VCL should be installed on the warm side of the insulation. There should be no layers of high vapour resistance on the cold side of the insulation.

Care is required to minimise thermal bridging of the insulation by timber noggings and other inserts (see Acceptable Construction Details, section 4 details).


B.6.3.2W3(b): Insulation between and across studs

Where the chosen stud depth is not sufficient to accommodate the required thickness of insulation, insulation can be installed to the full depth between the studs with additional insulation being provided as an internal lining. This additional insulation may be either in the form of plasterboard/insulation composite board or insulation between timber battens, to which the plasterboard is fixed.

The VCL should be on the warm side of the insulation. If different types of insulation are used between and inside the studs, the vapour resistance of the material between the studs should not exceed that of the material across them (see B.4 regarding VCLs).

B.6.4 Construction W4: Hollow concrete block wall, rendered externally, internal insulation lining with plasterboard finish

Diagram B11 Hollow-block wall, internal insulation lining
(Par. B.6.4)

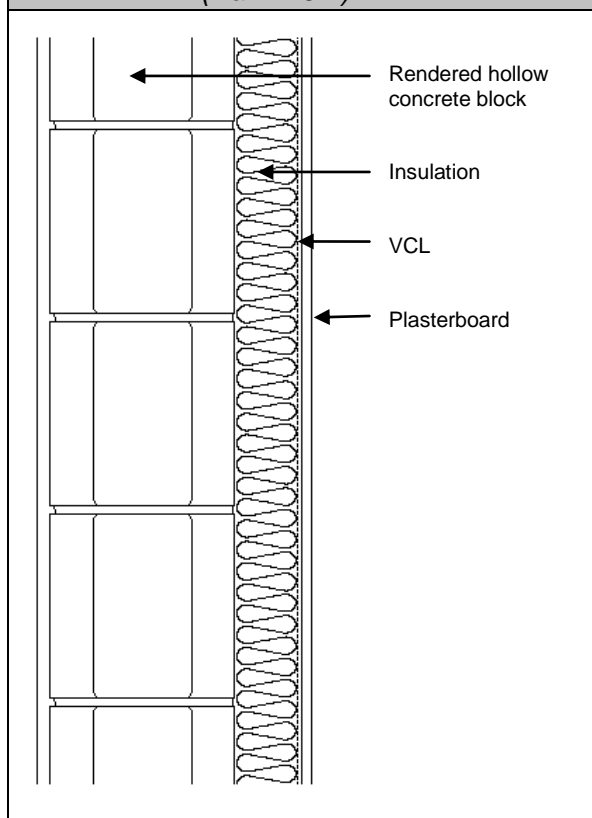

The insulation is installed on the inner face of the masonry walls. It may be installed between preservative-treated timber studs fixed to the wall, or in the form of composite boards of plaster backed with insulation, or as a combination of these.

Installation guidelines and precautions

Air movement

Air gaps in the insulation layer should be kept to a minimum. If using insulation between timber studs, there should be no gaps between insulation and studs, between insulation and the VCL, between butt joints in the insulation, around service penetrations, etc. If using composite boards, they should be tightly butted at edges, and should provide complete and continuous coverage of the external wall.

When mounting composite boards on plaster dabs or timber battens, there is a danger that air will be able to circulate behind the insulation, reducing its effectiveness. To minimise such air movement, the air gap behind the boards should be sealed along top and bottom, at corners and around window and door openings, e.g. with continuous ribbon of plaster or timber studs. This also serves as a fire barrier.

Condensation

A suitable VCL should be installed on the warm side of the insulation to minimise the risk of interstitial condensation on the cold masonry behind the insulation. Care should be taken to avoid gaps in the VCL at all joints, edges and service penetrations. The location of service runs in the air gap on the cold side of the insulation should be avoided. Refer to paragraph B.4 for further guidance.

Thermal bridging

Care should be taken to minimise the impact of thermal bridging. Critical locations where care should be taken to limit thermal bridging include lintels, jambs, sills, roof/wall junctions and wall/floor junctions (see Acceptable Construction Details, section 6 details).

Other areas where there is a risk of

significant thermal bridging include: -

Junctions with solid party walls and partitions

Internal partition or party walls of solid dense concrete blockwork can create significant thermal bridge effects at junctions with single leaf masonry external walls (see Acceptable Construction Details, details 6.05 and 6.06).

Junctions with intermediate floors

The external walls in the floor space of intermediate floors should be insulated and protected against vapour movement. Along the wall running parallel to the joists, insulation can be placed between the last joist and the wall. Where the joists are perpendicular to the wall, the insulation and VCL should be continuous through the intermediate floor space and should be carefully cut to fit around the joist ends (see Acceptable Construction Details, detail 6.04).

Stairs, cupboards and other fittings supported on or abutting the external wall

Insulation should be carried through behind such fittings.

Ducts, e.g. soil and vent pipe ducts, against external walls

Insulation should be continuous at all such ducts, i.e. the insulation should be carried through on either the external or internal side of such ducts. Where the insulation is on the external side, particular care should be taken to prevent ingress of cold external air where ducts etc. penetrate the insulation.


B.7 FLOOR CONSTRUCTIONS

B.7.1 Construction F1: Ground floor: concrete slab-on-ground. Insulation under slab or under screed

For continuous and uniform insulation under the full ground floor area, the insulation thickness required to achieve prescribed U-values for slab-on-ground floors varies depending on the floor area to exposed perimeter ratio as shown in Example A4 in Appendix A. When calculating the U value


the ground conductivity should be taken as 2.0 W/mK and the full wall thickness as per design.

Diagram B12 Concrete slab-on-ground floor, insulation under slab
(Par. B.7.1)

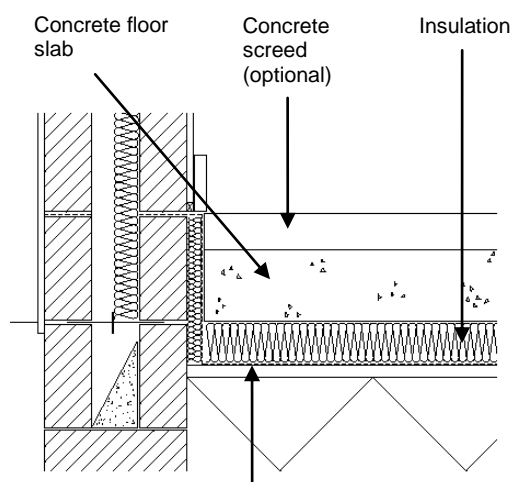

Damp proof membrane. Where radon barrier required, ensure correct detailing to prevent passage of radon gas into dwelling - See Technical Guidance Document C.

Diagram B13 Concrete slab on ground floor, insulation under screed
(Par. B.7.1)

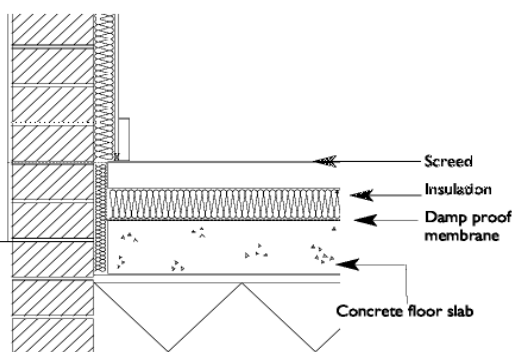

Where radon barrier required, ensure correct detailing to prevent passage of radon gas into dwelling - See TGD C.

moisture and, where placed below the dpm/radon barrier, should perform well under prolonged damp conditions and should not be degraded by any waterborne contaminants in the soil or fill.

The insulation should have sufficient load-bearing capacity to support the floor and its loading.

The insulation is laid horizontally over the whole area of the floor. Insulation boards should be tightly butted, and cut to fit tightly at edges and around service penetrations.

Care should be taken to prevent damage or dislodgement of insulation during floor laying. If the dpm is placed below the insulation, the joints between insulation boards should be taped to prevent wet screed from entering when being poured. If the slab/screed is power-floated, the exposed edges of perimeter insulation should be protected during power-floating, e.g. by boards, or the areas close to the edge of the floor should be hand trowelled.


Thermal bridging at floor/wall junctions should be minimised (see Acceptable Construction Details, details 1.01a and 6.02).

Installation guidelines and precautions

The insulation may be placed above or below the damp proof membrane (dpm)/radon barrier. The insulation should not absorb


B.7.2 Construction F2: Ground floor: suspended timber floor, insulation between joists

Diagram B14 Suspended timber floor with quilt insulation
(Par. B.7.2)

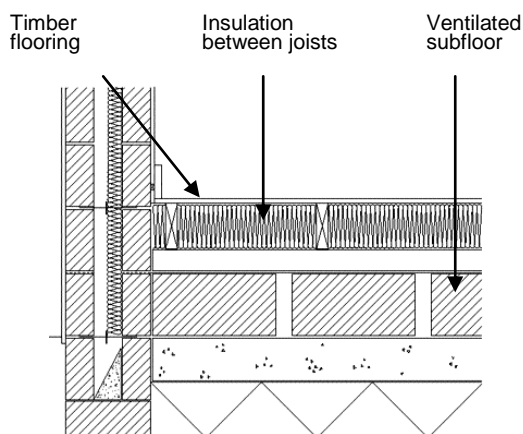

Where radon barrier required, ensure correct detailing to prevent passage of radon gas into dwelling - See Technical Guidance Document C.

Diagram B15 Suspended timber floor with rigid or semi-rigid board insulation
(Par. B.7.2)

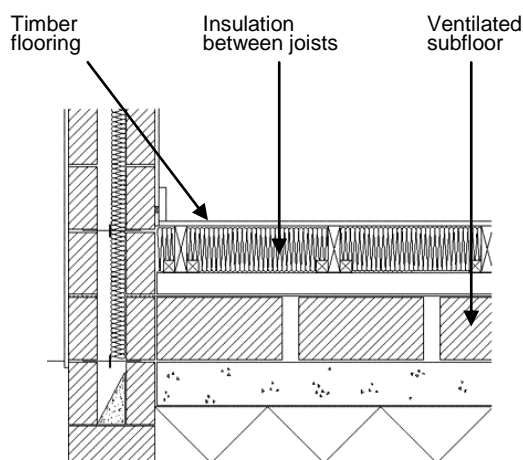

Where radon barrier required, ensure correct detailing to prevent passage of radon gas into dwelling - See Technical Guidance Document C.

Installation guidelines and precautions

Where mineral wool quilt insulation is used, the insulation is supported on polypropylene netting or a breather membrane draped over the joists and held against their sides with staples or battens. The full thickness of insulation should extend for the full width between joists. Insulation should not be draped over joists, but cut to fit tightly between them.

Alternatively, rigid or semi-rigid insulation boards, supported on battens nailed to the sides of the joists, may be used.

When calculating the U-value for a timber floor the fractional area of timber thermal bridging can be calculated or assumed as 11% as per Table A2.


Thermal bridging, and air circulation around the insulation from the cold vented air space below, should be minimised. The insulation should fit tightly against the joists and the flooring above. Careful placement of supporting battens (or staples) is required to achieve this. At floor/wall junctions the insulation should extend to the walls. The space between the last joist and the wall should be packed with insulation to the full depth of the joist. Where internal wall insulation is used, the floor and wall insulation should meet. Where cavity insulation is used, the floor insulation should be turned down on the internal face and overlap the cavity insulation, or insulating blocks used in the wall at this level (see Acceptable Construction Details, details 1.03 and 6.03).

Cross-ventilation should be provided to the sub-floor space to remove moisture.

Water pipes in the sub-floor space should be insulated to prevent freezing.

B.7.3 Construction F3: Ground floor: suspended concrete floor

Diagram B16 Suspended reinforced concrete floor, internally insulated walls (Par. B.7.3)

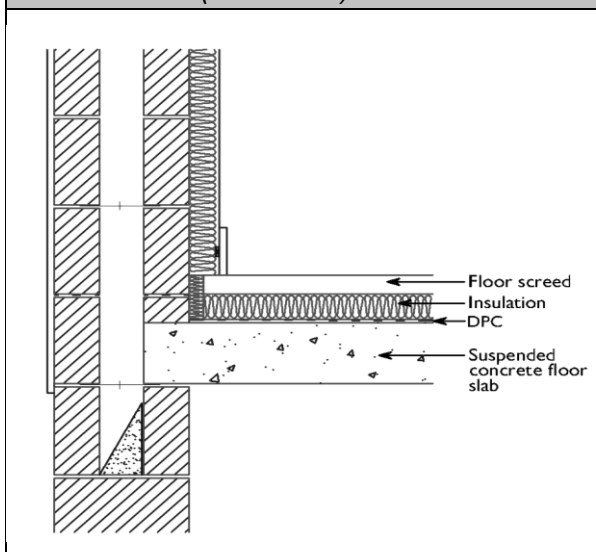


Installation guidance and precautions

If the walls are internally insulated, it is recommended that the floor insulation be placed above the floor structure, since it can then connect with the wall insulation. Thermal bridging at the floor/wall junction is difficult to avoid when insulation is placed below the floor structure (see Acceptable Construction Details, details 6.01 and 6.02).

If the walls are cavity insulated, floor insulation can not connect with wall insulation, so some thermal bridging is inevitable. It can be minimised by using insulating blocks for the inner leaf between overlapping floor and wall insulation. Insulation and insulating blocks may be either above or below the floor structure, but above is recommended. This will allow the use of less dense blocks (of lower thermal conductivity), since they will not have to support the weight of the floor. Also, above the structure they will be above the dpc, where their lower moisture content will give a lower thermal conductivity than below the dpc. Heat loss from the floor can be further


reduced by extending the cavity insulation down to, or below, the lower edge of the suspended floor.

Diagram B17 Suspended beam and block floor (Par. B.7.3)

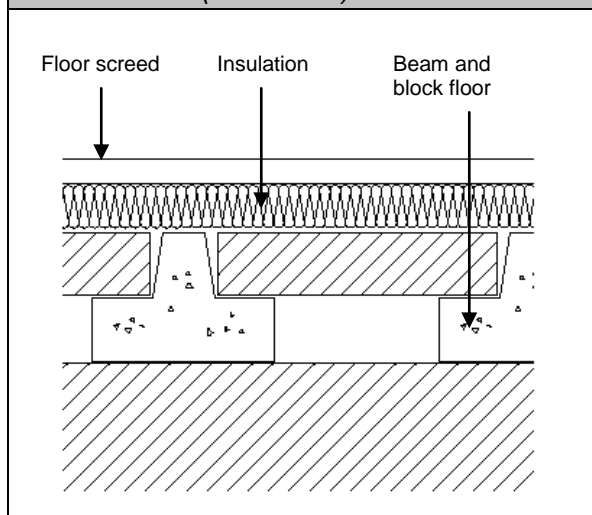

B.7.4 Construction F4: Exposed floor: timber joists, insulation between joists


Diagram B18 Exposed timber floor, insulation between joists (Par. B.7.4)

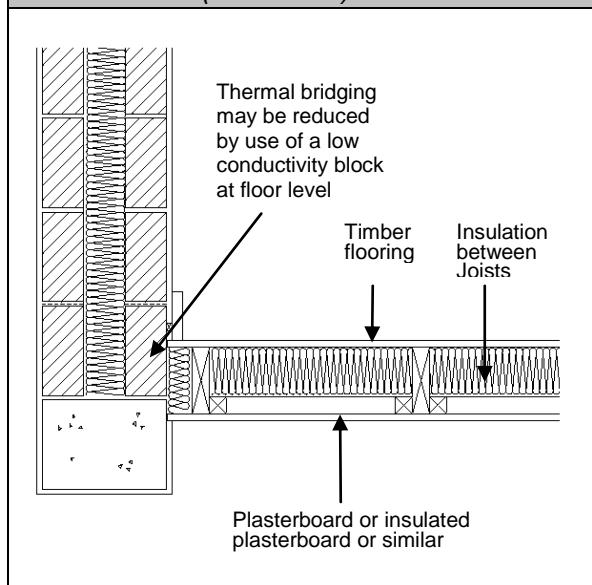

Installation guidance and precautions

The flooring on the warm side of the insulation should have a higher vapour resistance than the outer board on the cold side. If necessary, a vapour check should be laid across the warm side of the insulation. Methods of avoiding thermal bridging at junctions with internally insulated and cavity insulated walls are similar to those described for suspended timber ground floors above.

B.7.5 Construction F5: Exposed floor: solid concrete, insulation external

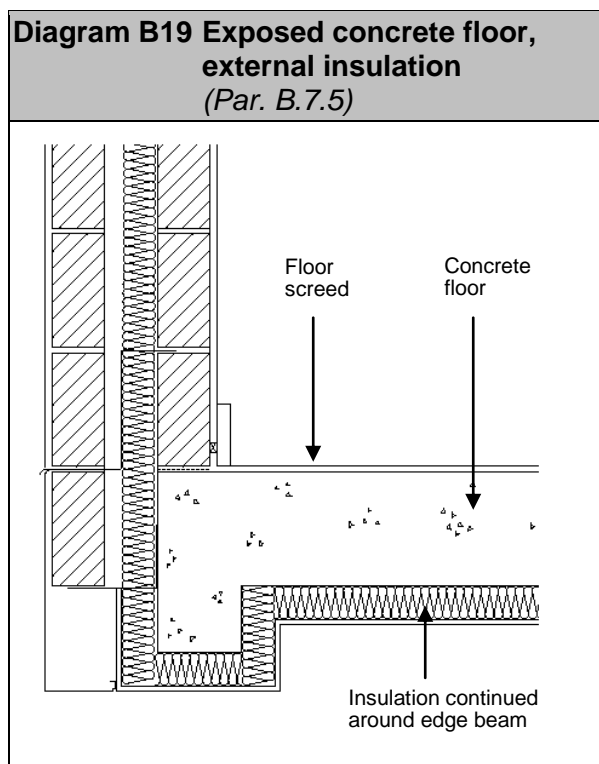

Installation guidance and precautions

If the walls are internally insulated, this floor construction is not recommended. Floor insulation should instead be located internally in order to connect with the wall insulation.

With cavity wall insulation, thermal bridging may be minimised by supporting the external leaf independently, and continuing the external floor insulation around the edgebeam to connect with the cavity insulation as shown in Diagram 19.

B.8 WINDOWS AND DOORS

B.8.1 Indicative U-values ($\text{W/m}^2\text{K}$) for windows, doors and roof windows

The values provided in Table B1 apply to the entire area of the window opening, including both frame and glass, and take account of the proportion of the area occupied by the frame and the heat conducted through it. If the U-value of the components of the window (glazed unit and frame) are known, window U-values may alternatively be taken from the tables in Annex F of I.S. EN ISO 10077-1, using the tables for 20% frame for metal-framed windows and those for 30% frame for wood or PVC-U framed windows.

U-values for windows or doors that have been independently certified by a third party, such as the Window Energy Performance Certification Scheme (WEP) or equivalent, should be used in preference to the data in this table. Adjustments for roof windows should be applied to the certified window U-values unless the certifier provides a U-value specifically for a roof window.

Table B1 — Indicative U-Values (W/m²K) for windows, doors and rooflight

	Type of frame					
	Window with wood or PVC-U frame (use adjustment in Note 1)			Window with metal frame with 4 mm thermal break (use adjustments in Note 2)		
	6 mm gap	12 mm gap	16 or more mm gap	6 mm gap	12 mm gap	16 or more mm gap
double-glazed, air filled	3.1	2.8	2.7	3.7	3.4	3.3
double-glazed, air filled (low-E, $\hat{A}_n = 0.2$, hard coat)	2.7	2.3	2.1	3.3	2.8	2.6
double-glazed, air filled (low-E, $\hat{A}_n = 0.15$, hard coat)	2.7	2.2	2.0	3.3	2.7	2.5
double-glazed, air filled (low-E, $\hat{A}_n = 0.1$, soft coat)	2.6	2.1	1.9	3.2	2.6	2.4
double-glazed, air filled (low-E, $\hat{A}_n = 0.05$, soft coat)	2.6	2.0	1.8	3.2	2.5	2.3
double-glazed, argon filled	2.9	2.7	2.6	3.5	3.3	3.2
double-glazed, argon filled (low-E, $\hat{A}_n = 0.2$, hard coat)	2.5	2.1	2.0	3.0	2.6	2.5
double-glazed, argon filled (low-E, $\hat{A}_n = 0.15$, hard coat)	2.4	2.0	1.9	3.0	2.5	2.4
double-glazed, argon filled (low-E, $\hat{A}_n = 0.1$, soft coat)	2.3	1.9	1.8	2.9	2.4	2.3
double-glazed, argon filled (low-E, $\hat{A}_n = 0.05$, soft coat)	2.3	1.8	1.7	2.8	2.2	2.1
triple-glazed, air filled	2.4	2.1	2.0	2.9	2.6	2.5
triple-glazed, air filled (low-E, $\hat{A}_n = 0.2$, hard coat)	2.1	1.7	1.6	2.6	2.1	2.0
triple-glazed, air filled (low-E, $\hat{A}_n = 0.15$, hard coat)	2.1	1.7	1.6	2.5	2.1	2.0
triple-glazed, air filled (low-E, $\hat{A}_n = 0.1$, soft coat)	2.0	1.6	1.5	2.5	2.0	1.9
triple-glazed, air filled (low-E, $\hat{A}_n = 0.05$, soft coat)	1.9	1.5	1.4	2.4	1.9	1.8
triple-glazed, argon filled	2.2	2.0	1.9	2.8	2.5	2.4
triple-glazed, argon filled (low-E, $\hat{A}_n = 0.2$, hard coat)	1.9	1.6	1.5	2.3	2.0	1.9
triple-glazed, argon filled (low-E, $\hat{A}_n = 0.15$, hard coat)	1.8	1.5	1.4	2.3	1.9	1.8
triple-glazed, argon filled (low-E, $\hat{A}_n = 0.1$, soft coat)	1.8	1.5	1.4	2.2	1.9	1.8
triple-glazed, argon filled (low-E, $\hat{A}_n = 0.05$, soft coat)	1.7	1.4	1.3	2.2	1.8	1.7
Windows and doors, single-glazed	4.8			5.7		
Solid wooden door	3.0					

Notes:

(1) — For roof windows with wooden or PVC-U frames apply the following adjustments to U-values:—

Wood or PVC-U frame — U-value adjustment for roof window, W/m²K

Single-glazed	+0.3
Double-glazed	+0.2
Triple-glazed	+0.2

(2) — For windows or roof windows with metal frames apply the following adjustments to U-values:—

Metal frames — Adjustment to U-value, W/m²K

	Window	Roof window
Metal, no thermal break	+0.3	+0.7
Metal, thermal break 4 mm	0	+0.3
Metal, thermal break 8 mm	-0.1	+0.2
Metal, thermal break 12 mm	-0.2	+0.1
Metal, thermal break 20 mm	-0.3	0
Metal, thermal break 32 mm	-0.4	-0.1

~~(3) For doors which are half-glazed (approximately) the U-value of the door is the average of the appropriate window U-value and that of the non-glazed part of the door (e.g. solid wooden door [U-value of 3.0 W/m²K] half-glazed with double-glazing [low-E, hard coat, argon filled, 6 mm gap, U-value of 2.5 W/m²K] has a resultant U-value of 0.5(3.0+2.5)= 2.75 W/m²K).~~

~~Source: Deap Manual~~

Appendix C

Reference values for calculation of MPEPC and MPCPC

GENERAL

C.1 This Appendix provides a set of reference values for the parameters of a DEAP calculation, which are used in connection with establishing an EPC and CPC for a dwelling for the purposes of demonstrating compliance with Regulation L3(a) for new dwellings. Table C1 is used to define a notional reference dwelling of the same size, i.e. same floor area and volume, and with the same area of opaque fabric elements, i.e. wall, roof and floor, as a dwelling being assessed. The total external window, rooflight and door area is taken to be 25% of the dwelling floor area.

C.2 The primary energy consumption and CO₂ emissions per unit floor area calculated for this reference dwelling are used to

calculate the primary energy performance coefficient (EPC) and carbon performance coefficient (CPC) respectively for a dwelling being assessed. These, in turn are compared to the MPEPC and MPCPC in order to demonstrate compliance for the dwelling being assessed. An example of a typical dwelling specification which complies with the MPEPC and MPCPC is given in Appendix E.

C.3 The main heating system for space and water heating in the reference dwelling is assumed to be natural gas, while the secondary system is assumed to be an open fire. Some 10% of space heating is assumed to be provided by the secondary heating method.

Table C1 Reference Values	
Element or system	Specifications
Total floor area, and dwelling volume	Same as actual dwelling
Opening areas (windows and doors)	25% of total floor area, or sum of exposed roof and wall area, whichever is the lesser The above includes one opaque door of area 1.85 m ² , any other doors are fully glazed
Walls	U = 0.27 W/m ² K Area: Total wall area including windows and doors to be the same as actual dwelling
Roof	U = 0.16 W/m ² K Area: Total area including any roof windows to be same as actual dwelling
Floor	U = 0.25 W/m ² K Area: same as actual dwelling
Opaque door	U = 3.0 W/m ² K
Windows and glazed doors	U = 2.2 W/m ² K Double glazed, low-E hard coat Frame factor 0.7 Solar energy transmittance 0.72 Light transmittance 0.80
Living area fraction	Same as actual dwelling
Shading and orientation	All glazing oriented E/W; average overshadowing
Number of sheltered sides	2
Allowance for thermal bridging	0.11 x total exposed surface area (W/K)
Extract fans	3 for dwellings with floor area greater than 100 m ² 2 for smaller dwellings
Draught lobby	None
Primary heating fuel (space and water)	Mains gas
Heating system	Boiler and radiators water pump in heated space

Table C1 Reference Values (contd....)

Element or system	Specifications
Boiler	Seasonal efficiency 78% room-sealed fanned flue
Heating system controls	Programmer + room thermostat + TRVs boiler interlock
Hot water system	Stored hot water, heated by boiler separate time control for space and water heating
Hot water cylinder	120 litre cylinder insulated with 35 mm of factory applied foam
Primary water heating losses	Primary pipework uninsulated cylinder temperature controlled by thermostat
Secondary space heating	Open fire
Low energy light fittings	None

Appendix D

Thermal bridging at junctions and around openings

D.1 General

This Appendix deals with the assessment of discrete thermal bridging not taken account of in the calculation of the U-values of plane building elements, e.g. at junctions and around openings such as doors and windows. It gives guidance on: -

- avoidance of mould growth and surface condensation, and
- limiting factors governing additional heat losses.

The guidance is based primarily on “BRE IP 1/06: Assessing the effects of thermal bridging at junctions and around openings”.

D.2 Mould growth and surface condensation

The key factor used in assessing the risk of mould growth or surface condensation in the vicinity of thermal bridges is the temperature factor (f_{Rsi}).

The temperature factor (f_{Rsi}) is defined as follows: -

$$f_{Rsi} = (T_{si} - T_e) / (T_i - T_e)$$

where: -

T_{si} = minimum internal surface temperature,

T_e = external temperature, and

T_i = internal temperature.

For dwellings, the value of f_{Rsi} should be greater than or equal to 0.75, so as to avoid the risk of mould growth and surface condensation. For three-dimensional corners of ground floors this value may be reduced to 0.70, for all points within 10 mm of the point of lowest f_{Rsi} .

D.3 Linear thermal transmittance and additional heat loss

The linear thermal transmittance (ψ)

describes the heat loss associated with a thermal bridge. This is a property of a thermal bridge and is the rate of heat flow per degree per unit length of bridge that is not accounted for in the U-values of the plane building elements containing the thermal bridge. The transmission heat loss coefficient associated with non-repeating thermal bridges is calculated as: -

$$H_{TB} = \sum (L \times \psi) \text{ (W/K)}$$

where L is the length of the thermal bridge over which ψ applies.

D.4 Calculation procedures

The calculation procedure to establish both temperature factor (f_{Rsi}) and the linear thermal transmittance (ψ) is outlined in BRE IP 1/06. Details should be assessed in accordance with the methods described in I.S. EN ISO 10211. These calculations of two dimensional or three dimensional heat flow require the use of numerical modeling software. To be acceptable, numerical modeling software should model the validation examples in I.S. EN ISO 10211 with results that agree with the stated values of temperature and heat flow within the tolerance indicated in the standard for these examples. Several packages are available that meet this requirement.

Detailed guidance on decisions regarding specific input to the modeling software and the determination of certain quantities from the output of the software is contained in BRE Report BR 497 Conventions for calculating linear thermal transmittance and temperature factors. This guidance should be followed in carrying out modeling work so that different users of the same software package and users of different software packages can obtain correct and consistent results.

D.5 Treatment of thermal bridging in DEAP calculation

Heat loss through thermal bridging is taken account of in the DEAP calculation. Two alternative methods of accounting for heat

loss are possible: -

- (a) Heat loss through thermal bridging can be accounted for in terms of a fraction (y) multiplied by the exposed surface area of the building. Where Acceptable Construction Details for sections 1 to 6 in the 2011 edition of the document “Limiting Thermal Bridging and Air Infiltration – Acceptable Construction Details” are used for all key junctions the value of (y) can be taken as 0.08. Where this is not the case, but this method of accounting for thermal bridging is used, the default value of (y) is taken to be 0.15.
- (b) Values of ψ can be determined from the results of numerical modeling, or they can be derived from measurement. The linear transmission heat loss coefficient (H_{TB}) can then be calculated directly and included in the DEAP calculation. Values of ψ are given in Tables D1 to D6 of this Appendix for Acceptable Construction Details and for Appendix 2 of the 2011 edition “Limiting Thermal Bridging and Air Infiltration – Acceptable Construction Details” to allow this approach to be used for these details. Where Section 3 - internal insulation details are used the ψ values given in Table D6 may be used.

Table D1	Section 1 - Cavity Wall Insulation	Target U-values		
Junction detail Identifier 2011 Edition	Junction detail	U-value = 0.21 W/m ² K, 150mm full-fill or partial-fill cavity ^{1,3} (roof U = 0.16) (floor U = 0.21)	U-value = 0.15 W/m ² K, 150mm full-fill or partial fill cavity and internal insulation ^{2,3} (roof U = 0.14) (floor U = 0.15)	U-value = 0.15 W/m ² K, 200mm full-fill or partial fill cavity ^{2,3} (roof U = 0.14) (floor U = 0.15)
		ψ-value (W/mK)	ψ-value (W/mK)	ψ-value (W/mK)
Section 1	Details			
1.01a	Ground Floor - Insulation above slab	0.170	0.072	0.196
1.01b	Ground Floor - Insulation above slab plus lightweight block	0.080	0.042	0.093
1.02a	Ground Floor - Insulation below slab	0.163	0.108	0.191
1.02b	Ground Floor - Insulation below slab plus lightweight block	0.070	0.061	0.083
1.03	Timber Suspended Ground Floor	0.219	0.102	0.227
1.04	Concrete Intermediate Floor within a dwelling	0.000	0.039	0.000
1.04a	Concrete Separating Floor between dwellings	0.064	0.087	0.045
1.05	Timber Intermediate Floor within a dwelling	-0.001	0.020	-0.001
1.05a	Timber Separating Floor between dwellings	0.041	0.051	0.029
1.06.1	Masonry Solid Separating Wall (plan)	0.045	0.066	0.032
1.06.2	Masonry Cavity Separating Wall (plan)	0.051	0.072	0.036
1.07	Masonry Partition Wall	0.000	0.000	0.000
1.08	Stud Partition Wall	0.000	0.000	0.000
1.09/1.10	Eaves – Unventilated/Ventilated attic	0.049	0.030	0.053
1.11.1/ 1.12.1	Eaves – Unventilated/Ventilated - Insulated at ceiling	0.028	0.024	0.037
1.11.2/ 1.12.2	Eaves – Unventilated/Ventilated – Insulation between and under rafters – Dormer	0.014	0.013	0.013
1.13.1	Eaves – Ventilated – Insulation between and under rafters – Pitched ceiling	0.021	0.020	0.036
1.13.2	Eaves – Ventilated – Insulation between and under rafters – Pitched with flat ceiling	0.020	0.017	0.017
1.14	Eaves – Unventilated – Insulation between and over rafters – Dormer	0.009	0.011	0.034
1.15	Ventilated Roof - Attic floor level	0.272	0.152	0.210
1.16/1.17	Gable - Insulation between and under rafters – Unventilated/Ventilated rafter void	0.067	0.041	0.063
1.18	Gable - Insulation between and over rafters - Unventilated rafter void	0.096	0.058	0.071
1.19	Flat Roof – Eaves	0.040	0.039	0.038
1.20	Flat Roof - Parapet	0.152	0.059	0.206
1.21	Ope - Split Lintels - Steel and Concrete	-0.003	0.005	0.001
1.22	Ope - Perforated steel lintel (stainless steel)	0.261	0.138	0.236
1.23.1	Ope - Pre-stressed concrete lintels	-0.005	0.004	0.001
1.23.2	Ope - Pre-stressed concrete lintels - proprietary closer	0.007	0.012	0.006
1.24	Ope - Jamb with closer block	0.028	0.026	0.031
1.25	Ope - Jamb with proprietary cavity closer	0.006	0.011	0.006
1.26	Ope - Concrete Forward Sill	0.006	0.015	0.019
1.27.1	Corner	0.044	0.032	0.035
1.27.2	Inverted corner	-0.069	-0.053	-0.055

Table D1 (contd)	Section 1 - Cavity Wall Insulation	Target U-values		
Junction detail Identifier 2011 Edition	Junction detail	U-value = 0.21 W/m ² K, 150mm full-fill or partial fill cavity ^{1,3} (roof U = 0.16) (floor U = 0.21)	U-value = 0.15 W/m ² K, 150mm full-fill or partial fill cavity and internal insulation ^{2,3} (roof U = 0.14) (floor U = 0.15)	U-value = 0.15 W/m ² K, 200mm full-fill or partial fill cavity ^{2,3} (roof U = 0.14) (floor U = 0.15)
		ψ-value (W/mK)	ψ-value (W/mK)	ψ-value (W/mK)
Section G	General Details			
G.01.1	Masonry Separating (cavity) Wall Head - Section	0.511	0.484	0.484
G.01.2	Masonry Separating (solid) Wall Head - Section	0.488	0.458	0.458
G.05.1	Solid Masonry Separating Wall through ground floor	0.201	0.240	0.240
G.05.2	Solid Masonry (narrow) Partition Wall through ground floor	0.138	0.150	0.150
Appendix 2	Details			
Diagram 1	Galvanised Steel top hat lintel detail bridging masonry cavity wall	0.483	0.206	0.454
Diagram 2	Concrete Back sill detail (insulation below wood sill section)	0.383	0.174	0.395
Diagram 3	Eaves - Ventilated roof space - wall head closed with slate	0.072	0.054	0.131
Other Details				
1.B.1	Balcony within dwelling ⁴	0.000	0.000	0.000
1.B.2	Balcony between dwellings ^{4,5}	0.020	0.020	0.020

¹ ψ values for a Target U-value for the wall of 0.21 W/m²K can be used for a range of U-values down to 0.18 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling = 0.13 to 0.16 W/m²K; Flat Roof = 0.16 to 0.2 W/m²K; Ground Floor = 0.16 to 0.21 W/m²K.

² ψ values for a Target U-value for the wall of 0.15 W/m²K can be used for a range of U-values from 0.12 W/m²K to 0.17 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling 0.11 to 0.16 W/m²K; Flat Roof = 0.11 to 0.17 W/m²K; Ground Floor = 0.12 to 0.18 W/m²K.

³ Where two building elements have one U-value above its target while the other is below its target U-value, the aggregate percentage change from the respective target U-values in the table should not exceed +20% for the Psi (ψ) value to be valid, i.e. if for the 0.15 U-value wall, if the U-value was increased by 10% above the wall target U-value (from 0.15 to 0.165), then the roof U-value could be at most 10% below the roof target U-value (from 0.14 to 0.126), because the aggregate change would then be 20%.

⁴ This is an externally supported balcony (the balcony slab is not a continuation of the floorslab) where the wall insulation is continuous and not bridged by the balcony slab.

⁵ Value of Ψ is applied to each dwelling.

Table D2	Section 2 - External Insulation	Target U-values	
Junction detail Identifier 2011 Edition	Junction detail	$U = 0.21 \text{ Wm}^{-2}\text{K}^{1,3}$ (roof $U = 0.16$) (floor $U = 0.21$)	$U = 0.15 \text{ Wm}^{-2}\text{K}^{2,3}$ (roof $U = 0.14$) (floor $U = 0.15$)
		ψ -value (W/mK)	ψ -value (W/mK)
Section 2	Details		
2.01	Ground Floor - Insulation above slab	0.131	0.145
2.01a	Ground Floor - Insulation above slab	0.214	0.259
2.02	Ground Floor - Insulation below slab	0.162	0.172
2.02a	Ground Floor - Insulation below slab	0.235	0.247
2.03	Timber Suspended Ground Floor	0.158	0.204
2.03a	Timber Suspended Ground Floor	0.297	0.368
2.04	Concrete Intermediate Floor within a dwelling	0.001	0.000
2.04a	Concrete Separating Floor between dwellings	0.071	0.048
2.05	Masonry Separating Wall - plan	0.049	0.033
2.06	Masonry Partition Wall	0.000	0.000
2.07	Stud Partition Wall	0.000	0.000
2.08/2.09	Eaves – Unventilated/Ventilated roof space	0.067	0.074
2.10.1/2.11.1	Eaves – Unventilated/Ventilated - Insulation between and under rafters – Dormer	0.050	0.055
2.12.1	Eaves - Unventilated - Insulation between and over rafters - Pitched ceiling	0.016	0.031
2.12.2	Eaves – Unventilated/Ventilated - Insulation between and under rafters - Pitched with flat ceiling	0.020	0.017
2.13	Eaves - Unventilated - Insulation between and over rafters	0.013	0.027
2.14	Ventilated Roof - Attic floor level	0.347	0.335
2.15/2.16	Gable - Insulation between and under rafters – Unventilated/Ventilated rafter void	0.091	0.087
2.17	Gable - Insulation between and over rafters - Unventilated rafter void	0.131	0.106
2.18	Flat Roof - Eaves	0.046	0.045
2.19	Flat Roof - Parapet	0.349	0.327
2.20	Ope - Lintel	0.097	0.098
2.21	Ope - Jamb	0.088	0.091
2.22	Sill	0.149	0.109
2.23.1	Corner	0.099	0.070
2.23.2	Inverted corner	-0.141	-0.096
Section G	General Details		
G.01.1	Masonry Separating Wall Head – Section	0.511	0.484
G.01.2	Masonry Separating Wall Head – Section	0.488	0.458
G.05.1	Solid Masonry Separating Wall through ground floor	0.201	0.240
G.05.2	Solid Masonry (narrow) Partition Wall through ground floor	0.138	0.150
Other Details			
2.B.1	Balcony within dwelling ⁴	0.000	0.000
2.B.2	Balcony between dwellings ^{4,5}	0.020	0.020

¹ ψ values for a Target U-value for the wall of $0.21 \text{ W/m}^2\text{K}$ can be used for a range of U-values down to $0.18 \text{ W/m}^2\text{K}$ for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling = 0.13 to $0.16 \text{ W/m}^2\text{K}$; Flat Roof = 0.16 to $0.2 \text{ W/m}^2\text{K}$; Ground Floor = 0.16 to $0.21 \text{ W/m}^2\text{K}$.

² ψ values for a Target U-value for the wall of $0.15 \text{ W/m}^2\text{K}$ can be used for a range of U-values

from of 0.12 W/m²K to 0.17 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling 0.11 to 0.16 W/m²K; Flat Roof = 0.11 to 0.17 W/m²K; Ground Floor = 0.12 to 0.18.

³ Where two building elements have one U-value above its target while the other is below its target U-value, the aggregate percentage change from the respective target U-values in the table should not exceed +20% for the Psi (ψ) value to be valid, i.e. if for the 0.15 U-value wall, if the U-value was increased by 10% above the wall target U-value (from 0.15 to 0.165), then the roof U-value could be at most 10% below the roof target U-value (from 0.14 to 0.126), because the aggregate change would then be 20%.

⁴ This is an externally supported balcony (the balcony slab is not a continuation of the floorslab) where the wall insulation is continuous and not bridged by the balcony slab.

⁵ Value of Ψ is applied to each dwelling.

Table D3	Section 3 – Internal Insulation	Target U-values	
Junction detail Identifier 2011 Edition	Junction detail	0.21 Wm ² K U-value. Insulation between studs ^{1,3} (roof U = 0.16) (floor U = 0.21)	0.15 Wm ² K U-value. Insulation between studs and internal Insulation ^{2,3} (roof U = 0.14) (floor U = 0.15)
		ψ-value (W/mK)	ψ-value (W/mK)
Section 3	Details		
	Refer to Table D6 for Section 3 Psi values		

Table D4	Section 4 - Timber Frame Construction	Target U-values	
Junction detail Identifier 2011 Edition	Junction detail	0.21 Wm ² K U-value. Insulation between studs ^{1,3} (roof U = 0.16) (floor U = 0.21)	0.15 Wm ² K U-value. Insulation between studs and internal insulation ^{2,3} (roof U = 0.14) (floor U = 0.15)
		ψ-value (W/mK)	ψ-value (W/mK)
Section 4	Details		
4.01	Ground Floor - Insulation above slab	0.051	0.021
4.02	Ground Floor - Insulation below slab	0.205	0.125
4.03	Timber Suspended Ground Floor	0.063	0.046
4.04.1	Corner	0.062	0.030
4.04.2	Inverted corner	-0.004	-0.015
4.05	Timber Intermediate Floor within a dwelling	0.130	0.080
4.05a	Timber Separating floor between dwellings	0.193	0.132
4.06	Separating Wall (plan)	0.087	0.079
4.07	Separating Wall (section)	0.236	0.236
4.08	Partition Wall	0.000	0.000
4.09/4.10	Eaves – Unventilated/Ventilated roof space	0.082	0.044
4.11.1/4.12.1	Eaves -Insulation between and under rafters – Unventilated/Ventilated rafter void – Dormer	0.054	0.039
4.12.2	Eaves – Insulation between and under rafters – Unventilated/Ventilated rafter void – Pitched Ceiling Dormer	0.014	0.013
4.13.1	Eaves - Ventilated - Insulation between and under rafters - Pitched Ceiling	0.075	0.040
4.13.2	Pitch ceiling/Insulation on flat	0.020	0.017
4.14	Eaves - Unventilated - Insulation between and over rafters	0.064	0.031
4.15	Ventilated Roof - Attic floor level	0.081	0.051
4.16/4.17	Gable - Insulation between and under rafters – Unventilated/Ventilated rafter void	0.060	0.024
4.18	Gable - Insulation between and over rafters - Unventilated rafter void	0.062	0.037
4.19	Flat Roof - Parapet	0.041	0.046
4.20	Ope – Lintel	0.144	0.084
4.21	Ope – Jamb	0.064	0.043
4.22	Ope – Sill	0.048	0.034
4.23.1	Timber Frame Separating Wall through ground floor	0.118	0.149
4.23.2	Timber Frame Partition Wall through ground floor	0.074	0.096
Section G General Details			
G.01.1	Masonry Separating Wall Head – Section	0.511	0.484
G.01.2	Masonry Separating Wall Head – Section	0.488	0.458
G.05.1	Solid Masonry Separating Wall through ground floor	0.201	0.240
Other Details			
4.B.1	Balcony within dwelling ⁴	0.000	0.000
4.B.2	Balcony between dwellings ^{4,5}	0.020	0.020

¹ ψ values for a Target U-value for the wall of 0.21 W/m²K can be used for a range of U-values down to 0.18 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling = 0.13 to 0.16 W/m²K; Flat Roof = 0.16 to 0.2 W/m²K; Ground Floor = 0.16 to 0.21 W/m²K.

² ψ values for a Target U-value for the wall of 0.15 W/m²K can be used for a range of U-values

from of 0.12 W/m²K to 0.17 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling 0.11 to 0.16W/m²K; Flat Roof = 0.11 to 0.17 W/m²K; Ground Floor = 0.12 to 0.18.

³ Where two building elements have one U-value above its target while the other is below its target U-value, the aggregate percentage change from the respective target U-values in the table should not exceed +20% for the Psi (ψ) value to be valid, i.e. if for the 0.15 U-value wall, if the U-value was increased by 10% above the wall target U-value (from 0.15 to 0.165), then the roof U-value could be at most 10% below the roof target U-value (from 0.14 to 0.126), because the aggregate change would then be 20%.

⁴ This is an externally supported balcony (the balcony slab is not a continuation of the floorslab) where the wall insulation is continuous and not bridged by the balcony slab.

⁵ Value of Ψ is applied to each dwelling.

Table D5	Section 5 - Steel Frame Construction	Target U-values	
Junction detail Identifier 2011 Edition	Junction detail	Hybrid steel frame U-value = 0.21 ^{1,3} (roof U = 0.16) (floor U = 0.21)	Hybrid steel frame with internal insulation U-value = 0.15 ^{2,3} (roof U = 0.14) (floor U = 0.15)
Section 5	Details	ψ-value (W/mK)	ψ-value (W/mK)
5.01	Ground Floor - Insulation above slab	0.033	0.038
5.02	Ground Floor - Insulation below slab	0.141	0.106
5.03	Lightweight Intermediate Floor	0.021	0.055
5.04	Separating Wall (plan)	0.103	0.114
5.05	Separating Wall (section)	0.520	0.189
5.06	Stud Partition Wall	0.00	0.00
5.07/5.08	Eaves – Unventilated/Ventilated Attic	0.030	0.026
5.09.1/5.10.1	Eaves – Unventilated/Ventilated – Insulation between and under rafters - Dormer	0.032	0.026
5.09.2/5.10.2	Eaves – Insulation between and under rafters – Unventilated/Ventilated void – Pitch Ceiling Dormer	0.014	0.013
5.11.1	Eaves – Ventilated – Insulation between and under rafters – Pitched ceiling	0.011	0.012
5.11.2	Eaves – Ventilated – Insulation between and under rafters – Pitched with flat ceiling	0.020	0.017
5.12	Eaves – Insulation between and over rafters – Unventilated rafter void	0.007	0.009
5.13	Ventilated and Unventilated Attic	0.111	0.049
5.14/5.15	Gable – Insulation between and under rafters – Unventilated/Ventilated rafter void	0.049	0.034
5.16	Gable – Insulation between and over rafters – Unventilated rafter void	0.055	0.037
5.17	Flat Roof – Eaves	0.054	0.043
5.18	Flat Roof – Parapet	0.093	0.054
5.19	Ope – Lintel	0.006	0.016
5.20	Ope – Jamb	0.023	0.019
5.21	Ope – Sill	0.012	0.021
5.22.1	Steel Separating Wall through ground floor	0.213	0.263
5.22.2	Steel Partition Wall through ground floor	0.125	0.148
5.23.1	Corner	0.075	0.029
5.23.2	Inverted corner	-0.045	-0.043
Section G General Details			
G.01.1	Masonry Separating Wall Head – Section	0.511	0.484
G.01.2	Masonry Separating Wall Head – Section	0.488	0.458
G.05.1	Solid Masonry Separating Wall through ground floor	0.201	0.240
Other Details			
5.B.1	Balcony within dwelling ⁴	0.000	0.000
5.B.2	Balcony between dwellings ^{4,5}	0.020	0.020

¹ ψ values for a Target U-value for the wall of 0.21 W/m²K can be used for a range of U-values down to 0.18 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling = 0.13 to 0.16 W/m²K; Flat Roof = 0.16 to 0.2 W/m²K; Ground Floor = 0.16 to 0.21 W/m²K.

² ψ values for a Target U-value for the wall of 0.15 W/m²K can be used for a range of U-values from 0.12 W/m²K to 0.17 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling 0.11 to 0.16 W/m²K; Flat Roof = 0.11 to 0.17 W/m²K;

Ground Floor = 0.12 to 0.18.

³ Where two building elements have one U-value above its target while the other is below its target U-value, the aggregate percentage change from the respective target U-values in the table should not exceed +20% for the Psi (ψ) value to be valid, i.e. if for the 0.15 U-value wall, if the U-value was increased by 10% above the wall target U-value (from 0.15 to 0.165), then the roof U-value could be at most 10% below the roof target U-value (from 0.14 to 0.126), because the aggregate change would then be 20%.

⁴ This is an externally supported balcony (the balcony slab is not a continuation of the floorslab) where the wall insulation is continuous and not bridged by the balcony slab.

⁵ Value of Ψ is applied to each dwelling.

Table D6	Section 6 - Hollow Block Construction	Target U-values	
Junction detail Identifier 2011 Edition	Junction detail	Hollow Block with internal insulation U-value = 0.21 W/m ² K ^{1,3} (roof U = 0.16) (floor U = 0.21)	Hollow Block with internal insulation U-value = 0.15 W/m ² K ^{2,3} (roof U = 0.14) (floor U = 0.15)
		ψ-value (W/mK)	ψ-value (W/mK)
Section 6	Details		
6.01	Ground Floor - Insulation above slab	0.039	0.031
6.02	Ground Floor - Insulation below slab	0.050	0.039
6.03	Timber Suspended Ground Floor	0.029	0.021
6.04	Timber Intermediate Floor - Within a dwelling	0.101	0.081
6.05.1	Masonry Separating (solid) Wall - plan	0.296	0.284
6.05.2	Masonry Separating (cavity) Wall - plan	0.316	0.309
6.06	Masonry Partition Wall - plan	0.155	0.156
6.07	Stud Partition	0.000	0.000
6.08/6.09	Eaves – Unventilated/Ventilated roof space	0.021	0.021
6.10	Eaves - Insulation between and under rafters – ventilated rafter void - Dormer	0.022	0.022
6.10.2	Eaves – Insulation between and under rafters – Ventilated void – Pitched Ceiling Dormer	0.014	0.013
6.11	Eaves - Insulation between and under rafters – Ventilated rafter void – Pitched ceiling	0.003	0.002
6.11.2	Eaves - Ventilated - Insulation between and under rafters – Pitched with flat ceiling	0.020	0.020
6.12	Eaves - Unventilated - Insulation between and over rafters - Dormer	0.011	0.015
6.13	Ventilated Roof - Attic floor level	0.038	0.034
6.14/6.15	Gable - Insulation between and under rafters – Unventilated/Ventilated rafter void	0.026	0.022
6.16	Gable - Insulation between and over rafters - Unventilated rafter void	0.036	0.031
6.17	Flat Roof - Eaves	0.053	0.039
6.18	Flat Roof - Parapet	0.046	0.038
6.19	Ope - Lintel	0.037	0.042
6.20	Ope - Jamb	0.031	0.036
6.21	Ope - Sill	-0.004	0.003
6.C1	Corner	0.018	0.016
6.C2	Inverted Corner	-0.047	-0.042
Section G	General Details		
G.01.1	Masonry Separating (cavity) Wall Head - Section	0.511	0.484
G.01.2	Masonry Separating (solid) Wall Head – Section	0.488	0.458
G.05.1	Solid Masonry Separating Wall through ground floor	0.201	0.245
G.05.2	Solid Masonry (narrow) Partition Wall through ground floor	0.138	0.150
Other Details			
6.B.1	Balcony within dwelling ⁴	0.000	0.000
6.B.2	Balcony between dwellings ^{4, 5}	0.020	0.020

⁴ ψ values for a Target U-value for the wall of 0.21 W/m²K can be used for a range of U-values down to 0.18 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U-value as follows: Pitched roof insulation on slope, insulation on ceiling = 0.13 to 0.16 W/m²K; Flat Roof = 0.16 to 0.2 W/m²K; Ground Floor = 0.16 to 0.21 W/m²K.

² ψ values for a Target U-value for the wall of 0.15 W/m²K can be used for a range of U-values from 0.12 W/m²K to 0.16 W/m²K for the construction type specified. The U-values of the flanking elements to the wall can vary from the flanking element target U value as follows: Pitched roof insulation on slope, insulation on ceiling = 0.11 to 0.16 W/m²K; Flat Roof = 0.11 to 0.17 W/m²K; Ground Floor = 0.12 to 0.18.

³ Where two building elements have one U-value above its target while the other is below its target U-value, the aggregate percentage change from the respective target U-values in the table should not exceed +20% for the Psi (ψ) value to be valid, i.e. if for the 0.15 U-value wall, if the U-value was increased by 10% above the wall target U-value (from 0.15 to 0.165), then the roof U-value could be at most 10% below the roof target U-value (from 0.14 to 0.126), because the aggregate change would then be 20%.

⁴ This is an externally supported balcony (the balcony slab is not a continuation of the floorslab) where the wall insulation is continuous and not bridged by the balcony slab.

⁵ Value of Ψ is applied to each dwelling.

Appendix E

Achieving compliance with respect to MPEPC and MPCPC and RER

E.1 The following table gives a set of specifications which are calculated to achieve compliance for a typical 126 m² semi-detached house and 80m² apartment. Compliance with this requirement could also be achieved by a number of other combinations of measures

Table E1.1 Example A: Semi-detached dwelling with gas boiler for space heating and continuous mechanical extract ventilation	
Element or system	Specifications
Dwelling size and shape	Semi-detached house, two-storey Overall internal dimensions: 7 m wide x 9 m deep x 5.1 m high Total floor area 126 m ² Rectangular shape with no irregularities
Opening areas (windows and doors)	25% of total floor area The above includes one opaque door of area 1.85 m ² , any other doors are fully glazed
Walls	U = 0.13 W/m ² K e.g. 150 mm cavity wall with 100 mm cavity insulation of thermal conductivity 0.022 W/mK and 60 mm internal insulation of conductivity 0.022 W/mK
Roof	U = 0.11 W/m ² K e.g. 360 mm insulation of conductivity 0.04 W/mK, between and over ceiling joists
Floor	U = 0.14 W/m ² K e.g. Slab-on-ground floor with 120 mm insulation of conductivity 0.023 W/mK
Opaque door	U = 1.5W/m ² K
Windows and glazed doors	Double Triple glazed, low E (En = 0.05, soft coat) 20 mm gap, argon filled, PVC frames (U = 1.3 0.9 W/m ² K, solar transmittance = 0.6)
Living area fraction	25% of total floor area
Shading and orientation	All glazing oriented E/W; average overshadowing
Number of sheltered sides	2
Allowance for thermal bridging at element junctions	0.05 x total exposed surface area (W/m ² K)
Internal heat capacity category	Medium
Ventilation system	Natural ventilation with intermittent extract fans Continuous Mechanical Extract Ventilation with SFP 0.2 W/(l/s)
Air permeability	Infiltration due to structure = 0.25ac/h 0.15ac/h(53m ³ /(hr.m ²))@50pa)
Chimneys	None
Open flues	None
Intermittent Extract fans	3 1 (cooker exhaust)
Draught lobby	One None
Primary heating fuel (space and water)	Mains gas
Heating system	Boiler and radiators with energy efficient water pump in heated space(energy consumption of 52kWh/yr)
Boiler Heat generator	Mains gas condensing boiler, seasonal efficiency 91.3%, room-sealed, fanned flue
Heating System Controls	Boiler Interlock and Time and Temperature Zone Control
Hot water system	As for space heating, Solar water heating system with evacuated tube collector of aperture area = 5.0 m², η₀ = 0.6, α_t = 3.0 W/m²K, facing SE/SW at 30 degrees and unshaded, twin coil cylinder 330-120 litre cylinder with 100 mm insulation Remainder of Demand met by space heating boiler, separate time control for space and water heating, cylinder temperature controlled by thermostat 2 shower, each with 6 litres/min flow restrictor ,1 bath
Primary water heating losses	Insulated primary pipework between boiler heat generator and cylinder
Secondary space heating	Gas fire, closed front, fan-assisted, balanced flue — efficiency 80% None
Low energy light fittings	100% low energy lighting, conforming to the following specification: <ul style="list-style-type: none"> · A+ Rated Bulbs with efficacy or 94 lumen/cW · Total =504 Watts
Renewable Energy Source	1.15 kWp Photovoltaic east/west facing, no overshadowing, 30° ,8.6m ² (7.5m ² /kWp)

Table E1.2 Example B: Semi-detached dwelling with gas boiler for space heating and natural ventilation with intermittent extract	
Element or system	Specifications
Dwelling size and shape	Semi-detached house, two-storey Overall internal dimensions: 7 m wide x 9 m deep x 5.1 m high Total floor area 126 m ² Rectangular shape with no irregularities
Opening areas (windows and doors)	25% of total floor area The above includes one opaque door of area 1.85 m ² , any other doors are fully glazed
Walls	U = 0.13 W/m ² K e.g. 150 mm cavity wall with 100 mm cavity insulation of thermal conductivity 0.022 W/mK and 60 mm internal insulation of conductivity 0.022 W/mK
Roof	U = 0.11 W/m ² K e.g. 360 mm insulation of conductivity 0.04 W/mK, between and over ceiling joists
Floor	U = 0.14 W/m ² K e.g. Slab-on-ground floor with 120 mm insulation of conductivity 0.023 W/mK
Opaque door	U = 1.5 W/m ² K
Windows and glazed doors	Double Triple glazed, low E (En = 0.05, soft coat) 20 mm gap, argon filled, PVC frames (U = 1.3 0.9 W/m ² K, solar transmittance = 0.63)
Living area fraction	25% of total floor area
Shading and orientation	All glazing oriented E/W; average overshading
Number of sheltered sides	2
Allowance for thermal bridging at element junctions	0.05 x total exposed surface area (W/m ² K)
Internal heat capacity category	Medium
Ventilation system	Natural ventilation with intermittent extract fans
Air permeability	Infiltration due to structure = 0.25ac/h (5m ³ /(hr.m ²) @50pa)
Chimneys	None
Open flues	None
Intermittent Extract fans	3
Draught lobby	One None
Primary heating fuel (space and water)	Mains gas
Heating system	Boiler and radiators with energy efficient water pump in heated space(energy consumption of 52kWh/yr)
Boiler Heat generator	Mains gas condensing boiler, seasonal efficiency 91.3%, room-sealed, fanned flue
Heating System Controls	Boiler Interlock and Time and Temperature Zone Control
Hot water system	As for space heating, Solar water heating system with evacuated tube collector of aperture area = 5.0 m ² , $\eta^0 = 0.6$, $a^+ = 3.0$ W/m ² K, facing SE/SW at 30 degrees and unshaded, twin coil cylinder 330 120 litre cylinder with 100 mm insulation Remainder of Demand met by space heating boiler, separate time control for space and water heating, cylinder temperature controlled by thermostat 2 showers, each with 6 litres/min flow restrictor, 1 bath
Primary water heating losses	Insulated primary pipework between boiler heat generator and cylinder
Secondary space heating	Gas fire, closed front, fan assisted, balanced flue — efficiency 80% None
Low energy light fittings	100% low energy lighting, conforming to the following specification: · A+ Rated Bulbs with efficacy or 94 lumen/cW · Total =504 Watts
Renewable Energy Source	1.25 kWp Photovoltaic east/west facing, no overshading, 30°, 9.38m ² (7.5m ² /kWp)

Table E1.3 Example C: Semi-detached dwelling with gas boiler for space heating and mechanical ventilation with heat recovery

Element or system	Specifications
Dwelling size and shape	Semi-detached house, two-storey Overall internal dimensions: 7 m wide x 9 m deep x 5.1 m high Total floor area 126 m ² Rectangular shape with no irregularities
Opening areas (windows and doors)	25% of total floor area The above includes one opaque door of area 1.85 m ² , any other doors are fully glazed
Walls	U = 0.13 W/m ² K e.g. 150 mm cavity wall with 100 mm cavity insulation of thermal conductivity 0.022 W/mK and 60 mm internal insulation of conductivity 0.022 W/mK
Roof	U = 0.11 W/m ² K e.g. 360 mm insulation of conductivity 0.04 W/mK, between and over ceiling joists
Floor	U = 0.14 W/m ² K e.g. Slab-on-ground floor with 120 mm insulation of conductivity 0.023 W/mK
Opaque door	U = 1.5 W/m ² K
Windows and glazed doors	Double Triple glazed, low E (En = 0.05, soft coat) 20 mm gap, argon filled, PVC frames (U = 1.3 0.9 W/m ² K, solar transmittance = 0.63)
Living area fraction	25% of total floor area
Shading and orientation	All glazing oriented E/W; average overshadowing
Number of sheltered sides	2
Allowance for thermal bridging at element junctions	0.05 x total exposed surface area (W/m ² K)
Internal heat capacity category	Medium
Ventilation system	Natural ventilation with intermittent extract fans Mechanical Ventilation with Heat Recovery, SFP =0.8, Heat Recovery Efficiency=85%
Air permeability	Infiltration due to structure = 0.15ac/h (3m ³ /(hr.m ²))@50pa)
Chimneys	None
Open flues	None
Intermittent Extract fans	None 1 (cooker exhaust)
Draught lobby	One None
Primary heating fuel (space and water)	Mains gas
Heating system	Boiler and radiators with energy efficient water pump in heated space(energy consumption of 52kWh/yr)
Boiler Heat generator	Mains gas condensing boiler, seasonal efficiency 91.3%, room-sealed, fanned flue
Heating System Controls	Boiler Interlock and Time and Temperature Zone Control
Hot water system	As for space heating, Solar water heating system with evacuated tube collector of aperture area = 5.0 m ² , $\eta^0 = 0.6$, $a^1 = 3.0$ W/m ² K, facing SE/SW at 30 degrees and unshaded, twin coil cylinder 330-120 litre cylinder with 100 mm insulation Remainder of Demand met by space heating boiler, separate time control for space and water heating, cylinder temperature controlled by thermostat 2 showers, each with 6 litres/min flow restrictor ,1 bath
Primary water heating losses	Insulated primary pipework between boiler heat generator and cylinder
Secondary space heating	Gas fire, closed front, fan assisted, balanced flue — efficiency 80% None
Low energy light fittings	100% low energy lighting, conforming to the following specification: · A+ Rated Bulbs with efficacy or 94 lumen/cW · Total =504 Watts
Renewable Energy Source	0.9 kWp Photovoltaic east/west facing, no overshadowing, 30°, 6.8m ² (7.5m ² /kWp)

Table E1.4 Example D: Semi-detached dwelling with heat pumps for space heating and continuous mechanical extract ventilation

Element or system	Specifications
Dwelling size and shape	Semi-detached house, two-storey Overall internal dimensions: 7 m wide x 9 m deep x 5.1 m high Total floor area 126 m ² Rectangular shape with no irregularities
Opening areas (windows and doors)	25% of total floor area The above includes one opaque door of area 1.85 m ² , any other doors are fully glazed
Walls	U = 0.13 W/m ² K e.g. 150 mm cavity wall with 100 mm cavity insulation of thermal conductivity 0.022 W/mK and 60 mm internal insulation of conductivity 0.022 W/mK
Roof	U = 0.11 W/m ² K e.g. 360 mm insulation of conductivity 0.04 W/mK, between and over ceiling joists
Floor	U = 0.14 W/m ² K e.g. Slab-on-ground floor with 120 mm insulation of conductivity 0.023 W/mK
Opaque door	U = 1.5 W/m ² K
Windows and glazed doors	Double Triple glazed, low E (En = 0.05, soft coat) 20 mm gap, argon filled, PVC frames (U = 1.3 0.9 W/m ² K, solar transmittance = 0.63)
Living area fraction	25% of total floor area
Shading and orientation	All glazing oriented E/W; average overshadowing
Number of sheltered sides	2
Allowance for thermal bridging at element junctions	0.05 x total exposed surface area (W/m ² K)
Internal heat capacity category	Medium
Ventilation system	Continuous Mechanical Extract Ventilation with SFP 0.2 W/(l/s)
Air permeability	Infiltration due to structure = 0.15 ac/h(3m ³ /(hr.m ²)) @50pa)
Chimneys	None
Open flues	None
Intermittent Extract fans	None 1 (cooker exhaust)
Draught lobby	One None
Primary heating fuel (space and water)	Mains gas Electricity;
Heating system	Low temperature radiators
Boiler Heat generator	Heat Pump; Space Heating efficiency =350%; Hot Water efficiency = 175%
Heating System Controls	Time and Temperature Zone Control
Hot water system	As for space heating, Solar water heating system with evacuated tube collector of aperture area = 5.0 m²; η^0 = 0.6; a^1 = 3.0 W/m²K, facing SE/SW at 30-degrees and unshaded, twin coil-cylinder 250 litre with 100 mm insulation Remainder of Demand met by heat pump, separate time control for space and water heating, cylinder temperature controlled by thermostat 2 showers, each with 6 litres/min flow restrictor, 1 bath
Primary water heating losses	Insulated primary pipework between boiler heat generator and cylinder
Secondary space heating	Gas fire, closed front, fan-assisted, balanced flue—efficiency 80%
Low energy light fittings	100% low energy lighting, conforming to the following specification: · A+ Rated Bulbs with efficacy or 94 lumen/cW · Total =504 Watts
Renewable Energy Source	Environmental energy from heat pump

Table E1.5 Example E Mid Floor Apartment Dwelling space heating-gas boiler and mechanical ventilation with heat recovery

Element or system	Specifications
Dwelling size and shape	Apartment Dwelling, single-storey Overall internal dimensions: 9 m wide x 9m deep x 2.45 m high Total floor area 81 m ² Rectangular shape with no irregularities
Opening areas (windows and doors)	25% of total floor area The above includes one opaque door of area 1.85 m ² , any other doors are fully glazed
Walls	External U = 0.13 W/m ² K e.g. 150 mm cavity wall with 100 mm cavity insulation of thermal conductivity 0.022 W/mK and 60 mm internal insulation of conductivity 0.022 W/mK Wall Adjoining Unheated Corridor U = 0.194 W/ m ² K
Opaque door	U = 1.5W/m ² K
Windows and glazed doors	Double Triple glazed, low E (En = 0.05, soft coat) 20 mm gap, argon filled, PVC frames (U = 1.3 0.9 W/m ² K, solar transmittance = 0.6)
Living area fraction	25% of total floor area
Shading and orientation	All glazing oriented E/W; average overshading
Number of sheltered sides	2
Allowance for thermal bridging at element junctions	0.05 x total exposed surface area (W/m ² K)
Internal heat capacity category	Medium
Ventilation system	Mechanical Ventilation with Heat Recovery, SFP =0.8, Heat Recovery Efficiency=85%
Air permeability	Infiltration due to structure = 0.15ac/h (3m ³ /(hr.m ²))@50pa
Chimneys	None
Open flues	None
Intermittent Extract fans	None1 (cooker exhaust)
Draught lobby	One
Primary heating fuel (space and water)	Mains gas
Heating system	Radiators
Heat Generator	Mains gas condensing boiler, seasonal efficiency 91.3%, room-sealed, fanned flue
Heating System Controls	Boiler Interlock, Time and Temperature Zone Control
Hot water system	Solar water heating system with evacuated tube collector of aperture area = 5.0 m², $\eta_p = 0.6$, $a^* = 3.0$ W/m²K, facing SE/SW at 30 degrees and unshaded, twin coil cylinder 120 litre with 100 mm insulation Demand met by space heating boiler, separate time control for space and water heating, cylinder temperature controlled by thermostat, 1 shower with 6 litres/min flow restrictor 1 bath
Primary water heating losses	Insulated primary pipework between heat generator and cylinder
Secondary space heating	Gas fire, closed front, fan-assisted, balanced flue — efficiency 80%—None
Low energy light fittings	100% low energy lighting, conforming to the following specification: · A+ Rated Bulbs with efficacy or 94 lumen/cW · Total =324 Watts
Renewable Energy Source	0.6 kWp Photovoltaic east/west facing, no overshading, 30°, 4.5m ² (7.5m ² /kWp)

Table E1.6 Example F Mid Floor Apartment Dwelling space heating-heat pump and continuous mechanical extract ventilation

Element or system	Specifications
Dwelling size and shape	Apartment Dwelling, single-storey Overall internal dimensions: 9 m wide x 9m deep x 2.45 m high Total floor area 81 m ² Rectangular shape with no irregularities
Opening areas (windows and doors)	25% of total floor area The above includes one opaque door of area 1.85 m ² , any other doors are fully glazed
Walls	External U = 0.13 W/m ² K e.g. 150 mm cavity wall with 100 mm cavity insulation of thermal conductivity 0.022 W/mK and 60 mm internal insulation of conductivity 0.022 W/mK Wall Adjoining Unheated Corridor U = 0.194 W/ m ² K
Opaque door	U = 1.5W/m ² K
Windows and glazed doors	Double Triple glazed, low E (En = 0.05, soft coat) 20 mm gap, argon filled, PVC frames (U = 1.3 0.9 W/m ² K, solar transmittance = 0.6)
Living area fraction	25% of total floor area
Shading and orientation	All glazing oriented E/W; average overshadowing
Number of sheltered sides	2
Allowance for thermal bridging at element junctions	0.05 x total exposed surface area (W/m ² K)
Internal heat capacity category	Medium
Ventilation system	Continuous Mechanical Extract Ventilation with SFP 0.2 W/(l/s)
Air permeability	Infiltration due to structure = 0.15ac/h (3m ³ /(hr.m ²)) @50pa
Chimneys	None
Open flues	None
Intermittent Extract fans	None 1 (cooker exhaust)
Draught lobby	One
Primary heating fuel (space and water)	Electricity
Heating system	Low Temperature Radiators
Heat Generator	Heat Pump; Space Heating efficiency =400%; Hot Water efficiency = 200%
Heating System Controls	Boiler Interlock, Time and Temperature Zone Control
Hot water system	Solar water heating system with evacuated tube collector of aperture area = 5.0 m²; $\eta^0 = 0.6$; $a^+ = 3.0$ W/m²K, facing SE/SW at 30 degrees and unshaded; twin coil cylinder 180 litre with 100 mm insulation Demand met by heat pump, separate time control for space and water heating, cylinder temperature controlled by thermostat, 1 shower with 6 litres/min flow restrictor 1 bath
Primary water heating losses	Insulated primary pipework between heat generator and cylinder
Secondary space heating	Gas fire, closed front, fan-assisted, balanced flue — efficiency 80% None
Low energy light fittings	100% low energy lighting, conforming to the following specification: <ul style="list-style-type: none"> · A+ Rated Bulbs with efficacy or 94 lumen/cW · Total =324 Watts
Renewable Energy Source	Environmental heat from heat pump

E.2 The standardized primary energy consumption and CO₂ emissions for space heating, water heating, ventilation and lighting for this dwelling, as calculated by DEAP, are given in Table E2, expressed per m² of floor area per annum. The table shows that the calculated EPC complies with the MPEPC requirement of 0.30, and the CPC complies with the MPCPC requirement of 0.35 with a margin to spare.

~~If the boiler ran on heating oil rather than mains gas, and the secondary heater on bottled LPG, with a boiler efficiency of 93%, the dwelling would still comply. The results for running the boiler on heating oil and the secondary heater on bottled LPG are also shown in the Table E2.~~

Table E2 Example Dwellings - Results						
	Example A-Semi Detached heated by mains gas and cmev	Example B-Semi Detached heated by mains gas and nv with intermittent extract	Example C-Semi Detached heated by mains gas and mvhr	Example D Semidetached heated by heat pump and cmev by oil (with secondary heating by LPG)	Example E Apartment heated by gas and mvhr by	Example F Apartment heated by heat pump and cmev by
Primary energy [kWh/m ² yr]	59-43	43	39	42	38	40
CO ₂ emissions [kg/m ² yr]	12-8	8	7	7	7	7
EPC	0.40-0.296	0.297	0.270	0.289	0.285	0.297
CPC	0.37-0.275	0.277	0.247	0.239	0.268	0.253
RER	0.23	0.24	0.20	0.35	0.21	0.36

Appendix F Heat Pumps

This section provides guidance on the specification of heat pump systems in dwellings for the provision of space heating and domestic hot water to meet relevant energy efficiency requirements in the Building Regulations.

A heat pump is a device which takes heat energy from a low temperature source and upgrades it to a higher temperature at which it can be usefully employed for heating or hot water. Heat pumps may supply all or part of the heating load.

The guidance in this section applies to the types of electrically-driven heat pump in Table 35 used as the heat generator in underfloor, warm air and medium temperature radiator heating systems, etc.

Heat pump type
Ground source heat pump (GSHP) systems Heat energy is extracted from the ground using closed pipe loops buried horizontally in trenches or in vertical boreholes that are connected back to the GSHP. The fluid circulating in the closed loop is normally a water/propylene glycol antifreeze mixture or accepted equivalent but some direct expansion GSHPs use refrigerant. Open loops may also be used to collect water from an aquifer and discharge via a separate aquifer downstream of the water table flow; systems of this type normally require permits from the Environmental Protection Agency. Heat extracted from the ground may be supplied to a dwelling either by a water-based heating system (ground-to- water heat pump) or by an air distribution system (ground-to-air heat pump). These heat pumps are suitable for use with warm water and hot water distribution systems.
Water source heat pump (WSHP) systems Heat energy is extracted indirectly from a water source using closed pipe loops as a heat exchanger. The closed loop is connected back to the water- to- water heat pump. The water source may be a lake, pond or river or other stable water source. The fluid circulating in the closed loop will normally be water but a water/propylene glycol or accepted equivalent antifreeze mixture may be used, depending on operating temperatures. Open loops may also be used subject to the permits being obtained from the Environmental Protection Agency. Heat may be supplied to the dwelling either by a water-based heating system (water-to-water heat pump) or by an air distribution system (water-to-air heat pump). These heat pumps are suitable for use with warm water and hot water distribution systems.
Air source heat pump (ASHP) systems Air source heat pumps extract heat directly from the ambient air. Heat is supplied to the dwelling either by a water based heating system (air-to-water heat pump) or by an air distribution system (air-to-air heat pump). Air source heat pumps may be single package or split systems.

Key Terms

Coefficient of performance (COP) is a measure of the efficiency of a heat pump at specified source and sink temperatures, but may not accurately represent installed performance:

- Heating COP = heat output / power input
- % COP (COP by 100) is the heat generator efficiency.

COP is measured in accordance with the procedures in I.S. EN 14511:2013, Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling.

Seasonal coefficient of performance (SCOP) is the overall coefficient of performance of the heat pump over the designated heating season. It makes general assumptions about the amount of auxiliary heating needed to top up the space and water heating available from the heat pump.

SCOP is measured in accordance with the procedures in I.S. EN 14825:2013, Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling. Testing and rating at part load conditions and calculation at seasonal performance.

Seasonal performance factor (SPF) is another measure of the operating performance of an electric heat pump over the season. It is the ratio of the heat delivered to the total electrical energy supplied over the season, but there are up to seven different ways to draw the system boundaries. For example, SPF_{H2} (which is SCOP) excludes auxiliary resistance heating whereas SPF_{H4} includes it.

DEAP calculations use SPF – either measured values for products listed in the HARP Database, or the default values in table 4a for products not listed there.

Seasonal primary energy efficiency (SPEER) is an emerging rating figure reflecting the use of primary energy for all types of heat pump, fossil fuel boiler and gas driven cogeneration technologies, as well as hybrid systems where solar heating or a heat pump is backed up with electric heating or a fossil fuel boiler.

Energy labelling with the SPEER is mandatory under the Energy Labelling Directive. Testing and rating is in accordance with I.S. EN 14825, as for SCOP.

Warm water and hot water heat pumps

At the time of preparation of this guide, European Commission Regulation No 206/2012 sets standards for the SCOP of electrically-driven air-to-air heat pumps with an output is less than 12kw. There are currently no European test standards for part- load testing of air- to- air heat pumps with an output is greater than 12 kw or for other types of heat pump, and the performance of these must be specified using COP obtained at the heating system rating conditions.

Heat pumps should meet the provisions in the following tables:

- (a) Meet the minimum standards for supply temperature, wet system radiator efficiency, installation and commissioning, hot water and controls in Table F. 1 for warm water and hot water heat pumps

Table F.1

	Minimum standard	Supplementary information
1.0 Supply water temperatures and efficiency	Underfloor heating (a) supply water temperatures to the underfloor heating system should be in the range 30°C to 40°C for new buildings and 30°C to 55°C for existing systems	
	Radiators (b) High- efficiency radiators with high water volume should be utilised (c) Supply water temperature to the radiators Should be in the range 40°C to 55°C	Space heating may be sized to meet all or part of the space heating load secondary heating will be required if the heat pump is sized to meet part of The space heating load.
	Fan coil units (d) Supply water temperature to the fan coil units Should be in the range 35°C 45°C	Fan coil units may be utilised for heating only or for winter heating and summer cooling.

	Minimum standard	Supplementary information
2.0 Installation and commissioning	<p>a. The water distribution system should be arranged for reverse return operation or arranged with a low loss manifold system to maximise efficiency and ease commissioning and future maintenance.</p> <p>b. Pipework not contributing to the space heating should be insulated to prevent heat loss, following the guidance of the TIMSA guide.</p> <p>c. If summer cooling is provided by the heat pump, all water distribution pipework should be insulated to prevent condensation, following the guidance in the TIMSA guide.</p> <p>d. External pipework between the dwelling and the ground heat exchanger should be insulated, following the TIMSA guidance.</p> <p>e. The ground loop water circuit should be protected with an antifreeze solution and inhibitor as recommended by the heat pump manufacturer.</p> <p>f. Ground loops should be cleaned with a</p>	<p>Design</p> <p>A pressurised water distribution system with expansion vessel is recommended.</p> <p>Constant water flow should be maintained through the heat pump.</p> <p>Pipe sizes should be in accordance with the manufacturer's recommendations.</p> <p>Installation</p> <p>Installation should be carried out by an installer approved by the manufacturer.</p> <p>If during installation access to the refrigeration circuit is needed, a competent refrigeration and air conditioning engineer holding a should carry out the work.</p> <p>Exposed refrigeration pipework should be insulated and enclosed in protective trunking to limit accidental damage.</p>

	<p>cleaning fluid and biocide as part of the commissioning process.</p> <p>g. The internal water distribution circuit should contain an inhibitor and may be protected by an antifreeze solution as recommended by the heat pump manufacturer.</p> <p>h. Ground loops should be filled with a heat transfer fluid. Installers should also refer to the equipment manufacturer's installation instructions for appropriate treatment products and special requirements for individual appliance models</p>	<p>Installation of the dwelling's water distribution system should be undertaken by a competent central heating specialist.</p> <p>Guidance and standards</p> <p><i>TIMSA HVAC guidance for achieving compliance with Part L of the Building Regulations.</i></p> <p><i>BS EN 378:2008 Refrigerating systems and heat pumps. Safety and environmental requirements.</i></p> <p><i>TR30 Guide to good practice – heat pumps, HVCA, July 2007.</i></p> <p><i>MIS 3005 Requirements for contractors undertaking the supply, design, installation, set to work, commissioning and handover of microgeneration heat pump systems, DECC</i></p>
	Minimum standard	Supplementary information
3.0 Domestic Hot Water (DHW)	<p>e. For full heating, the heat pump and any supplementary domestic hot water heating should be capable of supplying water in the range 60°C to 65°C. This is applicable to ground -to-water, water-to-water and air-to-water type heat pumps.</p> <p>f. If the heat pump is not capable of supplying water at these temperatures, supplementary heating should be provided and controlled as described in other sections of this guide.</p> <p>Controls should include an auxiliary heating regime to 60°C or more for disinfection purposes.</p> <p>g. the domestic hot water system should have temperature control (e.g. a tank thermostat) and time control to optimise the time taken to heat the water</p>	<p>The heat pump may be utilised for all or part of the DHW load. During the DHW heating period the heat pump may not necessarily be providing heated water to the space heating system</p>
4.0 Controls	d. Heat pump unit controls should include:	

	<ul style="list-style-type: none"> ix. control of water pump operation (internal and external as appropriate) x. Control of water temperature for the distribution system. xi. Control of outdoor fan operation for air-to-water units. xii. Defrost control of external airside heat exchanger for air-to-water systems. xiii. Protection for water flow failure xiv. Protection for water high temperature xv. Protection for high refrigerant pressure xvi. Protection of air flow failure on air-to-water units. e. External controls should include: <ul style="list-style-type: none"> iii. weather compensation or internal temperature control iv. timer or programmer for space heating. f. Minimum heat pump flow rates or volume requirements should be met. If all zones are thermostatically controlled, then a buffer would be an acceptable method of compliance. 	
	Minimum Standards	Supplementary Information
1.0 Installation	<ul style="list-style-type: none"> a. Minimum clearances adjacent to all airflow paths, as recommended by the manufacturer, Should be maintained. b. Pipe sizes should be in accordance with the manufacturer's recommendations. c. The refrigerant pipework on the split systems should be insulated in line with the manufacturer's recommendations. 	<p>Installation should be carried out by an installer approved by the manufacturer.</p> <p>Installation that requires access to the refrigeration circuit, or the connection of split systems, should be carried out by a competent refrigeration and air conditioning engineer holding a refrigerant handling certificate</p> <p><i>TIMSA HVAC Guidance for achieving compliance with Part L of the Building</i></p>

	<ul style="list-style-type: none"> d. If summer cooling is provided by the heat pump, provision should be made for condensate drainage from the indoor terminal units. e. For ground-to-air systems all external pipework between the dwelling and the external heat exchanger should be insulated following TIMSA guidance. f. For ground-to-air and water-to-air systems constant water flow should be maintained through the heat pump. 	<i>Regulations.</i>
2.0 Controls	<ul style="list-style-type: none"> a. Heat pump unit controls should include: <ul style="list-style-type: none"> i. Control of room air temperature (if not provided externally) ii. Control of outdoor fan operation for air-to-air units. iii. Defrost control of external airside heat exchanger for air-to-air systems. iv. Control for secondary heating (if fitted) on air-to-air systems. v. Control of external water pump operation for ground-to-air and water-to-air systems. vi. Protection for high refrigerant pressure. vii. Protection for indoor air flow failure. viii. Protection for external air flow failure on air-to-air units. ix. Protection of water flow failure on ground-to-air and water-to-air systems. b. External controls should include: <ul style="list-style-type: none"> i. Weather compensation or internal temperature control. ii. Timer or programmer for space 	

	<p>heating.</p> <p>Minimum heat pump flow rates or volume requirements should be met. If all zones are thermostatically controlled, then a buffer would be an acceptable method of compliance.</p>	
--	--	--

Standards referred to:

I.S. 161: 1975 Copper direct cylinders for domestic purposes

I.S. EN 1745: ~~2002~~2012 Masonry and masonry products - Methods for determining design thermal values

I.S. EN 1996: 2010 Eurocode 6; Design of masonry structures

I.S. EN 13707: ~~2004+A2: 2009~~ 2013 Flexible sheets for waterproofing - Reinforced bitumen sheets for roof waterproofing - Definitions and characteristics

I.S. EN 15026: 2007 Hygrothermal performance of building components and building elements – Assessment of moisture transfer by numerical simulation

I.S. EN ISO 6946: 2007 Building components and building elements – Thermal resistance and thermal transmittance – Calculation method

I.S. EN ISO 8990: 1997 Thermal insulation – Determination of steady-state thermal transmission properties – Calibrated and guarded hot box

I.S. EN ISO 9972:2015~~13829: 2000~~ Thermal performance of buildings: determination of air permeability of buildings: fan pressurization method

I.S. EN ISO 10077-1: 2006 Thermal performance of windows, doors and shutters – Calculation of thermal transmittance – Part 1: Simplified method

I.S. EN ISO 10077-2: ~~2003~~2012 Thermal performance of windows, doors and shutters – Calculation of thermal transmittance – Part 2: Numerical methods for frames

I.S. EN ISO 10211: 2007 Thermal bridges in building construction – Heat flows and surface temperatures – Detailed calculations

I.S. EN ISO 10456: 2007 Building materials and products - Procedures for determining declared and design thermal values

I.S. EN ISO 12567-1: ~~2004~~2010 Thermal performance of windows and doors – Determination of thermal transmittance by hot box method – Part 1: Complete windows and doors

I.S. EN ISO 13370: 2007 Thermal performance of buildings – Heat transfer via the ground – Calculation methods

I.S. EN ISO 13788: ~~2002~~ 2012 Hygrothermal performance of building components and building elements - Internal surface temperature to avoid critical surface humidity and interstitial condensation - Calculation Methods (ISO 13788: 2001)

I.S. EN ISO 13789: 2007 Thermal performance of buildings – Transmission heat loss coefficient – Calculation method

SR 50-2: ~~2011~~2012 Code of practice for building services - Part 2: Solar panels (~~to be published~~)

BS 1566 Part 1: 2002 Copper indirect cylinders for domestic purposes, open vented copper cylinders. Requirements and test methods

BS 5422: 2009 Method for specifying thermal insulating materials for pipes, tanks, vessels, ductwork and equipment (operating within the temperature range – 40°C to + 700°C)

BS 8206 Part 2: 2008 Lighting for buildings. Code of practice for daylighting

Publications referred to:

Advice Series, Energy Efficiency in Traditional Buildings, Department of the Environment, Heritage and Local Government 2010

Airtightness testing for new dwellings, A BSRIA Guide, Chris Knights and Nigel Potter, BSRIA 2006

BRE Digest 465, U-values for light steel frame construction, BRE 2002

BRE Good Building Guide 68 Part 2 Installing thermal insulation: Good site practice, BRE 2006

BRE Information Paper 1/06 Assessing the effects of thermal bridging at junctions and around openings, BRE 2001

BRE Information Paper 10/02, Metal cladding: assessing the thermal performance of built-up systems using 'Z' spacers, BRE 2002

BRE Report BR 262, Thermal Insulation: avoiding risks, BRE 2001

BRE Report BR 364, Solar shading of buildings, BRE 1999

BRE Report BR 443, Conventions for U-value calculations, BRE 2006

BRE Report BR 497, Conventions for calculating linear thermal transmittance and temperature factors, BRE 2007

CIBSE Guide A: Environmental design - Section 3: Thermal properties of buildings and components, CIBSE 2006

CIBSE SLL Lighting Guide 10: Daylighting and window design, CIBSE 1999

CIBSE TM 23: Testing buildings for air leakage, CIBSE 2000

Domestic Energy Assessment Procedure (DEAP), SEAI 2006 (www.seai.ie)

European Communities (Efficiency requirements for hot water boilers fired with liquid or gaseous fuels) Regulations 1994, S.I. No. 260 of 1994, Department of Transport, Energy and Communications 1994

Good Practice Guide 268, Energy efficient ventilation in dwellings – A guide for specifiers, 2006

Home-heating Appliance Register of Performance (HARP) database, SEAI (www.seai.ie)

Heating and Domestic Hot Water Systems for Dwellings – Achieving compliance with Part L 2011 (to be published)

Limiting Thermal Bridging and Air Infiltration – Acceptable Construction Details (2011 Edition to be published)

MCRMA Technical Paper No. 14, Guidance for the design of metal roofing and cladding to comply with Approved Document L2: 2001, The Metal Cladding and Roofing Manufacturers Association 2002

Planning Guidelines No. 9: Architectural Heritage Protection - Guidelines for Planning Authorities, Department of the Environment, Heritage and Local Government 2004

SCI Technical Information Sheet 312, Metal cladding: U-value calculation - Assessing thermal performance of built-up metal roof and wall cladding systems using rail and bracket spacers, The Steel Construction Institute 2002

Technical Standard L1, Measuring air permeability in the air envelopes of dwellings, ATTMA 2010

Window Energy Performance Certification Scheme (WEP), National Standards Authority of Ireland

Other standards and publications

CE 82 Energy Efficiency Best Practice in Housing: Domestic ground source heat pumps: design and installation of closed loop system.

CIBSE Good practice in the design of homes TM60:2018

Design of low-temperature domestic heating systems – A guide for system designers and installers. FB 59. HIS BRE Press. Available from www.brebookshop.com

HVCA TR30 Guide to good practice :Heat pumps.

I.S. EN 303-5: 1999 Heating boilers - Heating boilers for solid fuels, hand and automatically stoked, nominal heat output of up to 300 kw - Terminology requirements, testing and marking

I.S. EN 378-1:2008+A2:2012 Refrigerating systems and heat pumps. Safety and environmental requirements. Basic requirements, Definitions, classification and selection criteria.

I.S. EN 378-1:2008+A2:2012 Refrigerating systems and heat pumps. Safety and environmental requirements. Design, construction, testing, marking and documentation.

I.S. EN 378-1:2008+A2:2012 Refrigerating systems and heat pumps. Safety and environmental requirements. Installation site and personal protection.

I.S. EN 378-1:2008+A2:2012 Refrigerating systems and heat pumps. Safety and environmental requirements. Operation, maintenance, repair and recovery.

I.S. EN 12664: 2001 Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meters method – Dry and moist products of low and medium thermal resistance

I.S. EN 12667: 2001 Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meters method – Products of high and medium thermal resistance

I.S. EN 12975-1: 2006 Thermal solar systems and components - Solar collectors - Part 1: General requirements

I.S. EN 12828: 2003 Heating systems in buildings - Design for water-based heating systems

I.S. EN 12939: 2001 Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meters method – Thick products of high and medium thermal resistance

I.S. EN 12975-2: 2006 Thermal solar systems and components - Solar collectors - Part 2: Test methods

I.S. EN 12976-1: 2006 Thermal solar systems and components - Factory made systems - Part 1: General requirements

I.S. EN 12976-2: 2006 Thermal solar systems and components - Factory made systems - Part 2: Test methods

I.S. EN 14785: 2006 Residential space heating appliances fired by wood pellets - Requirements

Other standards and publications

and test methods

I.S. EN 14511-1: 2004 Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling - Part 1: Terms and definitions

I.S. EN 14511-2: 2004 Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling - Part 2: Test conditions

I.S. EN 14511-3: 2004 Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling - Part 3: Test methods

I.S. EN 14511-4: 2004 Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling - Part 4: Requirements

I.S. EN 15270: 2007 Pellet burners for small heating boilers - Definitions, requirements, testing, marking

I.S. EN 15316-4-2: 2008 Heating systems in buildings: Methods for calculation of system energy requirements and system efficiencies. Space heating generation systems, Heat pump systems.

I.S. EN 15450: 2007 Heating systems in Buildings. Design of heat pump heating systems.

IS ENV 12977-1: 2001 Thermal solar systems and components - Custom built systems - Part 1: General requirements

I.S. ENV 12977-2: 2001 Thermal solar systems and components - Custom built systems - Part 2: Test methods

ISO 9806-1: 1994 Test methods for solar collectors - Part 1: Thermal performance of glazed liquid heating collectors including pressure drop

ISO 9806-2: 1995 Test methods for solar collectors - Part 2: Qualification test procedures

ISO 9806-3: 1995 Test methods for solar collectors - Part 3: Thermal performance of unglazed liquid heating collectors (sensible heat transfer only) including pressure drop

ISO 13256-1:1998 Water-source heat pumps. Testing and rating for performance. Water-to-air and brine-to-air heat pumps.

ISO 13256-1:1998 Water-source heat pumps. Testing and rating for performance. Water-to-water and brine-to-water heat pumps.

Microgeneration Certification Scheme standard MIS 3005 Requirements for contractors undertaking the supply, design, installation, set to work, commissioning, and handover of microgeneration heat pump systems.

Microgeneration Certification Scheme Standard MIS 3007 Product certification requirements – heat pumps.

For Public Consultation



Printed on recycled paper containing a
minimum of 75% post-consumer waste

ISBN 978-1-4064-2594-9



9 781406 425949